

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id KAESER 6888993 (S/N 2110)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar202	0 Apr2021	May2022 A	ug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC102153	KC90492	KC88622
Sample Date		Client Info		05 Aug 2023	19 May 2022	29 Apr 2021
Machine Age	hrs	Client Info		10532	7170	4419
Oil Age	hrs	Client Info		3362	2751	2843
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	<1	<1	0
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	8	5	6
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	0	1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	<1	3	6
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		4	8	2
Zinc	ppm	ASTM D5185m		11	20	13
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	0	1	1
Water	%	ASTM D6304	>0.05	0.004	0.005	0.009
ppm Water	ppm	ASTM D6304	>500	43.2	58.1	92.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4340	4503	1057
Particles >6µm		ASTM D7647	>1300	1224	1239	381
Particles >14µm		ASTM D7647	>80	59	<u> </u>	64
Particles >21µm		ASTM D7647	>20	13	<u>44</u>	24
Particles >38µm		ASTM D7647	>4	1	2	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	△ 19/17/14	16/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Asid Number (AN)	I/OII/-	ACTM DODAE	0.4	0.40	0.44	0.070

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.44


0.40

0.379



OIL ANALYSIS REPORT

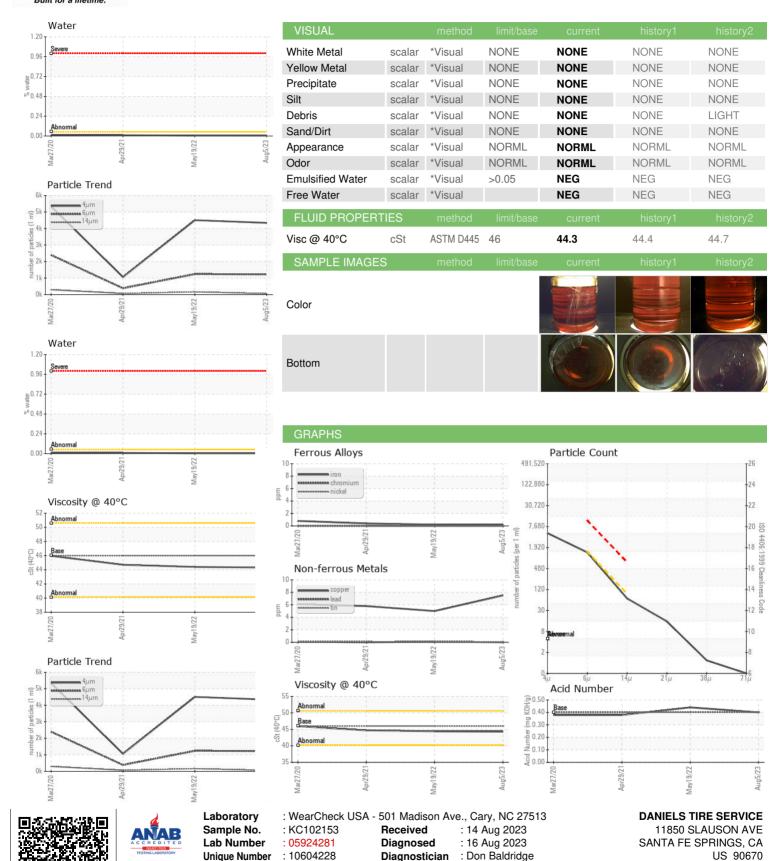



Certificate L2367

Test Package

: IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

Contact: Service Manager