


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



# KAESER AS 25T 2409903 (S/N 1035)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec2016 No	ov2017 Mar2019 Dec	2019 Nov2020 Nov2021	Dec2022	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP35030	KCP55515	KCP40777
Sample Date		Client Info		29 Jun 2023	28 Dec 2022	27 Jun 2022
Machine Age	hrs	Client Info		66536	66403	62113
Oil Age	hrs	Client Info		4423	4290	213
Oil Changed		Client Info		Changed	Not Changd	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	9	11	11
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	0	0	2
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	3	0	5
Zinc	ppm	ASTM D5185m	0	3	0	5
Sulfur	ppm	ASTM D5185m	23500	19306	21413	19893
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.05	0.004	0.005	0.014
ppm Water	ppm	ASTM D6304	>500	45.4	57.2	143.8
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		848	3622	4184
Particles >6μm		ASTM D7647	>1300	271	832	855
Particles >14µm		ASTM D7647	>80	26	37	38
Particles >21µm		ASTM D7647	>20	8	7	5
Particles >38µm		ASTM D7647	>4	1	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>17/13	15/12	17/12	17/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A 1 1 1 1 (AA)	140114	10711 00015	4.0			



## OIL ANALYSIS REPORT

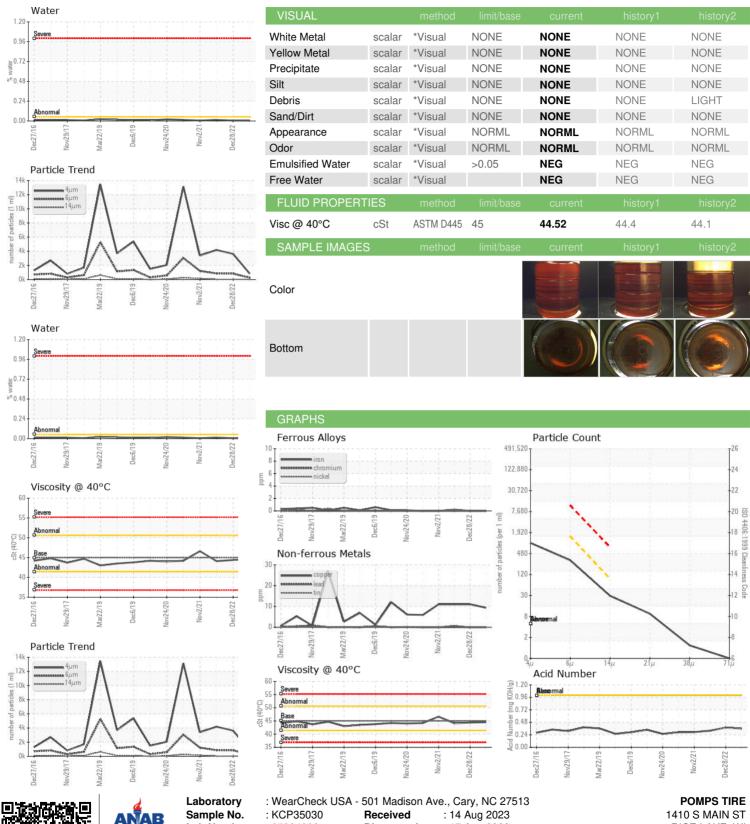



Certificate L2367

Lab Number **Unique Number** 

: 05924282 : 10604229

Diagnosed : 17 Aug 2023

Diagnostician : Jonathan Hester Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

RICE LAKE, WI US 54868

Contact: SERVICE MANAGER

T: F: