



# **PROBLEM SUMMARY**

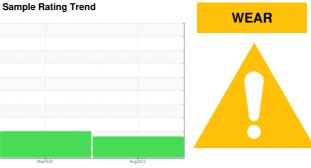

# KAESER 5259677 Component Compressor

## COMPONENT CONDITION SUMMARY

KAESER SIGMA (OEM) M-460 (--- GAL)

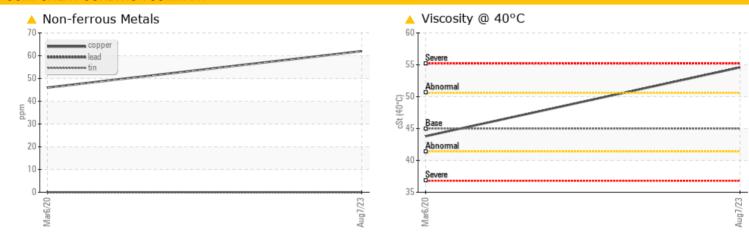

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	
Copper	ppm	ASTM D5185m	>50	<u> </u>	46	
Debris	scalar	*Visual	NONE	🔺 MODER	NONE	
Visc @ 40°C	cSt	ASTM D445	45	<b>6</b> 54.6	43.8	

Customer Id: BLEPIK Sample No.: KC05924283 Lab Number: 05924283 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED	ACTIONS			
Action	Status	Date	Done By	Description
Alert			?	We were unal particles pres

We were unable to perform a particle count due to a high concentration of particles present in this sample.

### HISTORICAL DIAGNOSIS

# ISO



### 06 Mar 2020 Diag: Don Baldridge

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

### Sample Rating Trend

WEAR

KAESER 5259677

### Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

### DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### A Wear

The copper level is abnormal. All other component wear rates are normal.

#### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05924283	KCP24027	
Sample Date		Client Info		07 Aug 2023	06 Mar 2020	
Machine Age	hrs	Client Info		13680	2301	
Oil Age	hrs	Client Info		0	2301	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	2	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	<u> </u>	46	
Tin	ppm	ASTM D5185m	>10	<1	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	
Barium	ppm	ASTM D5185m	90	0	<1	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	<1	5	
Calcium	ppm	ASTM D5185m	0	0	<1	
Phosphorus	ppm	ASTM D5185m	0	6	0	
Zinc	ppm	ASTM D5185m	0	0	4	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	6	<1	
Sodium	ppm	ASTM D5185m		2	3	
Potassium	ppm	ASTM D5185m	>20	<1	<1	
Water	%	ASTM D6304	>0.05	0.003	0.007	
ppm Water	ppm	ASTM D6304	>500	34.9	70.3	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647			29421	
Particles >6µm		ASTM D7647	>1300		<b>1</b> 0619	
Particles >14µm		ASTM D7647	>80		<b>1</b> 719	
Particles >21µm		ASTM D7647	>20		<b>1</b> 54	
Particles >38µm		ASTM D7647	>4		<u> </u>	
Particles >71µm		ASTM D7647	>3		<mark>▲</mark> 3	
Oil Cleanliness		ISO 4406 (c)	>/17/13		<b>1</b> /17	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.23	0.210	

Contact/Location: Service Manager - BLEPIK



Acid Number

1.20

# **OIL ANALYSIS REPORT**

method


limit/base


current


history1

history2

VISUAL





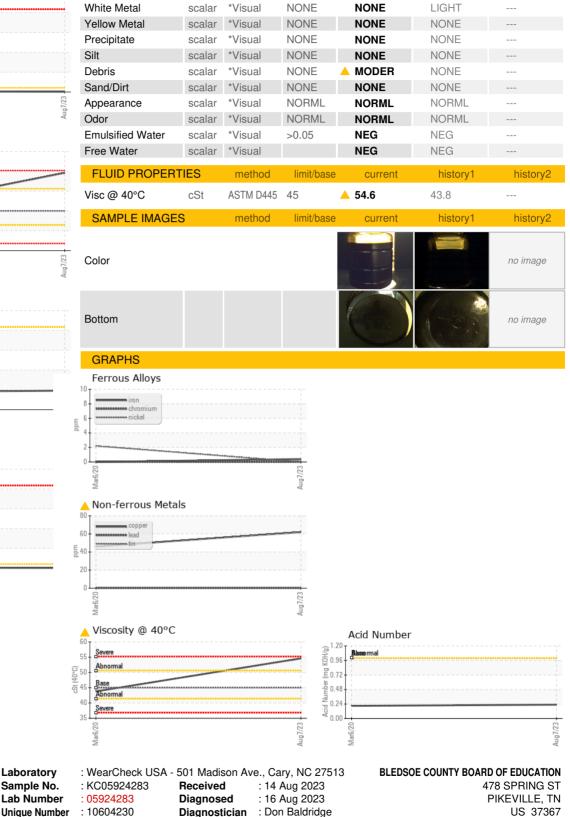

(B/H0.9 Ê0.7 Ê n 48 Pio 0.2 0.00 Water 1.20 0.9 0.72<u>ي</u> a<sup>2</sup>0.48 0.24 Abnorma 0.00 AarG



Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Laboratory

Sample No.

Lab Number