




PROBLEM SUMMARY


Sample Rating Trend

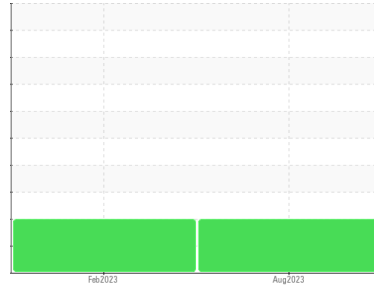

Machine Id
KAESER BSD50 6549617 (S/N 1506)
 Component
Compressor
 Fluid
FG ADVANTAGE (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

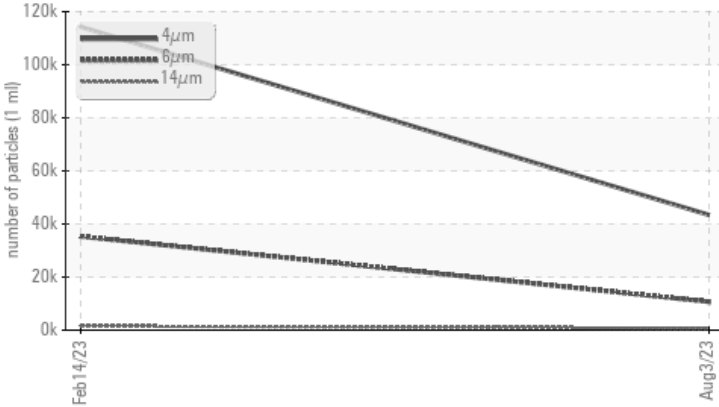

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 10691	▲ 35294	---
Particles >14µm	ASTM D7647	>80	▲ 676	▲ 1536	---
Particles >21µm	ASTM D7647	>20	▲ 175	▲ 247	---
Particles >38µm	ASTM D7647	>4	▲ 6	▲ 18	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 23/21/17	▲ 24/22/18	---

Customer Id: NEXLEXOH
 Sample No.: KC111394
 Lab Number: 05924307
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

14 Feb 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

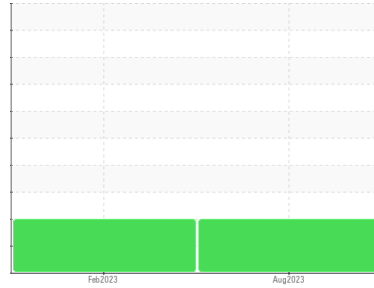

Machine Id
KAESER BSD50 6549617 (S/N 1506)
 Component
Compressor
 Fluid
FG ADVANTAGE (--- GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		KC111394	KC101414	---
Sample Date	Client Info		03 Aug 2023	14 Feb 2023	---
Machine Age	hrs	Client Info	35738	32446	---
Oil Age	hrs	Client Info	7200	4000	---
Oil Changed	Client Info		Changed	Not Changd	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	<1	2	---
Lead	ppm	ASTM D5185m >10	0	<1	---
Copper	ppm	ASTM D5185m >50	1	6	---
Tin	ppm	ASTM D5185m >10	0	<1	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---





ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	<1	0	---
Magnesium	ppm	ASTM D5185m	<1	<1	---
Calcium	ppm	ASTM D5185m	<1	<1	---
Phosphorus	ppm	ASTM D5185m	37	36	---
Zinc	ppm	ASTM D5185m	34	88	---

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	5	---
Sodium	ppm	ASTM D5185m	2	5	---
Potassium	ppm	ASTM D5185m >20	<1	1	---
Water	%	ASTM D6304 >0.05	0.002	0.003	---
ppm Water	ppm	ASTM D6304 >500	22.5	35.3	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		43409	114288	---
Particles >6µm	ASTM D7647 >1300		▲ 10691	▲ 35294	---
Particles >14µm	ASTM D7647 >80		▲ 676	▲ 1536	---
Particles >21µm	ASTM D7647 >20		▲ 175	▲ 247	---
Particles >38µm	ASTM D7647 >4		▲ 6	▲ 18	---
Particles >71µm	ASTM D7647 >3		0	1	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 23/21/17	▲ 24/22/18	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.32	0.56	---


OIL ANALYSIS REPORT

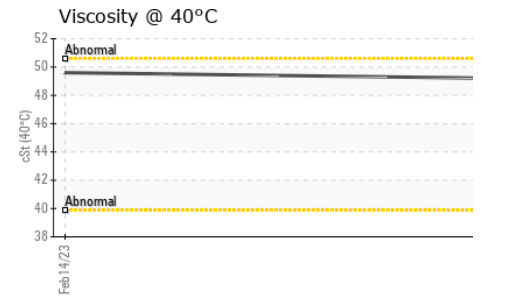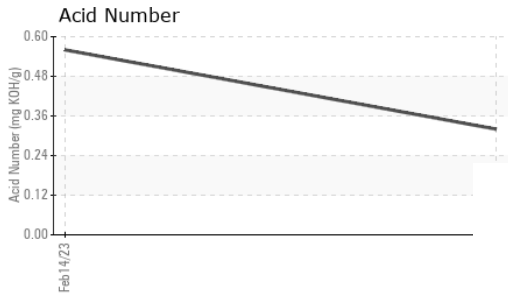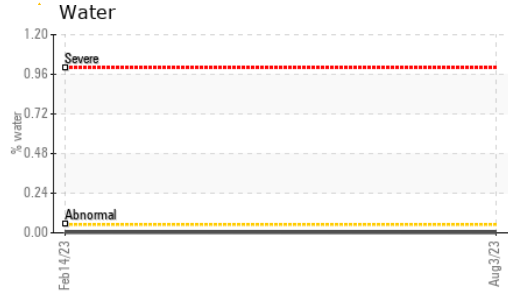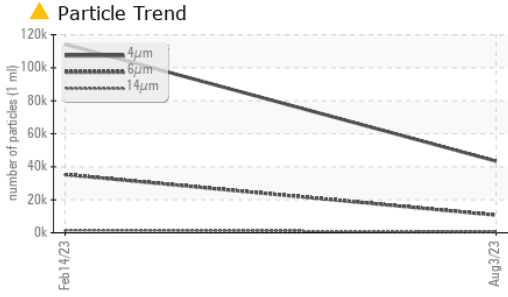





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.2	49.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

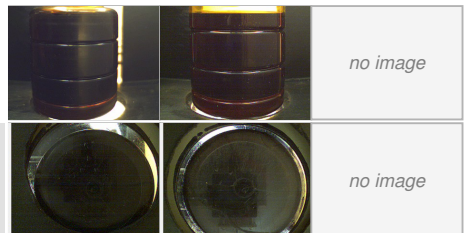

GRAPHS

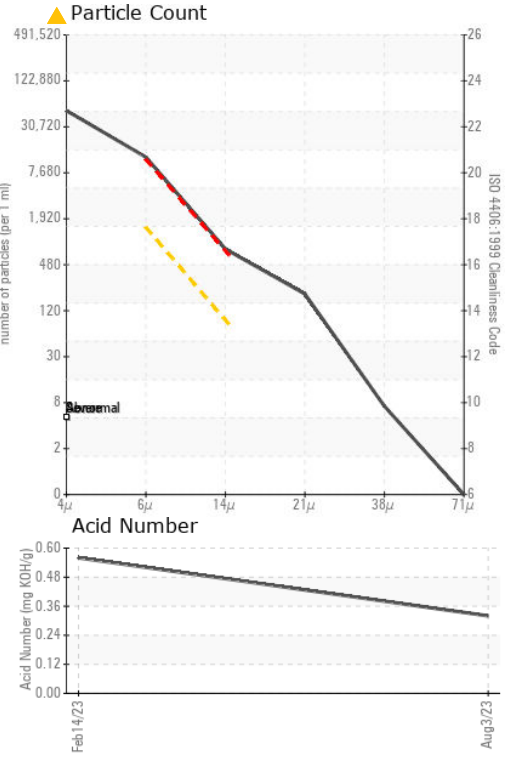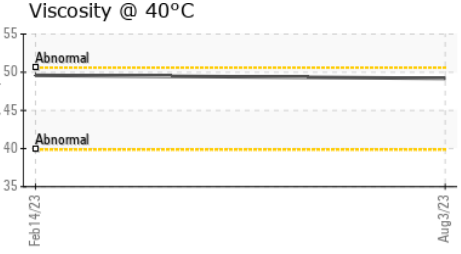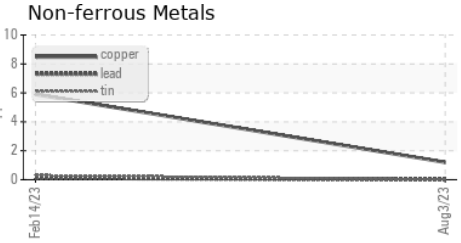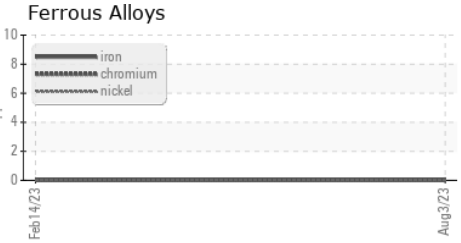

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC111394 **Received** : 14 Aug 2023
Lab Number : 05924307 **Diagnosed** : 16 Aug 2023
Unique Number : 10604254 **Diagnostician** : Don Baldrige
Test Package : IND 2

NEXT GEN
 170 INDUSTRIAL DR
 LEXINGTON, OH
 US 44904
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)