

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id 7807120 (S/N 1011) Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


			Nov2021	Aug2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP48055D	KCP43519	
Sample Date		Client Info		14 Aug 2023	15 Nov 2021	
Machine Age	hrs	Client Info		14935	3883	
Oil Age	hrs	Client Info		2000	3833	
Oil Changed		Client Info		Changed	Not Changd	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	10	35	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	2	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	1	1	
Lead	ppm	ASTM D5185m	>10	0	0	
		ASTM D5185m		1	3	
Copper Tin	ppm	ASTM D5185m	>50 >10	0	0	
	ppm		>10	-		
Antimony	ppm	ASTM D5185m			<1	
Vanadium	ppm	ASTM D5185m		0	<1	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	15	
Barium	ppm	ASTM D5185m	90	124	94	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	135	100	
Calcium	ppm	ASTM D5185m	2	4	4	
Phosphorus	ppm	ASTM D5185m		2	2	
Zinc	ppm	ASTM D5185m		<1	3	
Sulfur	ppm	ASTM D5185m		17752	18194	
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	
Sodium	ppm	ASTM D5185m		22	16	
Potassium	ppm	ASTM D5185m	>20	3	6	
Water	%	ASTM D6304	>0.05	0.029	0.031	
ppm Water	ppm	ASTM D6304	>500	299.2	319.3	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3301		
Particles >6µm		ASTM D7647	>1300	893		
Particles >14μm		ASTM D7647	>80	59		
Particles >21µm		ASTM D7647		18		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.50	0.360	
-40.56) Boy: 1		. 10 1 11 200-10	5.1		ion: Service Mai	

Report Id: THEPLE [WUSCAR] 05924323 (Generated: 08/16/2023 09:40:56) Rev: 1


Contact/Location: Service Manager - THEPLE




OIL ANALYSIS REPORT





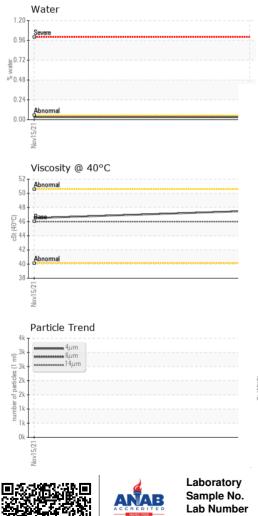

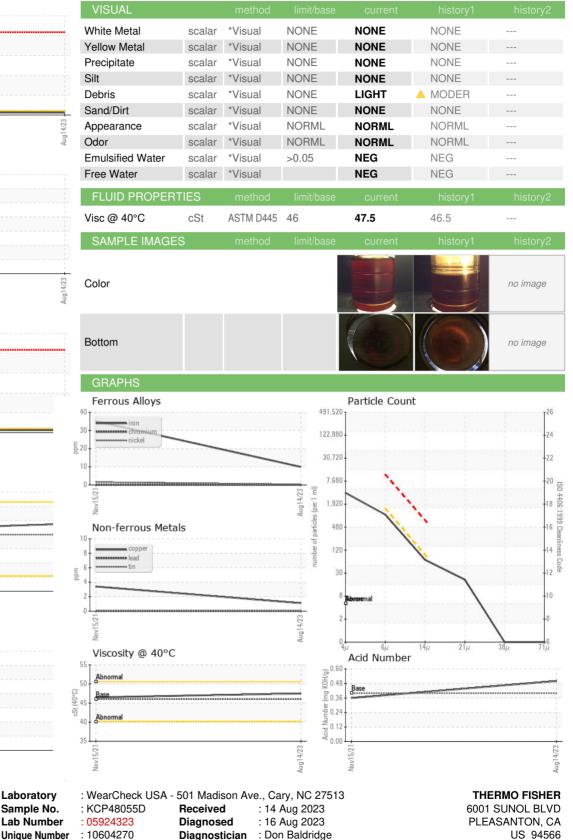

US 94566 Contact: Service Manager

T:

F:

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367