




PROBLEM SUMMARY


Sample Rating Trend

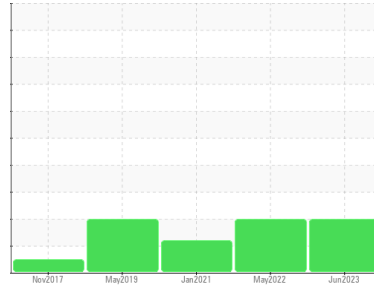

Machine Id
KAESER AS 25T 3687765 (S/N 1530)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

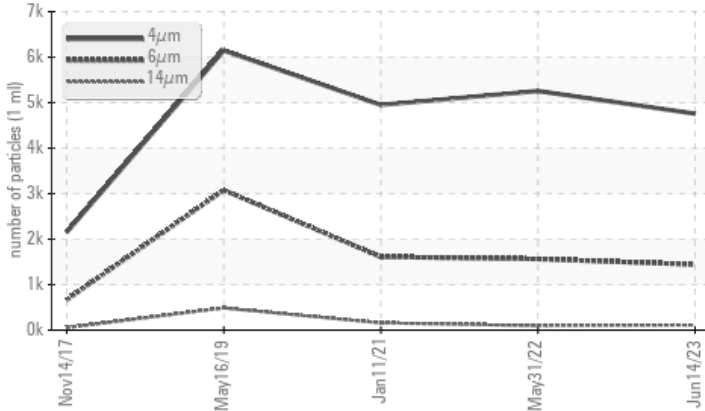

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ATTENTION	ATTENTION
Particles >6µm	ASTM D7647	>1300	▲ 1443	▲ 1564	▲ 1610	
Particles >14µm	ASTM D7647	>80	▲ 111	▲ 98	▲ 158	
Particles >21µm	ASTM D7647	>20	▲ 32	▲ 38	▲ 40	
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/18/14	▲ 20/18/14	▲ 18/14	
Debris	scalar	*Visual	NONE	▲ MODER	NONE	NONE

Customer Id: GALMAY
 Sample No.: KCPA003459
 Lab Number: 05924331
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

31 May 2022 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



11 Jan 2021 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



16 May 2019 Diag: Jonathan Hester

WEAR



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. The lead level is abnormal. All other component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

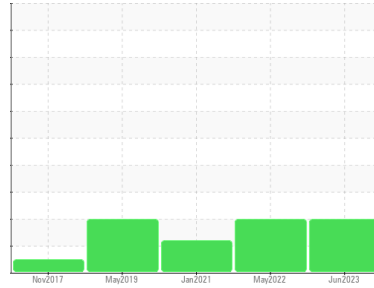

Machine Id
KAESER AS 25T 3687765 (S/N 1530)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA003459	KCP51246	KCP30830
Sample Date	Client Info		14 Jun 2023	31 May 2022	11 Jan 2021
Machine Age	hrs	Client Info	25413	22314	18390
Oil Age	hrs	Client Info	0	3924	4059
Oil Changed	Client Info		N/A	Changed	Changed
Sample Status			ABNORMAL	ATTENTION	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	0	2	3
Copper	ppm	ASTM D5185m >50	3	4	4
Tin	ppm	ASTM D5185m >10	<1	<1	<1
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	12
Barium	ppm	ASTM D5185m 90	<1	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 100	27	35	51
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 0	4	3	<1
Zinc	ppm	ASTM D5185m 0	9	2	6
Sulfur	ppm	ASTM D5185m 23500	25928	18004	19388

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	1	<1	0
Sodium	ppm	ASTM D5185m	7	7	19
Potassium	ppm	ASTM D5185m >20	<1	2	2
Water	%	ASTM D6304 >0.05	0.012	0.015	0.012
ppm Water	ppm	ASTM D6304 >500	129.0	158.0	122.8






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		4758	5256	4949
Particles >6µm	ASTM D7647 >1300		▲ 1443	▲ 1564	▲ 1610
Particles >14µm	ASTM D7647 >80		▲ 111	▲ 98	▲ 158
Particles >21µm	ASTM D7647 >20		▲ 32	▲ 38	▲ 40
Particles >38µm	ASTM D7647 >4		2	▲ 5	2
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 19/18/14	▲ 20/18/14	▲ 18/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.37	0.36	0.388

OIL ANALYSIS REPORT

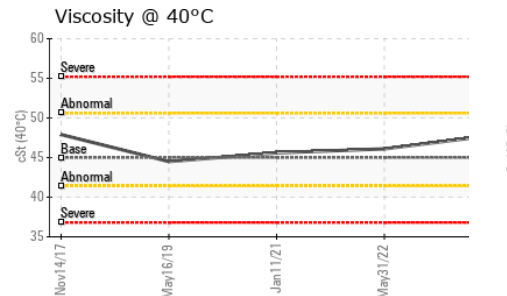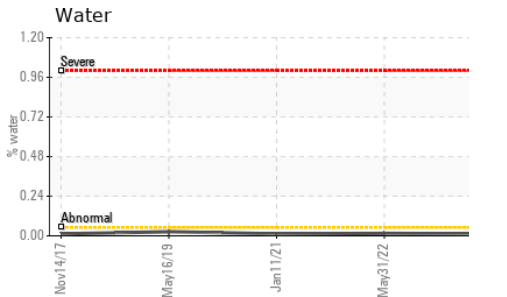
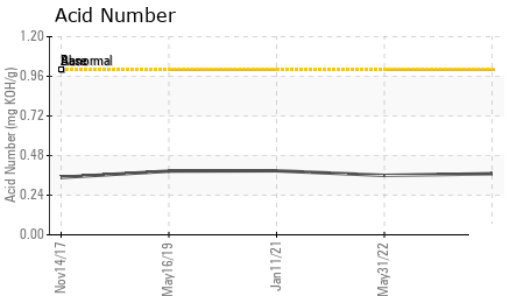
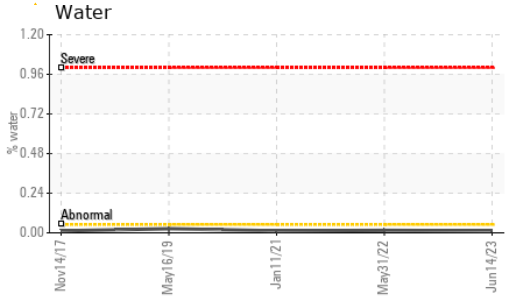
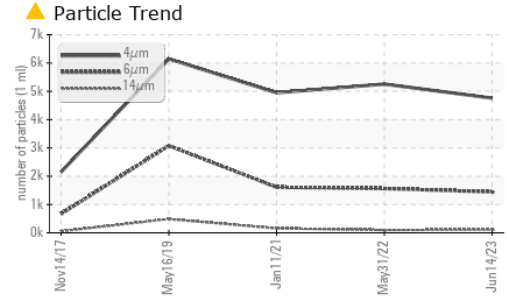


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	47.8	46.1	45.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

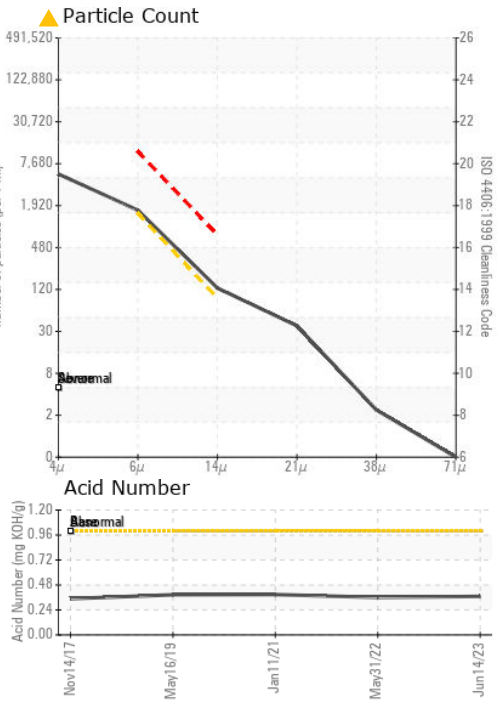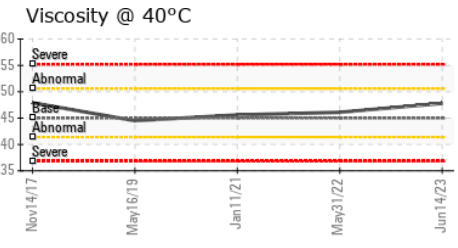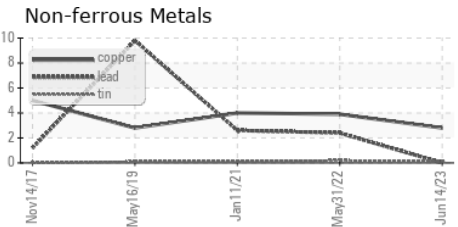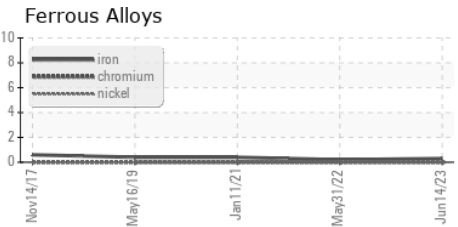

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA003459 **Received** : 14 Aug 2023
Lab Number : 05924331 **Diagnosed** : 16 Aug 2023
Unique Number : 10604278 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

GALLOPING CABINETS LLC
 16155 COUNTY RD 122
 MAYER, MN
 US 55360
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: