


# PROBLEM SUMMARY


Sample Rating Trend

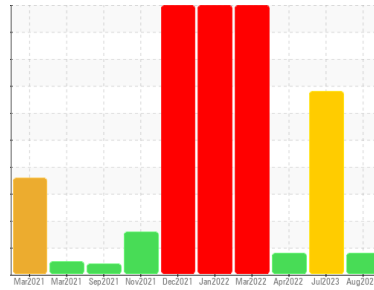

Machine Id  
**MHTF\_1B MHTF\_1B\_M1**  
 Component  
**Non-Drive End Bearing**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Non-ferrous Metals

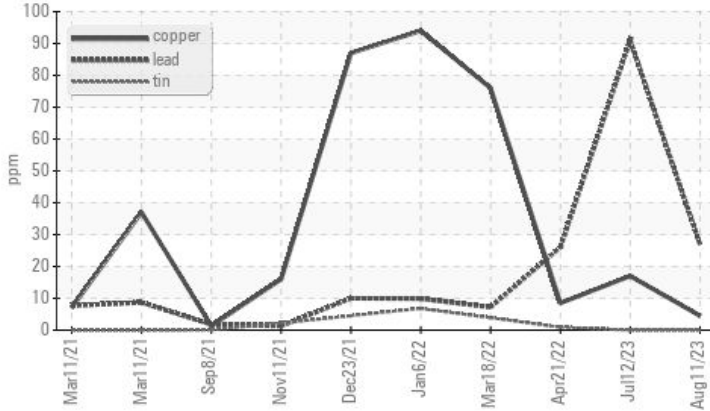

## RECOMMENDATION

No corrective action is recommended at this time.  
 Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	ABNORMAL	SEVERE	ABNORMAL
Lead	ppm ASTM D5185m >20 ▲ 27	91	▲ 26

Customer Id: ENEAST  
 Sample No.: RP0027173  
 Lab Number: 05924412  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Angela Borella +1 800-237-1369  
[angela.borella@wearcheckusa.com](mailto:angela.borella@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 12 Jul 2023 Diag: Jonathan Hester

#### WEAR



We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. Bearing and/or bushing wear is indicated. The water content is negligible. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.

view report



### 21 Apr 2022 Diag: Jonathan Hester

#### WEAR



No corrective action is recommended at this time. Resample at the next service interval to monitor. Bearing wear is indicated. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 18 Mar 2022 Diag: Angela Borella

#### WEAR



We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. The iron level is severe. The copper level is severe. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

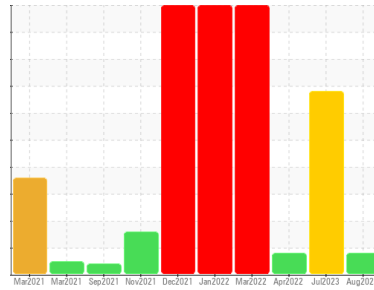

**WEAR**



Machine Id  
**MHTF\_1B MHTF\_1B\_M1**  
 Component  
**Non-Drive End Bearing**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

**DIAGNOSIS**

- Recommendation**  
No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**  
Bearing wear is indicated.
- Contamination**  
There is no indication of any contamination in the oil.
- Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0027173</b>	RP0033010	RP0012603
Sample Date	Client Info		<b>11 Aug 2023</b>	12 Jul 2023	21 Apr 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	SEVERE	ABNORMAL

**WEAR METALS**

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>20	<b>0</b>	<1	2
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m	>20	<b>▲ 27</b>	91	▲ 26
Copper	ppm	ASTM D5185m	>20	<b>4</b>	▲ 17	8
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

**ADDITIVES**

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	2	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>84</b>	50	67
Calcium	ppm	ASTM D5185m		<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>2</b>	2	13
Zinc	ppm	ASTM D5185m		<b>0</b>	6	3

**CONTAMINANTS**

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	<b>2</b>	8	12
Sodium	ppm	ASTM D5185m		<b>2</b>	1	3
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	0
Water	%	ASTM D6304	>2	<b>0.024</b>	0.024	0.028
ppm Water	ppm	ASTM D6304		<b>246.7</b>	246.4	289.6





**FLUID DEGRADATION**

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.46</b>	0.373	0.43

**VISUAL**


	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>2	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	mittel	neg

# OIL ANALYSIS REPORT

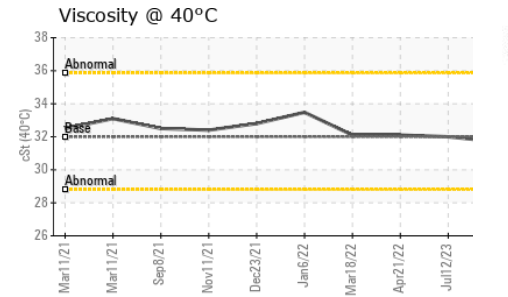
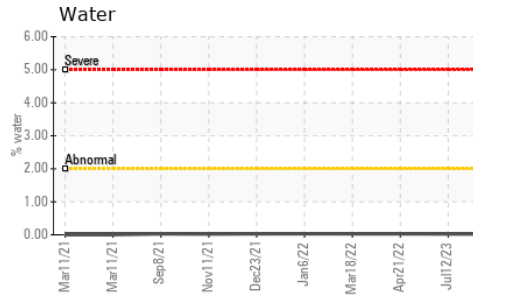
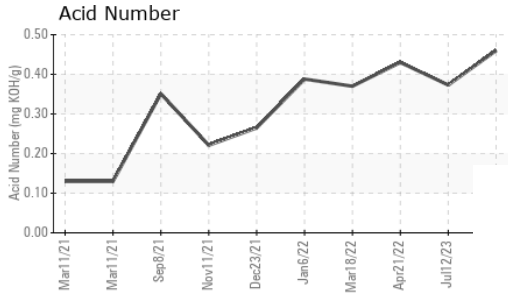
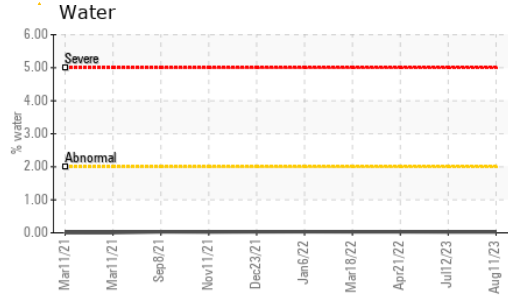


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	<b>31.7</b>	32.0	32.1

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

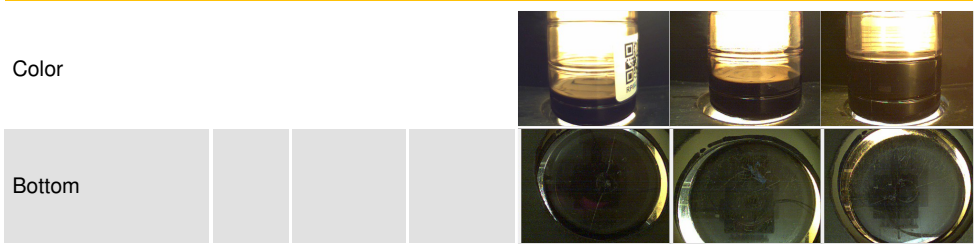

## GRAPHS

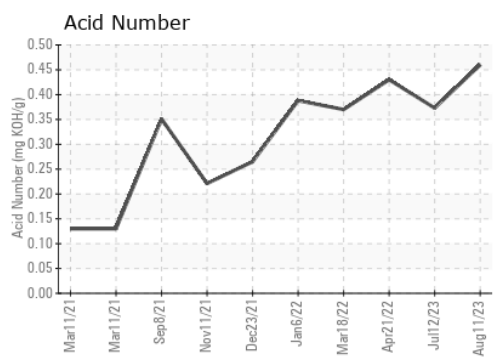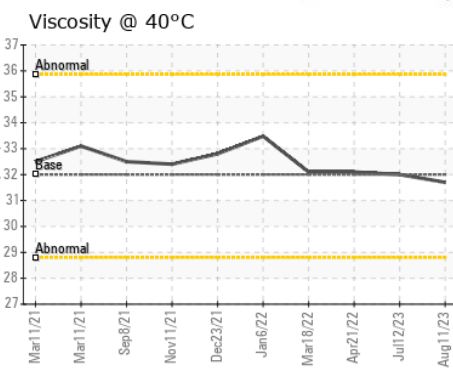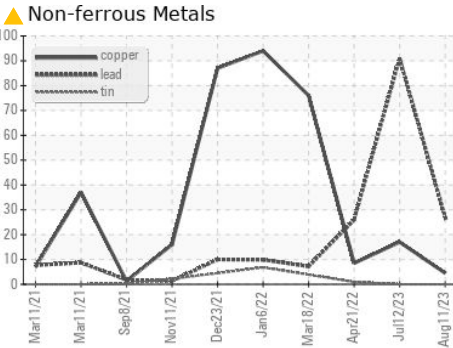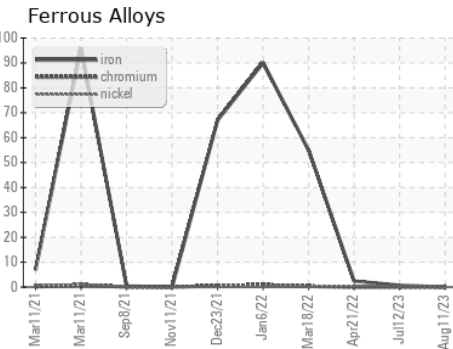

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0027173  
**Lab Number** : 05924412  
**Unique Number** : 10604359  
**Test Package** : IND 2

**ENERGY TRANSFER - MARCUS HOOK TF**  
 7 COMMERCE DRIVE  
 ASTON, PA  
 US 19014  
 Contact: QUITA MORGAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (610)220-8386  
 F: