



PROBLEM SUMMARY

Sample Rating Trend


ISO

Area
EL SAUZ
 Machine Id
K01WEA90054 (S/N HR002708.B-10028)
 Component
Wind Turbine Gearbox
 Fluid
FUCHS RENOLIN UNISYN CKC ISO 320 (500 LTR)



COMPONENT CONDITION SUMMARY

▲ Particle Trend

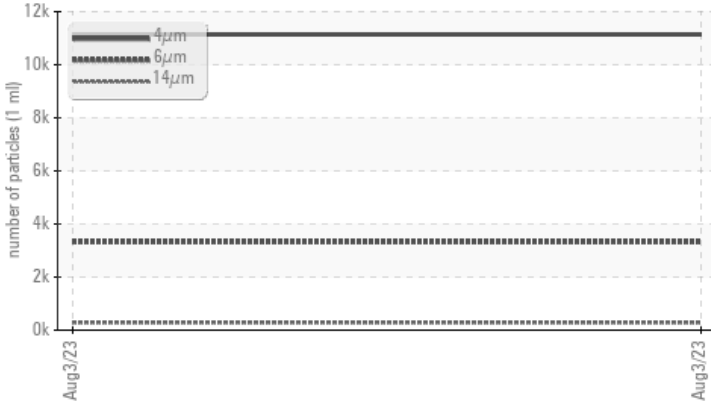

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| Sample Status | | | ABNORMAL | --- | --- |
|-----------------|--------------|-----------|-------------------|-----|-----|
| Particles >6µm | ASTM D7647 | >320 | ▲ 3323 | --- | --- |
| Particles >14µm | ASTM D7647 | >40 | ▲ 281 | --- | --- |
| Particles >21µm | ASTM D7647 | >10 | ▲ 65 | --- | --- |
| Particles >38µm | ASTM D7647 | >3 | ▲ 3 | --- | --- |
| Oil Cleanliness | ISO 4406 (c) | >--/15/12 | ▲ 21/19/15 | --- | --- |

Customer Id: NORDEX
 Sample No.: NX014528
 Lab Number: 05924853
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


| Action | Status | Date | Done By | Description |
|---------------|--------|------|---------|---|
| Change Filter | --- | --- | ? | We recommend you service the filters on this component. |

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

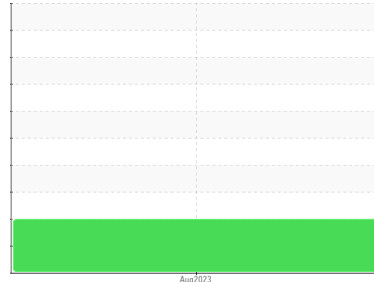

ISO



Area
EL SAUZ
 Machine Id
K01WEA90054 (S/N HR002708.B-10028)
 Component
Wind Turbine Gearbox
 Fluid
FUCHS RENOLIN UNISYN CKC ISO 320 (500 LTR)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-------------|--------------------|----------|----------|
| Sample Number | Client Info | NX014528 | --- | --- |
| Sample Date | Client Info | 03 Aug 2023 | --- | --- |
| Machine Age | hrs | Client Info | 0 | --- |
| Oil Age | hrs | Client Info | 0 | --- |
| Oil Changed | Client Info | N/A | --- | --- |
| Sample Status | | ABNORMAL | --- | --- |

WEAR METALS

| method | limit/base | current | history1 | history2 |
|----------|------------|-------------|-----------|--------------|
| PQ | ASTM D8184 | >50 | 21 | --- |
| Iron | ppm | ASTM D5185m | >30 | 15 |
| Chromium | ppm | ASTM D5185m | >3 | <1 |
| Nickel | ppm | ASTM D5185m | >3 | <1 |
| Titanium | ppm | ASTM D5185m | >10 | 0 |
| Silver | ppm | ASTM D5185m | | 0 |
| Aluminum | ppm | ASTM D5185m | >30 | <1 |
| Lead | ppm | ASTM D5185m | >15 | 5 |
| Copper | ppm | ASTM D5185m | >10 | <1 |
| Tin | ppm | ASTM D5185m | >10 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 |

ADDITIVES

| method | limit/base | current | history1 | history2 |
|------------|------------|-------------|----------|--------------|
| Boron | ppm | ASTM D5185m | 25 | 7 |
| Barium | ppm | ASTM D5185m | | 0 |
| Molybdenum | ppm | ASTM D5185m | | <1 |
| Manganese | ppm | ASTM D5185m | | <1 |
| Magnesium | ppm | ASTM D5185m | | <1 |
| Calcium | ppm | ASTM D5185m | 17 | 35 |
| Phosphorus | ppm | ASTM D5185m | 200 | 309 |
| Zinc | ppm | ASTM D5185m | | 5 |
| Sulfur | ppm | ASTM D5185m | 5000 | 7118 |

CONTAMINANTS

| method | limit/base | current | history1 | history2 |
|-----------|------------|-------------|----------|--------------|
| Silicon | ppm | ASTM D5185m | >+15 | 10 |
| Sodium | ppm | ASTM D5185m | | 3 |
| Potassium | ppm | ASTM D5185m | >20 | <1 |
| Water | % | ASTM D6304 | >0.02 | 0.002 |
| ppm Water | ppm | ASTM D6304 | >200 | 23.8 |

FLUID CLEANLINESS





| method | limit/base | current | history1 | history2 |
|-----------------|--------------|-----------|-------------------|----------|
| Particles >4µm | ASTM D7647 | | 11142 | --- |
| Particles >6µm | ASTM D7647 | >320 | ▲ 3323 | --- |
| Particles >14µm | ASTM D7647 | >40 | ▲ 281 | --- |
| Particles >21µm | ASTM D7647 | >10 | ▲ 65 | --- |
| Particles >38µm | ASTM D7647 | >3 | ▲ 3 | --- |
| Particles >71µm | ASTM D7647 | >3 | 1 | --- |
| Oil Cleanliness | ISO 4406 (c) | >--/15/12 | ▲ 21/19/15 | --- |

FLUID DEGRADATION

| method | limit/base | current | history1 | history2 |
|------------------|------------|------------|----------|-------------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.9 | 0.37 |



OIL ANALYSIS REPORT

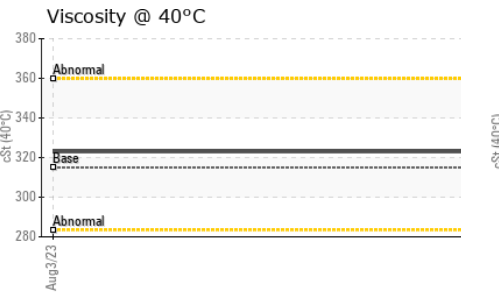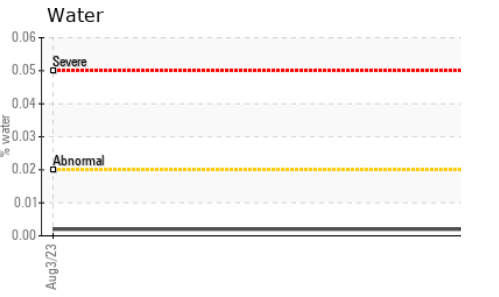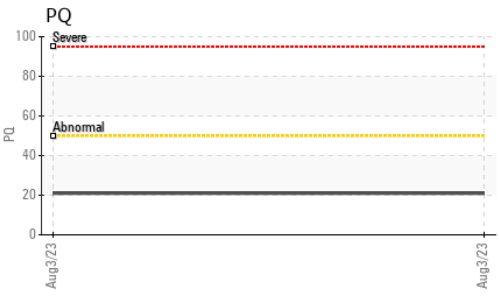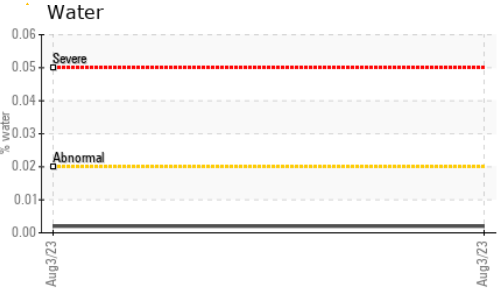




| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | LIGHT | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.02 | NEG | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|---------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 315 | 323 | --- | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | |
|--------|--|----------|----------|
| Color | | no image | no image |
| Bottom | | no image | no image |

GRAPHS

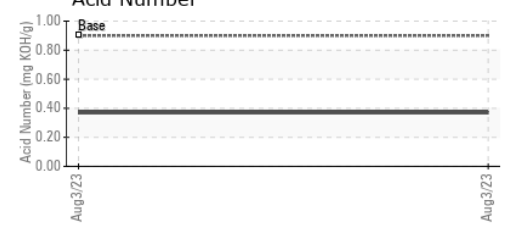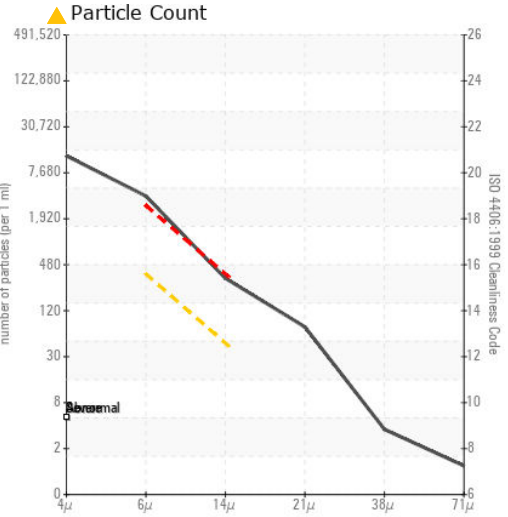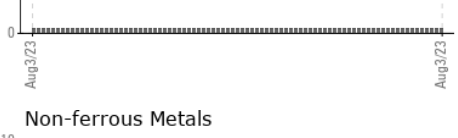

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX014528 **Received** : 15 Aug 2023
Lab Number : 05924853 **Diagnosed** : 16 Aug 2023
Unique Number : 10604800 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com
 T: (312)386-4124
 F: (312)386-7102

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)