


PROBLEM SUMMARY

Sample Rating Trend




WEAR

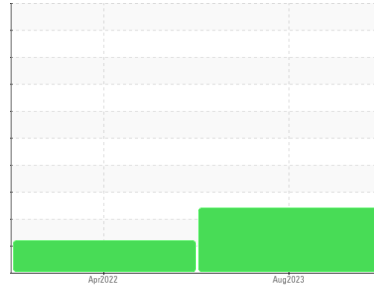


Machine Id
KAESER SK 20 A/C 7221615 (S/N 1556)
Component
Compressor
Fluid
NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Non-ferrous Metals

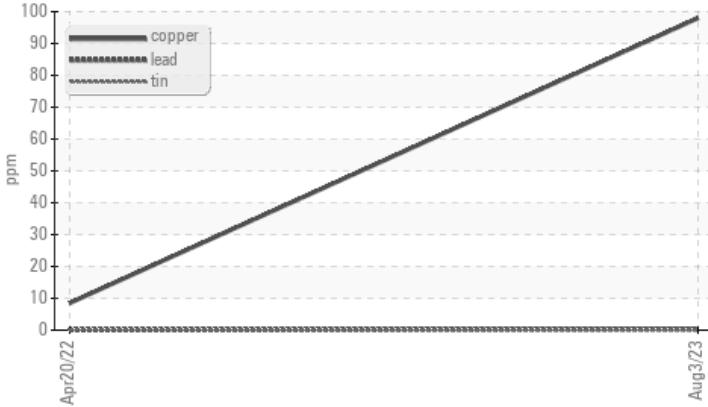

▲ Particle Trend

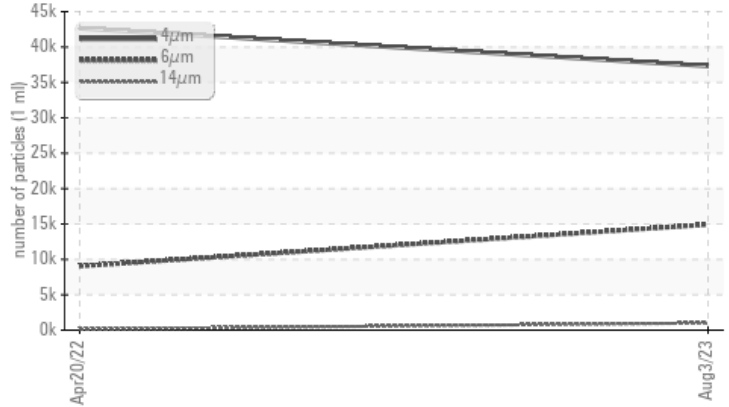

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	---
Copper	ppm	ASTM D5185m	>50	▲ 98	8	---
Particles >6µm		ASTM D7647	>1300	▲ 14906	▲ 9040	---
Particles >14µm		ASTM D7647	>80	▲ 1007	▲ 142	---
Particles >21µm		ASTM D7647	>20	▲ 164	11	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 22/21/17	▲ 23/20/14	---

Customer Id: ARMCHE
Sample No.: KC108900
Lab Number: 05924860
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

20 Apr 2022 Diag: Don Baldrige

ISO




Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

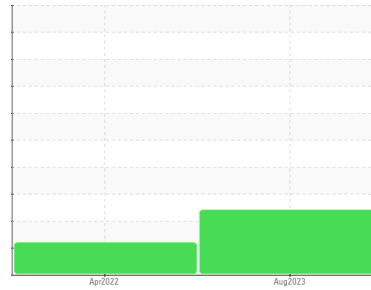

WEAR



Machine Id
KAESER SK 20 A/C 7221615 (S/N 1556)

Component
Compressor
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

▲ **Recommendation**

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

▲ **Wear**

The copper level is abnormal. All other component wear rates are normal.

▲ **Contamination**

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC108900	KC85675	---
Sample Date	Client Info		03 Aug 2023	20 Apr 2022	---
Machine Age	hrs	Client Info	5019	1244	---
Oil Age	hrs	Client Info	3600	1244	---
Oil Changed	Client Info		Changed	Changed	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	1	6	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	<1	---
Aluminum	ppm	ASTM D5185m >10	<1	<1	---
Lead	ppm	ASTM D5185m >10	<1	0	---
Copper	ppm	ASTM D5185m >50	▲ 98	8	---
Tin	ppm	ASTM D5185m >10	0	<1	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	1	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	<1	<1	---
Magnesium	ppm	ASTM D5185m	30	55	---
Calcium	ppm	ASTM D5185m	0	2	---
Phosphorus	ppm	ASTM D5185m	2	3	---
Zinc	ppm	ASTM D5185m	77	13	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	1	<1	---
Sodium	ppm	ASTM D5185m	7	12	---
Potassium	ppm	ASTM D5185m >20	7	16	---
Water	%	ASTM D6304 >0.05	0.023	0.023	---
ppm Water	ppm	ASTM D6304 >500	235.5	236.8	---





FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		37329	42655	---
Particles >6µm	ASTM D7647	>1300	▲ 14906	▲ 9040	---
Particles >14µm	ASTM D7647	>80	▲ 1007	▲ 142	---
Particles >21µm	ASTM D7647	>20	▲ 164	11	---
Particles >38µm	ASTM D7647	>4	2	0	---
Particles >71µm	ASTM D7647	>3	0	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/21/17	▲ 23/20/14	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.37	0.35	---


OIL ANALYSIS REPORT

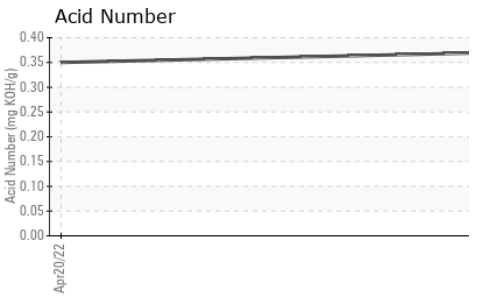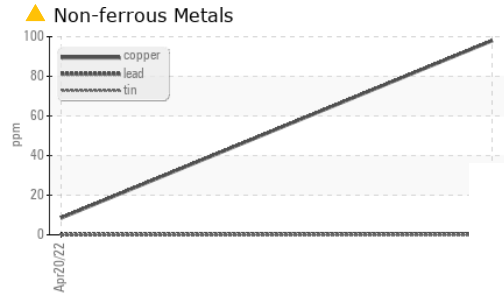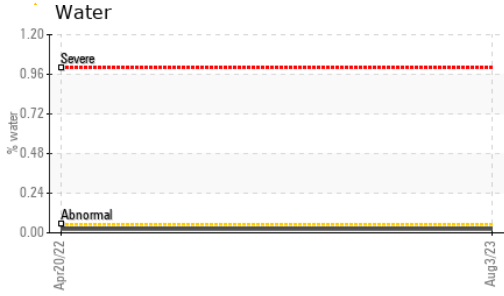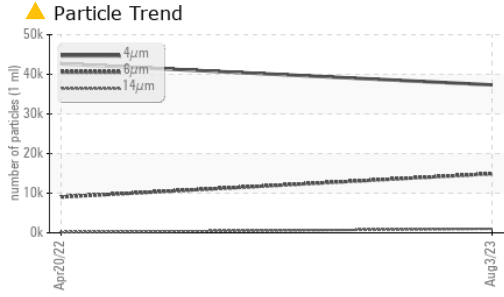






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.0	47.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

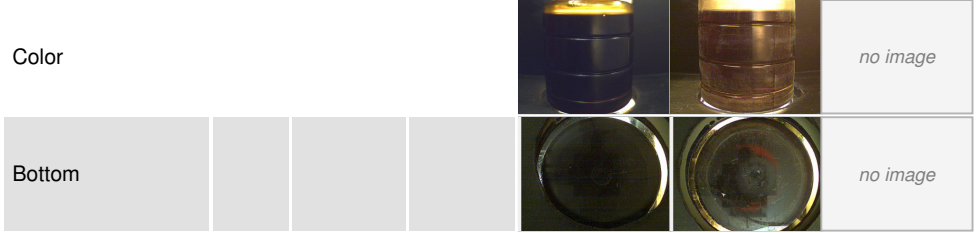

GRAPHS

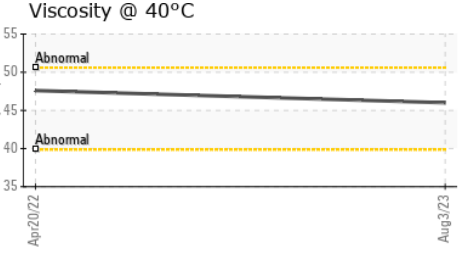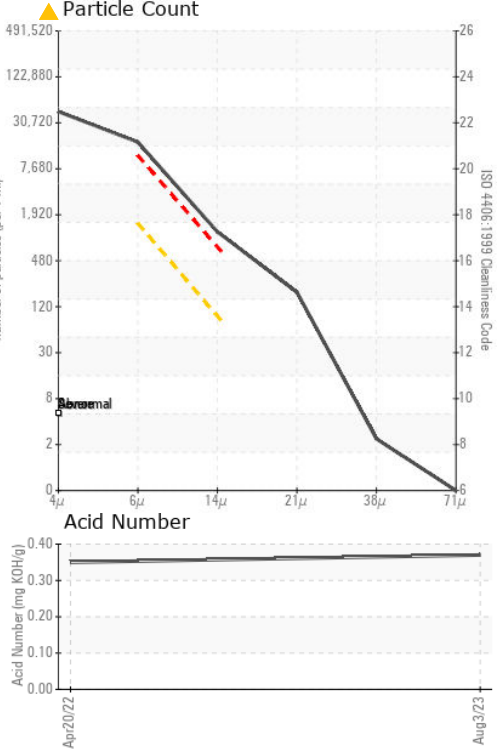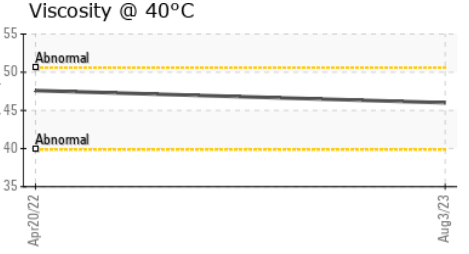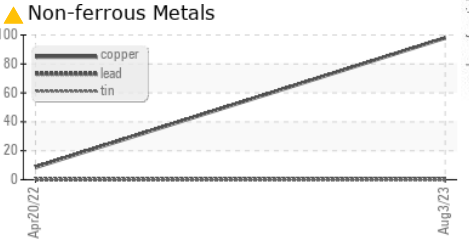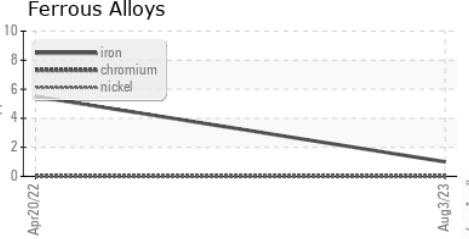

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC108900 **Received** : 15 Aug 2023
Lab Number : 05924860 **Diagnosed** : 16 Aug 2023
Unique Number : 10604807 **Diagnostician** : Jonathan Hester
Test Package : IND 2

ARMINA STONE
 780 RTE 910, SUITE 100
 CHESWICK, PA
 US 15204
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: