

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Area NOT GIVEN Machine Id INGERSOLL RAND MOX1001403 Component

Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05924920		
Sample Date		Client Info		27 Jul 2023		
Machine Age	hrs	Client Info		164		
Oil Age	hrs	Client Info		16		
Dil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
_ead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m		<1		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m	210	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	le le	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	0		mistoryz
Barium		ASTM D5185m	525	392		
	ppm			0		
Molybdenum	ppm	ASTM D5185m	10	-		
Manganese	ppm	ASTM D5185m	5	<1		
Magnesium	ppm	ASTM D5185m	5	2		
Calcium	ppm	ASTM D5185m	10	1		
Phosphorus	ppm	ASTM D5185m	250	108		
Zinc	ppm	ASTM D5185m		23		
Sulfur	ppm	ASTM D5185m	400	467		
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		8		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRAD	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.25		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.8	NEG		
				NEG		
Emulsified Water Free Water I:56:38) Rev: 1	scalar scalar	*Visual *Visual	>0.8	NEG		Z -

Contact/Location: JIM SUAREZ - UCADVTOM



OIL ANALYSIS REPORT

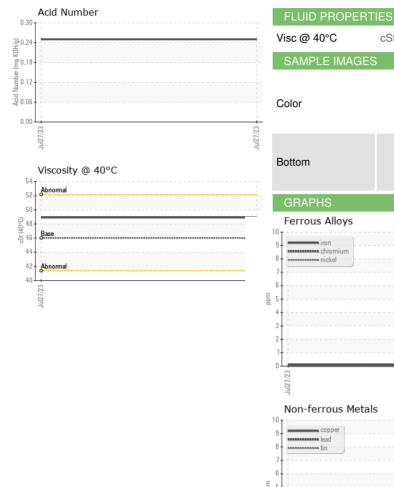

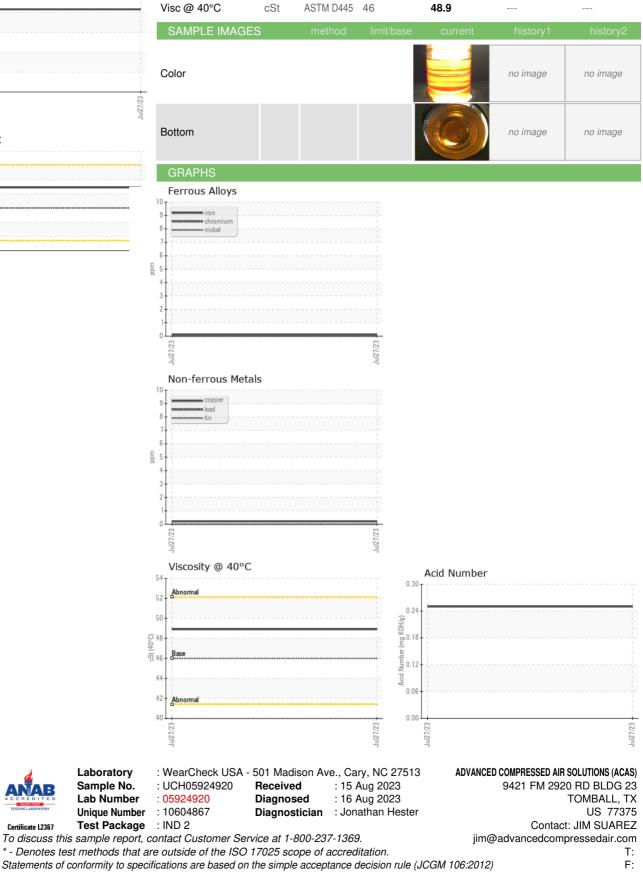

Contact/Location: JIM SUAREZ - UCADVTOM