OIL ANALYSIS REPORT

Sample Rating Trend

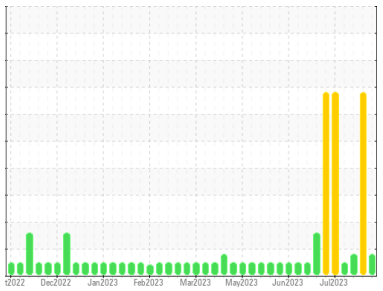

WEAR

Machine Id
CATERPILLAR GM02
Component
Biogas Engine
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
The iron level is abnormal. All other component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0836322**	WC0836320	WC0836354
Sample Date		Client Info		**14 Aug 2023**	13 Aug 2023	09 Aug 2023
Machine Age	hrs	Client Info		**64565**	64500	64452
Oil Age	hrs	Client Info		**61**	85	37
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	SEVERE	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel		WC Method	>4.0	**<1.0**	<1.0	<1.0
Glycol		WC Method		**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>45	▲ **75**	⬢ 121	▲ 64
Chromium	ppm	ASTM D5185m	>2	**<1**	▲ 2	<1
Nickel	ppm	ASTM D5185m	>2	**0**	0	<1
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m	>5	**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	**1**	2	2
Lead	ppm	ASTM D5185m	>5	**0**	0	2
Copper	ppm	ASTM D5185m	>14	**0**	<1	4
Tin	ppm	ASTM D5185m	>13	**0**	<1	<1
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	0
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**0**	0	2
Manganese	ppm	ASTM D5185m		**<1**	1	2
Magnesium	ppm	ASTM D5185m		**1**	4	4
Calcium	ppm	ASTM D5185m		**1470**	1466	1305
Phosphorus	ppm	ASTM D5185m		**395**	406	362
Zinc	ppm	ASTM D5185m		**430**	454	397
Sulfur	ppm	ASTM D5185m		**2320**	2444	2339

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>200	**43**	57	27
Sodium	ppm	ASTM D5185m		**0**	1	5
Potassium	ppm	ASTM D5185m	>20	**0**	<1	4

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0**	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	**4.9**	5.0	4.7
Sulfation	Abs/.1mm	*ASTM D7415	>30	**15.5**	15.2	15.3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	**9.5**	9.5	9.2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.50**	0.29	0.55
Base Number (BN)	mg KOH/g	ASTM D2896		**6.36**	7.31	6.86

OIL ANALYSIS REPORT

Ferrous Alloys

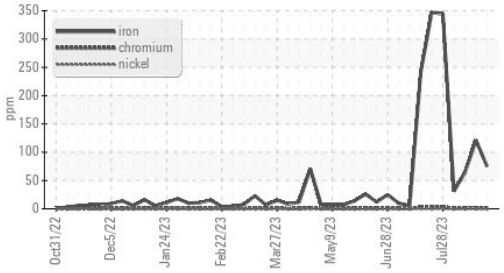

Acid Number

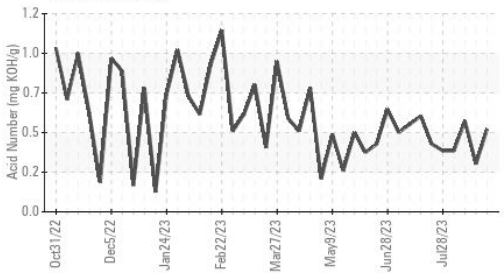

Base Number

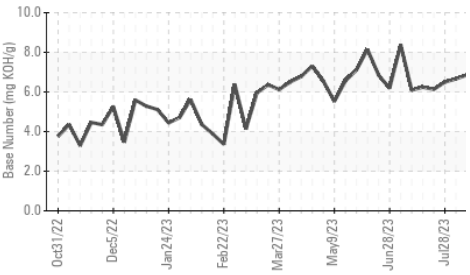

Viscosity @ 100°C

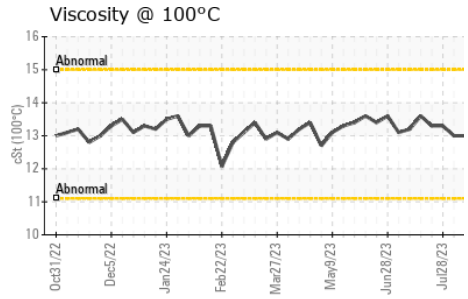

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445		**13.1**	13.1	13.0

GRAPHS

Iron (ppm)

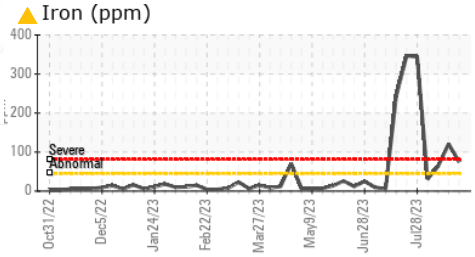

Lead (ppm)

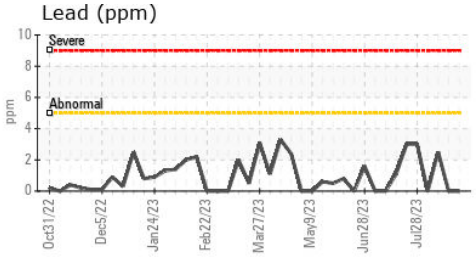

Aluminum (ppm)

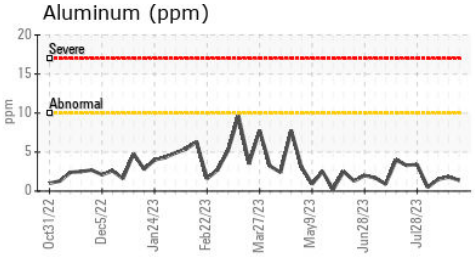

Chromium (ppm)

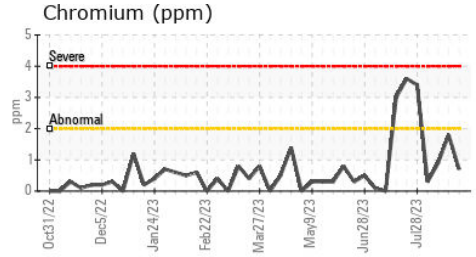

Copper (ppm)

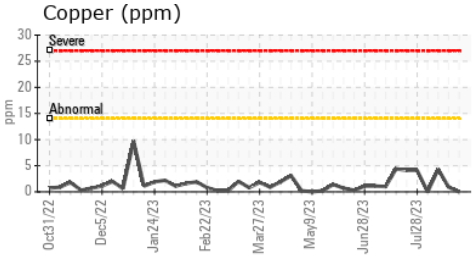

Silicon (ppm)

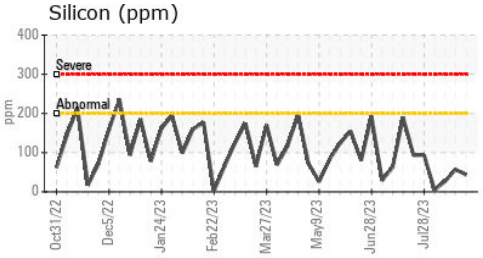

Viscosity @ 100°C

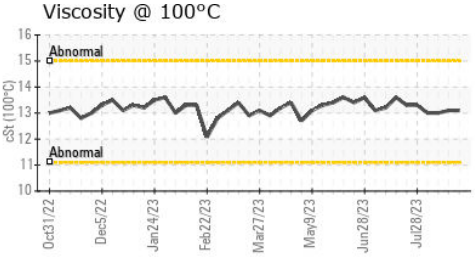

Base Number

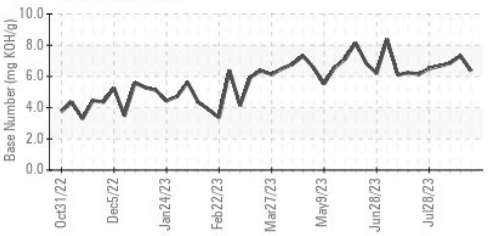

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0836322
Lab Number : 05924997
Unique Number : 10604944
Test Package : MOB 2

Received : 15 Aug 2023
Diagnosed : 16 Aug 2023
Diagnostician : Angela Borella

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

OAK GROVE KS
1150 E 700TH AVE
ARCADIA, KS
US 66711
Contact: KALEB WEAVER
kaleb.weaver@cubedistrictenergy.com
T:
F: