




OIL ANALYSIS REPORT

Sample Rating Trend

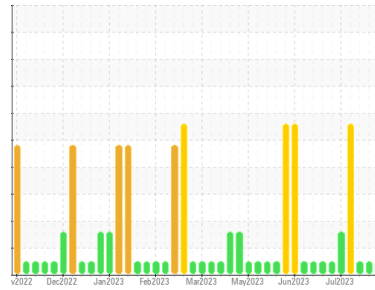

NORMAL



Machine Id
SJNM01BE
Component
Biogas Engine
Fluid
CHEVRON HDAX 6500 LFG GAS ENGINE OIL (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0764409	WC0764410	WC0764423
Sample Date	Client Info		11 Aug 2023	04 Aug 2023	28 Jul 2023
Machine Age	hrs	Client Info	65973	65805	65637
Oil Age	hrs	Client Info	504	491	168
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>15	1	0	0
Chromium	ppm	ASTM D5185m	>4	0	0	0
Nickel	ppm	ASTM D5185m	>2	0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>5	0	<1	0
Aluminum	ppm	ASTM D5185m	>6	<1	2	<1
Lead	ppm	ASTM D5185m	>9	5	4	<1
Copper	ppm	ASTM D5185m	>6	1	2	1
Tin	ppm	ASTM D5185m	>4	2	2	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		6	8	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		9	10	19
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		22	23	50
Calcium	ppm	ASTM D5185m		2028	2110	1955
Phosphorus	ppm	ASTM D5185m		319	314	301
Zinc	ppm	ASTM D5185m		381	398	366
Sulfur	ppm	ASTM D5185m		2593	2680	2380

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>181	135	120	66
Sodium	ppm	ASTM D5185m		<1	0	3
Potassium	ppm	ASTM D5185m	>20	2	3	3

INFRA-RED




	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	7.3	6.8	6.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.4	19.2	17.0

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	14.7	13.0	10.6
Acid Number (AN)	mg KOH/g	ASTM D8045	1.2	1.24	1.03	0.65
Base Number (BN)	mg KOH/g	ASTM D2896	4.5	5.37	4.41	4.60











OIL ANALYSIS REPORT

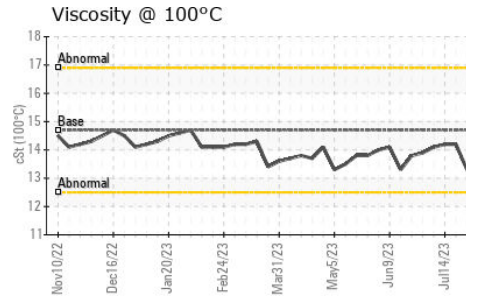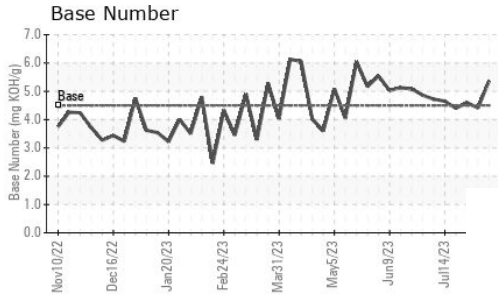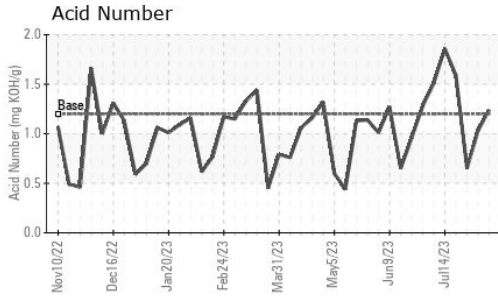

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.7	13.7	13.6

GRAPHS

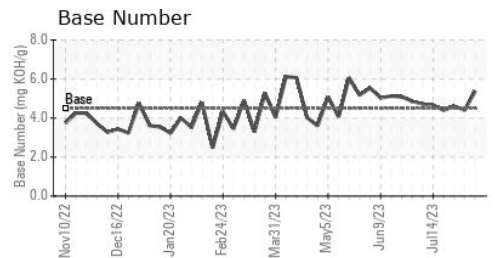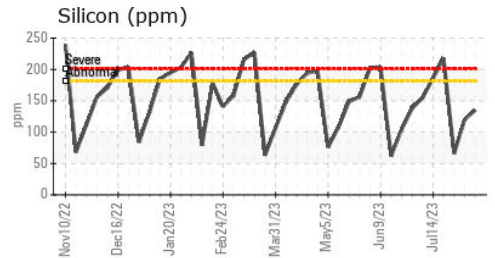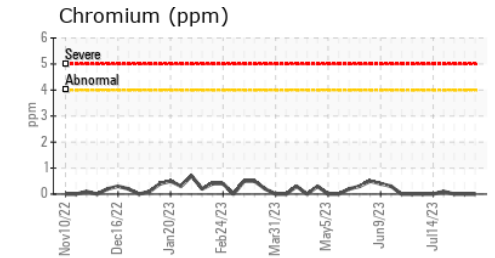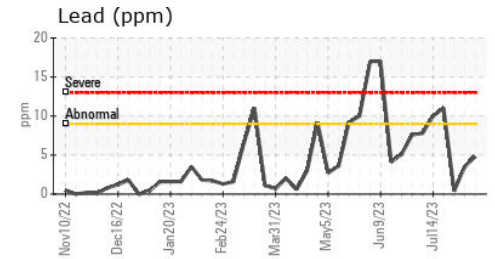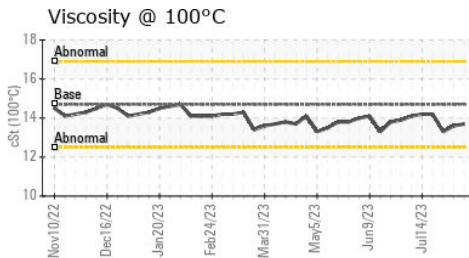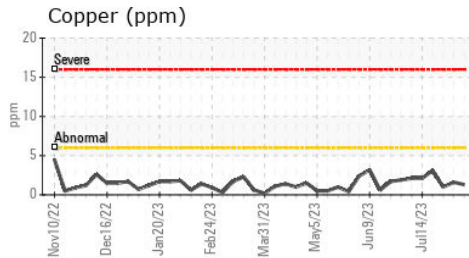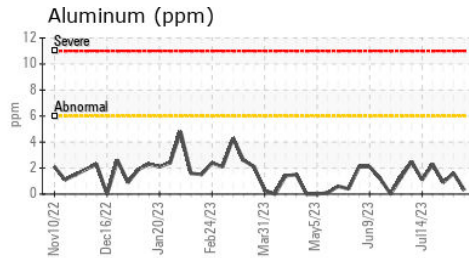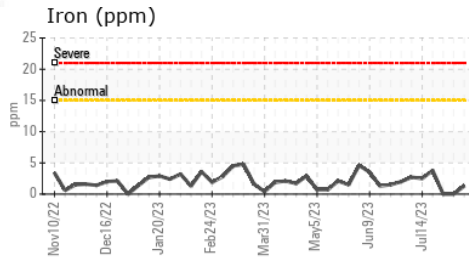

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0764409 Received : 15 Aug 2023
 Lab Number : 05925003 Diagnosed : 16 Aug 2023
 Unique Number : 10604950 Diagnostician : Angela Borella
 Test Package : MOB 2

EDL NA Recips-South Jordan
 South Jordan Powerstation, 10473 S. Bacchus Hwy.
 South Jordan, UT
 US 84095
 Contact: Aaron Klein
 aaron.klein@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: