



FUEL REPORT


Sample Rating Trend

NORMAL



Machine Id
SIESTA KEY MASTER GEN - SARASOTA COUNTY

Component
Tank Diesel Fuel
Fluid
NOT GIVEN (1925 GAL)

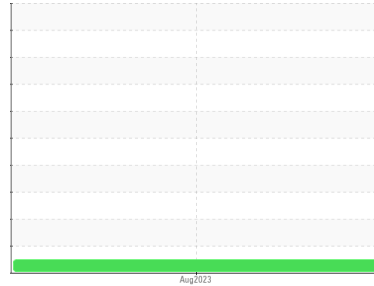

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number | Client Info | | | WCDF4462 | --- | --- |
| Sample Date | Client Info | | | 08 Aug 2023 | --- | --- |
| Machine Age | mls | Client Info | | 0 | --- | --- |
| Sample Status | | | | NORMAL | --- | --- |



| PHYSICAL PROPERTIES | | method | limit/base | current | history1 | history2 |
|---------------------|--------|-------------|------------|-------------|----------|----------|
| ASTM Color | scalar | *ASTM D1500 | | L4.0 | --- | --- |
| Visc @ 40°C | cSt | ASTM D445 | | 2.4 | --- | --- |

| SULFUR CONTENT | | method | limit/base | current | history1 | history2 |
|----------------|-----|-------------|------------|-----------|----------|----------|
| Sulfur | ppm | ASTM D5185m | | 0 | --- | --- |
| Sulfur (UVF) | ppm | ASTM D5453 | | 10 | --- | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | <1.0 | 0 | --- | --- |
| Sodium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Potassium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Water | % | ASTM D6304 | <0.05 | 0.003 | --- | --- |
| ppm Water | ppm | ASTM D6304 | <500 | 34.4 | --- | --- |
| % Gasoline | % | *In-House | <0.50 | 0.0 | --- | --- |
| % Biodiesel | % | *In-House | <20.0 | 0.0 | --- | --- |

| HEAVY METALS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Aluminum | ppm | ASTM D5185m | <0.1 | <1 | --- | --- |
| Nickel | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Iron | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Calcium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Magnesium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | <0.1 | <1 | --- | --- |
| Zinc | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |




SAMPLE IMAGES

| method | limit/base | current | history1 | history2 |
|--------|------------|---|----------|----------|
| Color | |  | no image | no image |
| Bottom | |  | no image | no image |



FUEL REPORT

GRAPHS

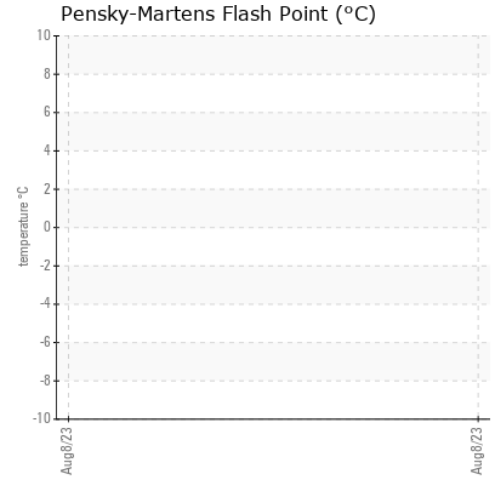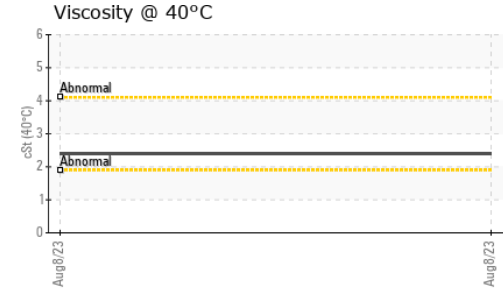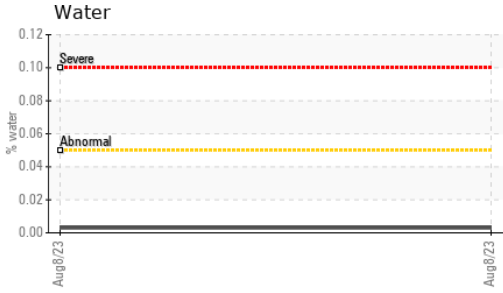

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WCDF4462 **Received** : 15 Aug 2023
Lab Number : 05925207 **Diagnosed** : 21 Aug 2023
Unique Number : 10605154 **Diagnostician** : Doug Bogart
Test Package : DF-5 (Additional Tests: Screen, Sulphur-Active)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

TANK WIZARDS
 1511 MASTERS RD NW
 PALM BAY, FL
 US 32907
 Contact: WENDALL STRODERD
 wendall@tankwizards.com
 T: (321)427-5149
 F: (321)574-4131