

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id 7097182 (S/N 1445) Component

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Ju	12020	Jul2021 Jul2	023	
SAMPLE INFORM	ΛΑΤΙΟΝ	method	limit/base	current	history1	history2
Sample Number		Client Info		KC111303	KC98316	KC86849
Sample Date		Client Info		28 Jul 2023	02 Jul 2021	07 Jul 2020
Machine Age	hrs	Client Info		11912	4198	1344
Oil Age	hrs	Client Info		0	2854	1344
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	1	3
Chromium	ppm	ASTM D5185m	>10	0	0	<1
Nickel	ppm	ASTM D5185m	>3	0	<1	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m		12	8	4
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m	>10		0	3
Vanadium		ASTM D5185m		0	0	0
	ppm					0
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	1	0
Barium	ppm	ASTM D5185m	90	0	1	<1
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		1	1	<1
Magnesium	ppm	ASTM D5185m	90	42	63	76
Calcium	ppm	ASTM D5185m	2	0	0	6
Phosphorus	ppm	ASTM D5185m		3	2	2
Zinc	ppm	ASTM D5185m		0	0	9
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m		8	13	17
Potassium	ppm	ASTM D5185m	>20	2	2	5
Water	%	ASTM D6304	>0.05	0.018	0.021	0.034
ppm Water	ppm	ASTM D6304	>500	180.5	212.4	344.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1248	730	5218
Particles >6µm		ASTM D7647	>1300	237	161	1 997
Particles >14µm		ASTM D7647	>80	15	13	▲ 324
Particles >21µm		ASTM D7647	>20	3	2	1 31
Particles >38μm		ASTM D7647	>4	0	0	 7
Particles >71µm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/11	15/11	▲ 18/16
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.34	0.340	0.330
(-)	0 - 0					



OIL ANALYSIS REPORT





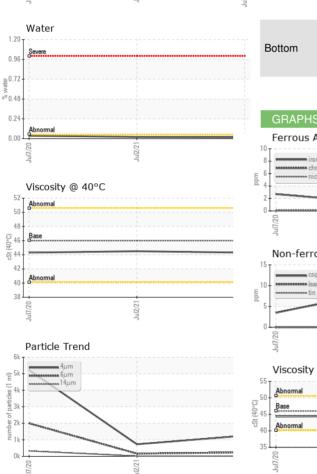



GRAPHS Ferrous Alloys Particle Count 491 52 122,880 nicke 30,720 7,680 20 8 Jul28/23 1406 (per 1 1,920 6661 Non-ferrous Metals 480 120 lead 30 Jul28/23 Viscosity @ 40°C Acid Number (B) 0.50 HOX 0.40 Base Ē0.30 ළි 0.20 2 0.10 0.00 P ul28/23 lul2/21 : WearCheck USA - 501 Madison Ave., Cary, NC 27513 **QMI INC** 4258 ZARROW ST : KC111303 Received : 15 Aug 2023 Lab Number PRYOR, OK : 05925448 Diagnosed : 17 Aug 2023 : Jonathan Hester US 74361 Unique Number : 10605395 Diagnostician Test Package : IND 2 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

E

Laboratory

Sample No.

Contact/Location: Service Manager - QMIPRY

T:

F:

^{* -} Denotes test methods that are outside of the ISO 17025 scope of accreditation.