




PROBLEM SUMMARY


Sample Rating Trend

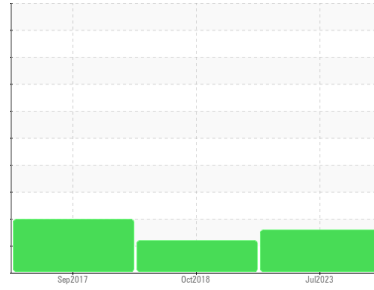

Machine Id
KAESER ASD 40S T 4788938 (S/N 1107)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

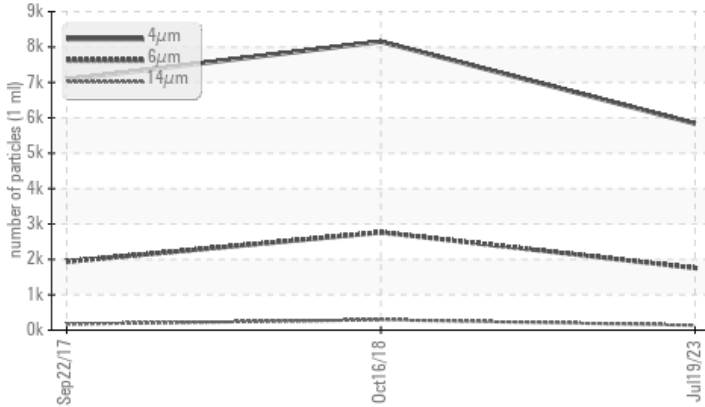

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ATTENTION	ABNORMAL	ABNORMAL
Particles >6µm	>1300	▲ 1754	▲ 2763	▲ 1933
Particles >14µm	>80	▲ 136	▲ 293	▲ 171
Particles >21µm	>20	▲ 32	▲ 58	▲ 51
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/18/14	▲ 19/15	▲ 18/15

Customer Id: SRCTULOK
 Sample No.: KCPA004810
 Lab Number: 05925454
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

16 Oct 2018 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



22 Sep 2017 Diag: Don Baldrige

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

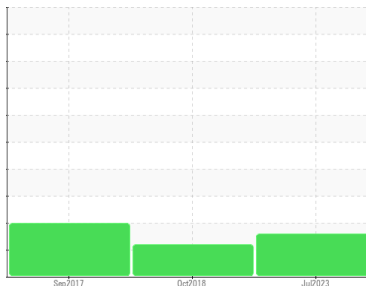

Machine Id
KAESER ASD 40S T 4788938 (S/N 1107)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ **Recommendation**

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ **Contamination**

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA004810	KCP12336	KCP03913
Sample Date	Client Info		19 Jul 2023	16 Oct 2018	22 Sep 2017
Machine Age	hrs	Client Info	23038	13976	7044
Oil Age	hrs	Client Info	0	6932	4246
Oil Changed	Client Info		N/A	Changed	Changed
Sample Status			ATTENTION	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	1	<1	1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	10	14	8
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	0	4
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	2
Magnesium	ppm	ASTM D5185m 90	20	9	21
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	<1	1	<1
Zinc	ppm	ASTM D5185m	113	115	148
Sulfur	ppm	ASTM D5185m	23810	23957	9300

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	5	2	12
Potassium	ppm	ASTM D5185m >20	2	1	7
Water	%	ASTM D6304 >0.05	0.016	0.005	0.013
ppm Water	ppm	ASTM D6304 >500	168.4	50	130






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5836	8153	7080
Particles >6µm	ASTM D7647 >1300		▲ 1754	▲ 2763	▲ 1933
Particles >14µm	ASTM D7647 >80		▲ 136	▲ 293	▲ 171
Particles >21µm	ASTM D7647 >20		▲ 32	▲ 58	▲ 51
Particles >38µm	ASTM D7647 >4		1	0	▲ 9
Particles >71µm	ASTM D7647 >3		0	0	▲ 3
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 20/18/14	▲ 19/15	▲ 18/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.38	0.422	0.331


OIL ANALYSIS REPORT

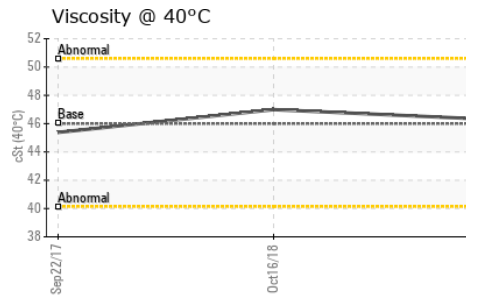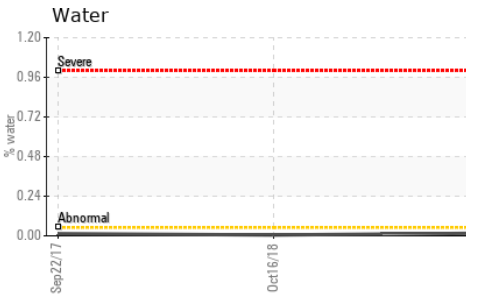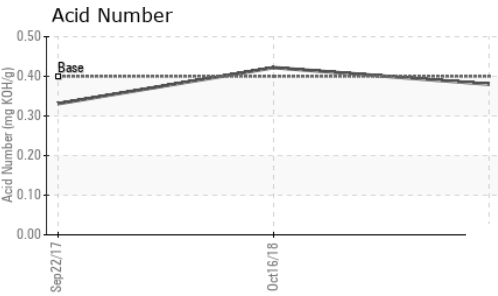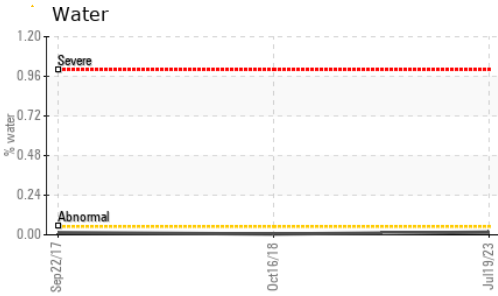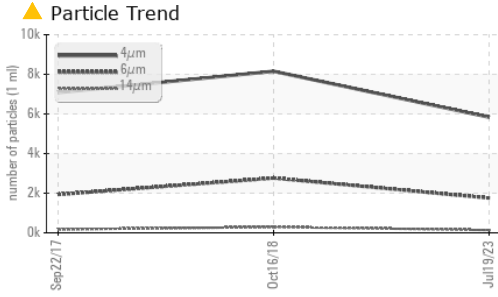






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	VLITE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.3	46.99	45.38

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

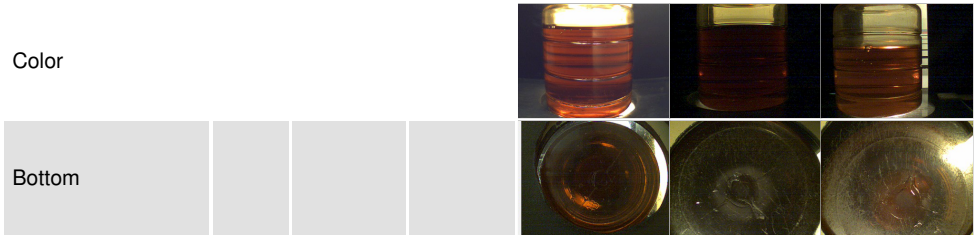

GRAPHS

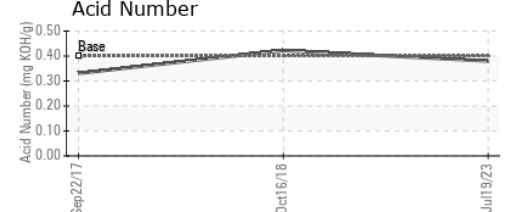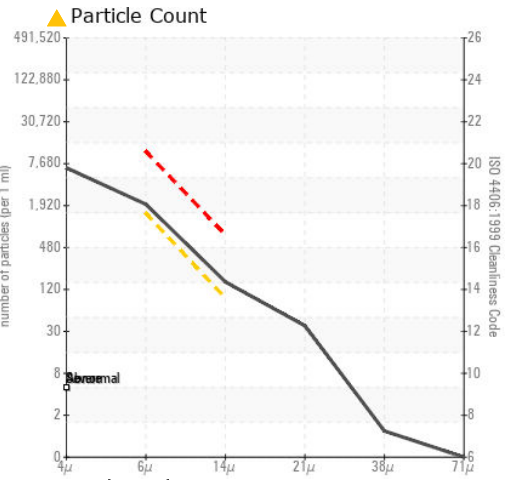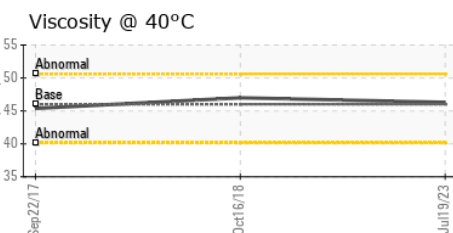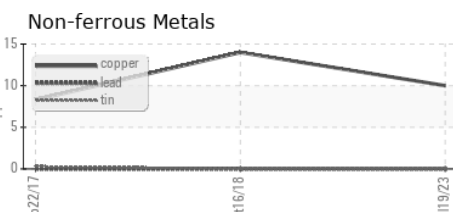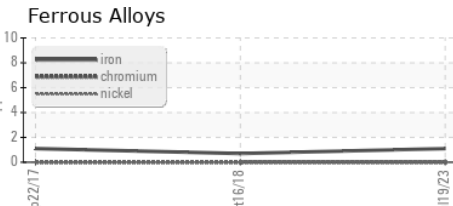

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA004810 **Received** : 15 Aug 2023
Lab Number : 05925454 **Diagnosed** : 17 Aug 2023
Unique Number : 10605401 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

S&R COMPRESSION
 4234 S JACKSON AVE
 TULSA, OK
 US 74107
 Contact: K. GUILLORY
 kguillory@sandrcompression.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)