




PROBLEM SUMMARY

Sample Rating Trend

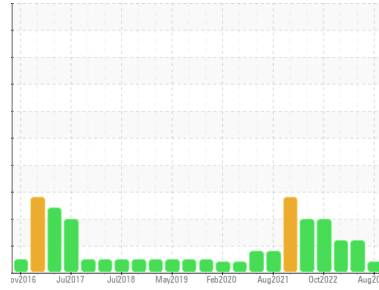

VIS DEBRIS



Machine Id
FRICK TYSAMAFRE 1 FRICK (S/N S006QFMCTHAC03)
 Component
Refrigeration Compressor
 Fluid
USPI 1009-68 SC (--- GAL)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT	LIGHT

Customer Id: TYSAMA
Sample No.: USP0000628
Lab Number: 05925480
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

15 May 2023 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



26 Jan 2023 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



02 Oct 2022 Diag: Doug Bogart

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

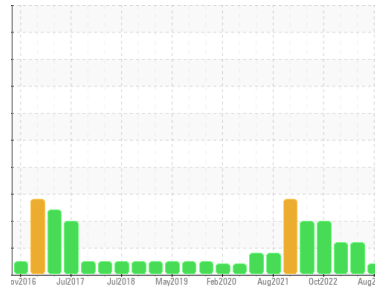

VIS DEBRIS



Machine Id
FRICK TYSAMAFRE 1 FRICK (S/N S006QFMCTHAC03)

Component
Refrigeration Compressor
Fluid
USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USP0000628	USP248056	USP245101
Sample Date	Client Info		15 Aug 2023	15 May 2023	26 Jan 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<1	2	<1
Chromium	ppm	ASTM D5185m >2	0	0	0
Nickel	ppm	ASTM D5185m	<1	1	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >3	<1	<1	0
Lead	ppm	ASTM D5185m >2	0	0	0
Copper	ppm	ASTM D5185m >8	0	0	<1
Tin	ppm	ASTM D5185m >4	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m	0	1	0
Calcium	ppm	ASTM D5185m	0	0	<1
Phosphorus	ppm	ASTM D5185m	0	0	0
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m 50	0	5	37

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<1	<1	0
Sodium	ppm	ASTM D5185m	0	<1	0
Potassium	ppm	ASTM D5185m >20	<1	1	<1
Water	%	ASTM D6304 >0.01	0.005	0.003	0.002
ppm Water	ppm	ASTM D6304 >100	58.3	27.7	18.9

FLUID CLEANLINESS




	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	---	▲ 28746	▲ 17894
Particles >6µm	ASTM D7647	>2500	---	▲ 6672	▲ 5468
Particles >14µm	ASTM D7647	>320	---	176	267
Particles >21µm	ASTM D7647	>80	---	21	35
Particles >38µm	ASTM D7647	>20	---	0	1
Particles >71µm	ASTM D7647	>4	---	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	---	▲ 22/20/15	▲ 21/20/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	0.015	0.015	0.014



OIL ANALYSIS REPORT

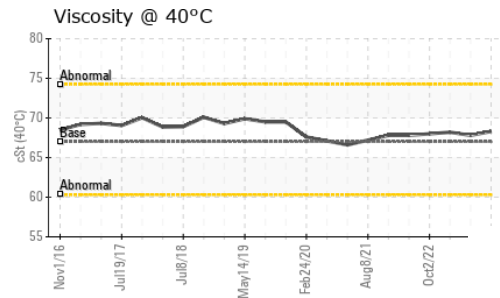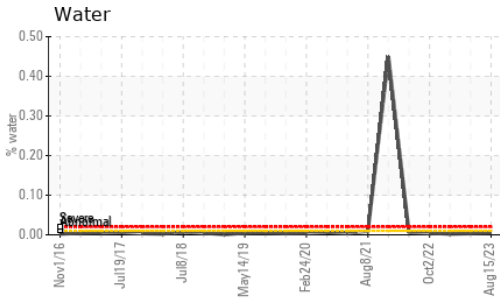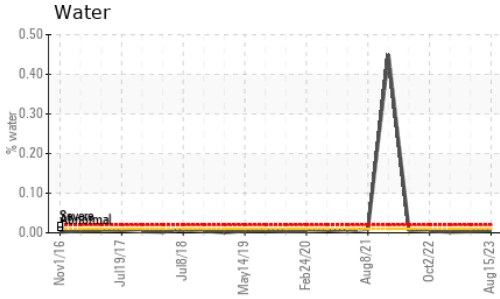


PARAMETER	VISUAL	method	limit/base	current	history1	history2
White Metal		scalar	*Visual	NONE	NONE	NONE
Yellow Metal		scalar	*Visual	NONE	NONE	NONE
Precipitate		scalar	*Visual	NONE	NONE	NONE
Silt		scalar	*Visual	NONE	NONE	NONE
Debris		scalar	*Visual	NONE	▲ MODER	LIGHT
Sand/Dirt		scalar	*Visual	NONE	NONE	NONE
Appearance		scalar	*Visual	NORML	NORML	NORML
Odor		scalar	*Visual	NORML	NORML	NORML
Emulsified Water		scalar	*Visual	>0.01	NEG	NEG
Free Water		scalar	*Visual		NEG	NEG

PARAMETER	method	limit/base	current	history1	history2
FLUID PROPERTIES					
Visc @ 40°C	cSt	ASTM D445	67	68.3	67.8

PARAMETER	method	limit/base	current	history1	history2
SAMPLE IMAGES					


Color

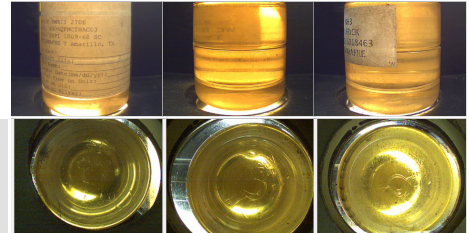


Bottom

GRAPHS


Ferrous Alloys

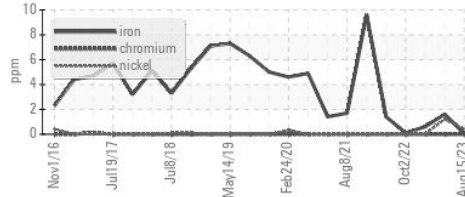


Non-ferrous Metals

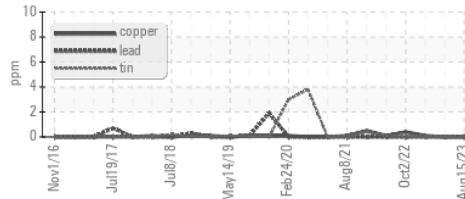

Viscosity @ 40°C

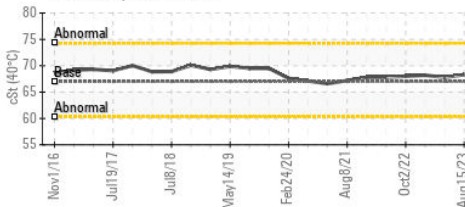

Acid Number

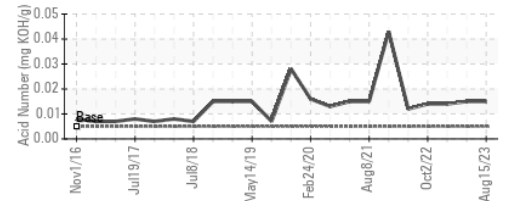

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USP0000628
 Lab Number : 05925480
 Unique Number : 10605427
 Test Package : IND 2

TYSON -AMARILLO-USP

AMARILLO, TX
US

Contact: RANDY INGRAM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (806)355-7732

F: (806)352-6946