

OIL ANALYSIS REPORT

KAESER 6202499 - RC MOLDING (S/N 1011) Component

Compressor

KAESER SIGMA (OEM) S-460 (1 GAL)

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





TITELOLE. UNEXCE. Progeous						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0845121	WC0705748	WC0662130
Sample Date		Client Info		09 Aug 2023	12 Jul 2022	09 Mar 2022
Machine Age	hrs	Client Info		23424	18770	17315
Oil Age	hrs	Client Info		23424	2746	1291
Oil Changed		Client Info		N/A	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	5	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	1	<1	<1
Tin	ppm	ASTM D5185m	>10	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	39	61	81
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	78	84	81
Calcium	ppm	ASTM D5185m	2	0	1	0
Phosphorus	ppm	ASTM D5185m		3	6	<1
Zinc	ppm	ASTM D5185m		0	<1	0
Sulfur	ppm	ASTM D5185m		21303	20514	14499
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	7	1	<1
Sodium	ppm	ASTM D5185m		18	6	12
Potassium	ppm	ASTM D5185m	>20	4	0	0
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.341	0.45	0.38
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Eree Mater	a a a l a u	*\/:		NEO	NEO	NEO

NEG

scalar *Visual


Free Water


NEG


NEG



OIL ANALYSIS REPORT

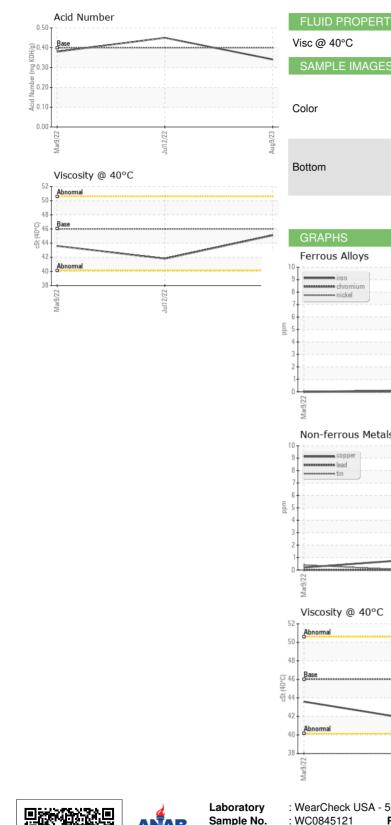

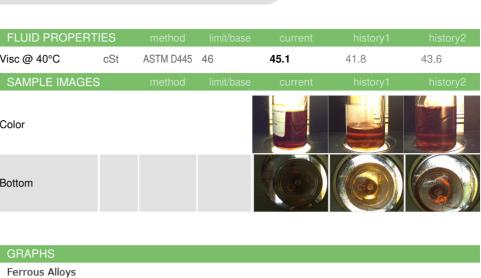

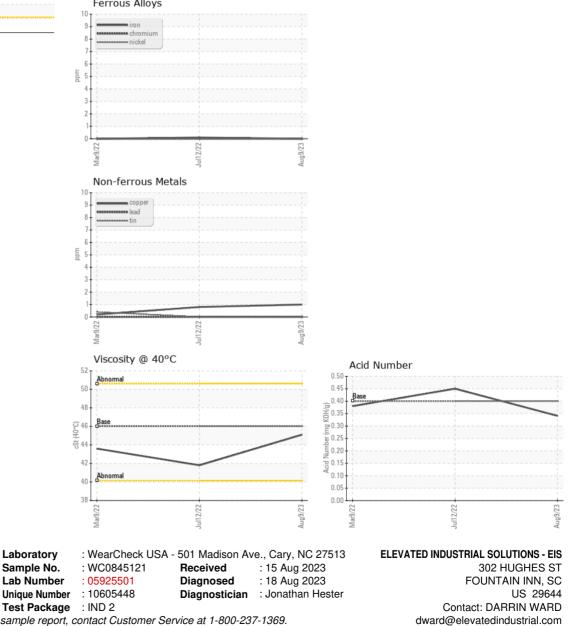



 Certificate 12367
 Test Package
 : IND 2

 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 dward

 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 dward

 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (864)862-7653

T: