




FUEL REPORT

Sample Rating Trend

NORMAL

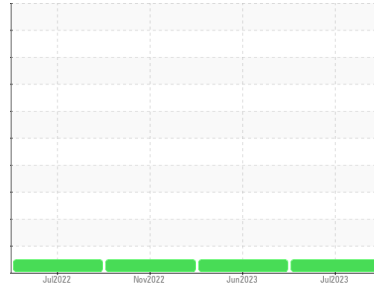

Machine Id
HC2234
 Component
Diesel Fuel
 Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample. No corrective action is recommended at this time.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.

Fuel Condition

The condition of the fuel is acceptable for the time in service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | WC0810516 | WC0746646 | WC0556159 |
| Sample Date | Client Info | | | 25 Jul 2023 | 15 Jun 2023 | 10 Nov 2022 |
| Machine Age | hrs | Client Info | | 3265 | 2929 | 2172 |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

| PHYSICAL PROPERTIES | | method | limit/base | current | history1 | history2 |
|---------------------|-----|-----------|------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | | 2.88 | 2.64 | 2.5 |

| SULFUR CONTENT | | method | limit/base | current | history1 | history2 |
|----------------|-----|-------------|------------|----------|----------|----------|
| Sulfur | ppm | ASTM D5185m | | 0 | 0 | 10 |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | <1.0 | 0 | 0 | 0 |
| Sodium | ppm | ASTM D5185m | <0.1 | 0 | 0 | 0 |
| Potassium | ppm | ASTM D5185m | <0.1 | <1 | 0 | 0 |
| Water | % | ASTM D6304 | <0.05 | 0.004 | 0.004 | 0.003 |
| ppm Water | ppm | ASTM D6304 | <500 | 42.4 | 40.7 | 38.3 |

| HEAVY METALS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Aluminum | ppm | ASTM D5185m | <0.1 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | <0.1 | 0 | 0 | 0 |
| Lead | ppm | ASTM D5185m | <0.1 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | <0.1 | 0 | 0 | 0 |
| Iron | ppm | ASTM D5185m | <0.1 | 0 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | <0.1 | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | <0.1 | 0 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | <0.1 | <1 | 0 | 0 |
| Zinc | ppm | ASTM D5185m | <0.1 | 0 | 0 | 0 |

| SAMPLE IMAGES | | method | limit/base | current | history1 | history2 |
|---------------|--|--------|------------|---------|----------|----------|
|---------------|--|--------|------------|---------|----------|----------|

Color







Bottom





FUEL REPORT

GRAPHS

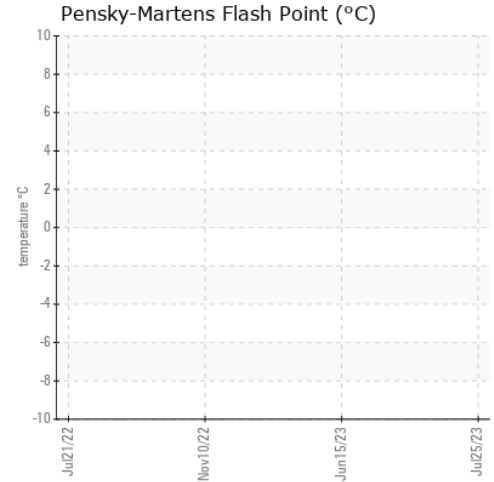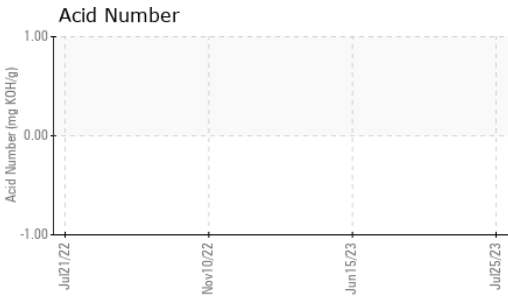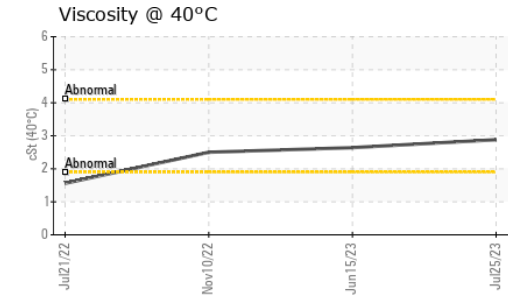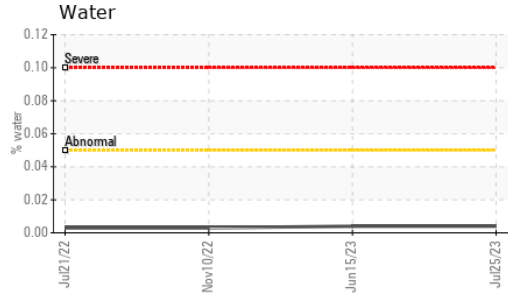

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0810516 **Received** : 15 Aug 2023
Lab Number : **05925704** **Diagnosed** : 17 Aug 2023
Unique Number : 10605651 **Diagnostician** : Jonathan Hester
Test Package : CONST (Additional Tests: KF, SCREEN)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

BUCKNER - WILLIS
 18123 HWY 75 NORTH
 WILLIS, TX
 US 77378

Contact: JOHN HAWKINS
 johnh@bucknercompanies.com

T:
 F: