

PROBLEM SUMMARY

Sample Rating Trend


ISO

North Plant-Crystallization Machine Id PU-2512F

Component **Hydraulic System**

ROYAL PURPLE SYNDRAULIC 46 (20 GAL)

COMPONENT CONDITION SUMMARY

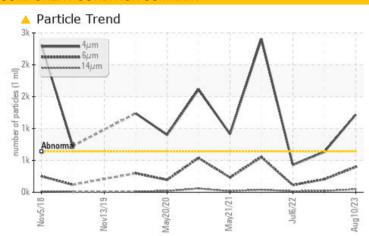

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL	ATTENTION	NORMAL			
Particles >4µm	ASTM D7647	>640	<u> </u>	635	429			
Particles >6µm	ASTM D7647	>160	4 398	2 04	112			
Particles >14µm	ASTM D7647	>40	48	20	17			
Particles >21µm	ASTM D7647	>10	<u> </u>	4	5			
Oil Cleanliness	ISO 4406 (c)	>16/14/12	17/16/13	<u>▲</u> 16/15/11	16/14/11			

Customer Id: AJIEDD Sample No.: WC0786787 Lab Number: 05926102 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

23 Jan 2023 Diag: Don Baldridge





No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



06 Jul 2022 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



13 Dec 2021 Diag: Angela Borella

ISO




We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

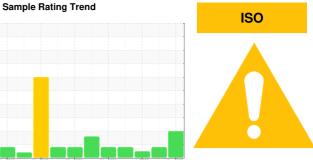

North Plant-Crystallization PU-2512F

Component

Hydraulic System

ROYAL PURPLE SYNDRAULIC 46 (20 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

.)		Nov2018	Nov2019 May2020	May2021 Jul2022	Aug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0786787	WC0723598	WC0686401
Sample Date		Client Info		10 Aug 2023	23 Jan 2023	06 Jul 2022
Machine Age	mths	Client Info		0	0	0
Oil Age	mths	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	1	1	1
Chromium	ppm	ASTM D5185m	>10	<1	<1	<1
Nickel	ppm	ASTM D5185m	>10	4	2	4
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	1	<1	<1
Copper	ppm	ASTM D5185m	>75	5	5	4
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		4	4	2
Calcium	ppm	ASTM D5185m	150	125	140	129
Phosphorus	ppm	ASTM D5185m	670	551	589	526
Zinc	ppm	ASTM D5185m	800	706	770	692
Sulfur	ppm	ASTM D5185m		15896	15849	16179
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>20	3	3	3
Sodium	ppm	ASTM D5185m		0	0	2
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Water	%	ASTM D6304	>0.1	0.013	0.006	0.017
ppm Water	ppm	ASTM D6304	>1000	130.9	64.6	175.7
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>640	<u> </u>	635	429
Particles >6µm		ASTM D7647	>160	△ 398	<u>^</u> 204	112
Particles >14μm		ASTM D7647	>40	48	20	17
Particles >21µm		ASTM D7647	>10	<u> </u>	4	5
Particles >38µm		ASTM D7647	>3	1	0	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>16/14/12	17/16/13	<u> </u>	16/14/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.71	0.72	0.64



OIL ANALYSIS REPORT







Certificate L2367

Sample No. Lab Number **Unique Number**

: WC0786787

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: 05926102 : 10606049 Test Package : PLANT

: 16 Aug 2023 Received Diagnosed : 17 Aug 2023 : Doug Bogart Diagnostician

1116 HWY 137 EDDYVILLE, IA

US 52553 Contact: Alan Brittain brittaina@ajiusa.com T: (641)295-0086

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: