




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

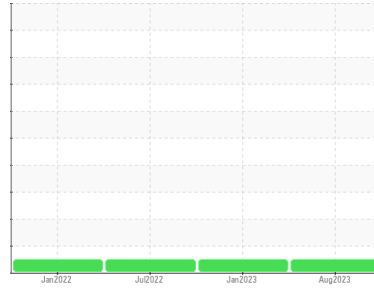

Area  
**North Plant-Purification**  
 Machine Id  
**AG-32516**

Component  
**Gear Reducer**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 320 (30 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

Viscosity of sample indicates oil is within ISO 220 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0804712</b>	WC0765962	WC0527594
Sample Date	Client Info	<b>10 Aug 2023</b>	20 Jan 2023	06 Jul 2022
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>250	<b>4</b>	5	4
Chromium ppm ASTM D5185m	>5	<b>0</b>	0	0
Nickel ppm ASTM D5185m	>5	<b>0</b>	0	0
Titanium ppm ASTM D5185m		<b>0</b>	0	0
Silver ppm ASTM D5185m		<b>0</b>	0	0
Aluminum ppm ASTM D5185m	>20	<b>0</b>	0	<1
Lead ppm ASTM D5185m	>50	<b>0</b>	0	<1
Copper ppm ASTM D5185m	>50	<b>&lt;1</b>	<1	<1
Tin ppm ASTM D5185m	>5	<b>0</b>	0	0
Antimony ppm ASTM D5185m	>5	<b>---</b>	---	---
Vanadium ppm ASTM D5185m		<b>0</b>	0	0
Cadmium ppm ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	0	0
Barium ppm ASTM D5185m		<b>1</b>	1	0
Molybdenum ppm ASTM D5185m		<b>0</b>	0	0
Manganese ppm ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium ppm ASTM D5185m	90	<b>73</b>	82	74
Calcium ppm ASTM D5185m		<b>&lt;1</b>	<1	0
Phosphorus ppm ASTM D5185m		<b>5</b>	7	5
Zinc ppm ASTM D5185m		<b>5</b>	5	2
Sulfur ppm ASTM D5185m		<b>20907</b>	17998	19492

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>60	<b>&lt;1</b>	<1	0
Sodium ppm ASTM D5185m		<b>0</b>	0	0
Potassium ppm ASTM D5185m	>20	<b>1</b>	<1	<1
Water % ASTM D6304	>0.2	<b>0.042</b>	0.012	0.029
ppm Water ppm ASTM D6304	>2000	<b>429.9</b>	126.8	293.9

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>20000	<b>10840</b>	3425	1363
Particles >6µm ASTM D7647	>5000	<b>3284</b>	554	193
Particles >14µm ASTM D7647	>640	<b>284</b>	46	28
Particles >21µm ASTM D7647	>160	<b>60</b>	11	7
Particles >38µm ASTM D7647	>40	<b>2</b>	0	0
Particles >71µm ASTM D7647	>10	<b>1</b>	0	0
Oil Cleanliness ISO 4406 (c)	>21/19/16	<b>21/19/15</b>	19/16/13	18/15/12

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	0.25	<b>0.46</b>	0.42	0.46




# OIL ANALYSIS REPORT

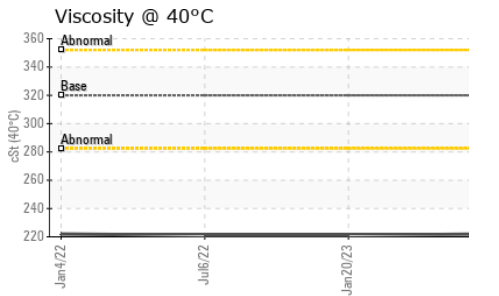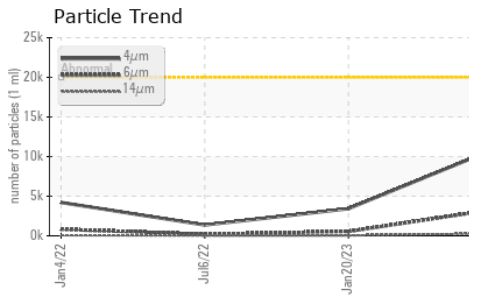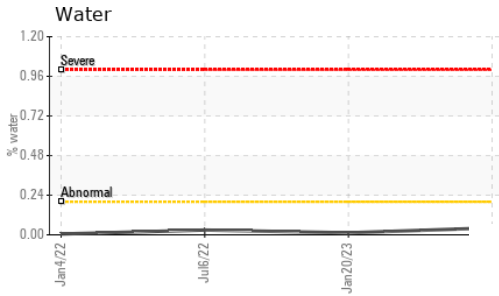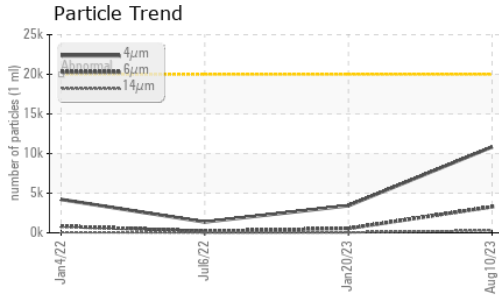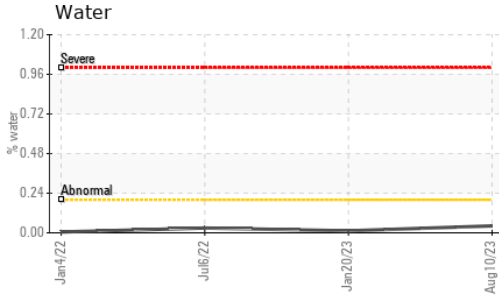






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 320	<b>222</b>	221	221

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

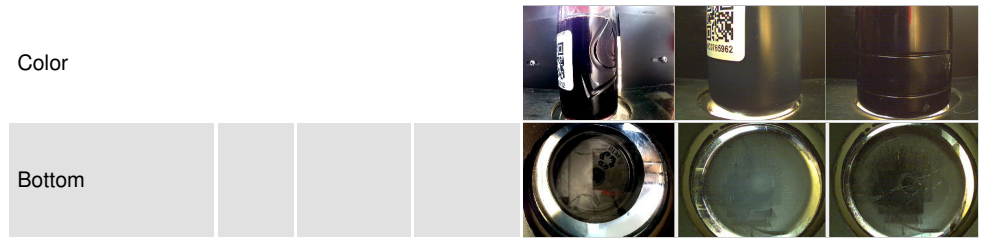

## GRAPHS

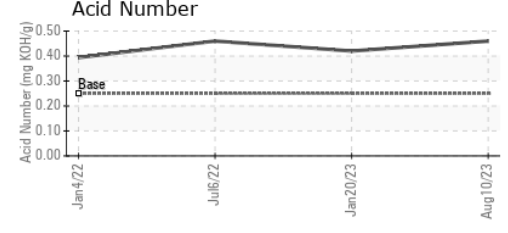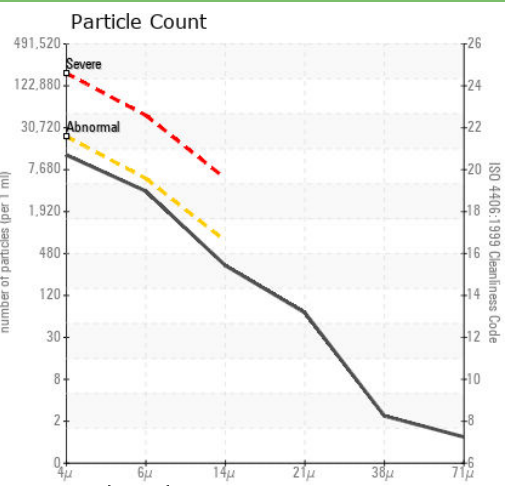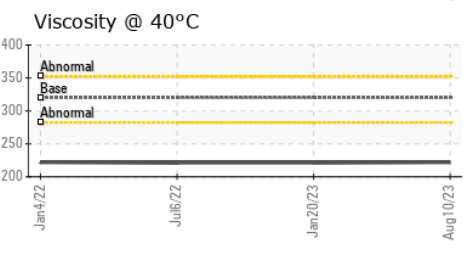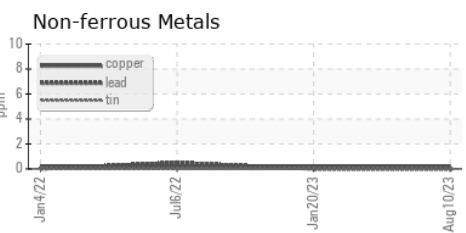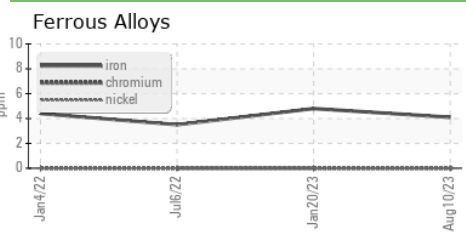

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0804712  
**Lab Number** : **05926122**  
**Unique Number** : 10606069  
**Test Package** : PLANT

**AJINOMOTO ANIMAL NUTRITION NORTH AMERICA, INC.**  
 1116 HWY 137  
 EDDYVILLE, IA  
 US 52553  
 Contact: Alan Brittain  
 brittaina@ajjusa.com  
 T: (641)295-0086  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)