

# **PROBLEM SUMMARY**


## Sample Rating Trend

# ISO

# North Plant-Crystallization PU-2513L


Component **Lube System** 

**ROYAL PURPLE SYNFILM GT 46 (20 GAL)** 





## **COMPONENT CONDITION SUMMARY**

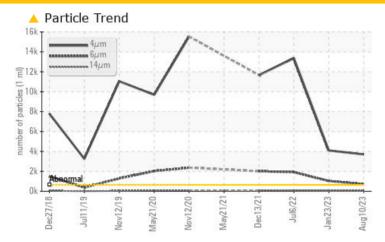

### RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL				
Particles >4µm	ASTM D7647	>640	<u> </u>	<b>4</b> 098	<u>▲</u> 13359				
Particles >6µm	ASTM D7647	>160	<u> </u>	<u>1031</u>	<b>1</b> 919				
Particles >14µm	ASTM D7647	>40	<u>41</u>	<b>4</b> 8	<b>▲</b> 79				
Particles >21µm	ASTM D7647	>10	<u> 11</u>	8	<u> </u>				
Oil Cleanliness	ISO 4406 (c)	>16/14/12	<u> </u>	<b>1</b> 9/17/13	<u>^</u> 21/18/13				

Customer Id: AJIEDD **Sample No.:** WC0786775 Lab Number: 05926129 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

### **RECOMMENDED ACTIONS**

Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS

## 23 Jan 2023 Diag: Don Baldridge



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 06 Jul 2022 Diag: Don Baldridge





We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### 13 Dec 2021 Diag: Angela Borella

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

Sample Rating Trend



# North Plant-Crystallization PU-2513L

Component

**Lube System** 

**ROYAL PURPLE SYNFILM GT 46 (20 GAL)** 

# **DIAGNOSIS**

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec2018 Jul2	019 Nov2019 May2020 Nov2	020 May2021 Dec2021 Jul2022 Jan2	023 Aug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0786775	WC0765949	WC0686368
Sample Date		Client Info		10 Aug 2023	23 Jan 2023	06 Jul 2022
Machine Age	mths	Client Info		0	0	0
Oil Age	mths	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	17	15	12
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>10	0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	3	4	3
Copper	ppm	ASTM D5185m	>75	3	2	2
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	<1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	95	32	57	39
Calcium	ppm	ASTM D5185m	0	1	12	3
Phosphorus	ppm	ASTM D5185m	0	57	64	57
Zinc	ppm	ASTM D5185m	0	3	1	2
Sulfur	ppm	ASTM D5185m	15000	20001	17711	21423
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>20	2	1	1
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Water	%	ASTM D6304	>0.1	0.012	0.004	0.014
ppm Water	ppm	ASTM D6304	>1000	124.3	49.4	149.2
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>640	<b>4</b> 3701	<b>4</b> 098	<b>▲</b> 13359
Particles >6µm		ASTM D7647	>160	<u>^</u> 715	<u></u> 1031	<b>△</b> 1919
Particles >14μm		ASTM D7647	>40	<b>4</b> 1	<b>4</b> 8	<b>△</b> 79
Particles >21µm		ASTM D7647	>10	<u> 11</u>	8	<u> </u>
Particles >38µm		ASTM D7647	>3	1	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>16/14/12	<u> </u>	<b>△</b> 19/17/13	<b>△</b> 21/18/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.48



## **OIL ANALYSIS REPORT**

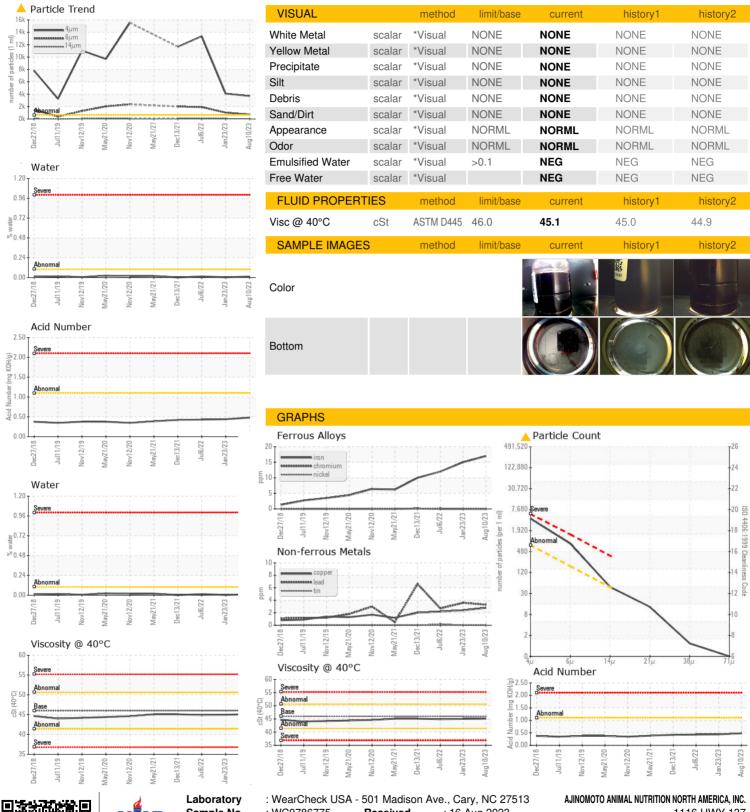





Certificate L2367

Sample No. Lab Number **Unique Number** 

: 05926129 : 10606076 Test Package : PLANT

: WC0786775

Received : 16 Aug 2023 : 17 Aug 2023 : Doug Bogart

Diagnosed Diagnostician

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

1116 HWY 137 EDDYVILLE, IA US 52553

Contact: Alan Brittain brittaina@ajiusa.com

T: (641)295-0086 F:

Submitted By: Alan Brittain