

PROBLEM SUMMARY

Sample Rating Trend

ISO


iso

North Plant-Crystallization PU-2513A

Component **Lube System**

ROYAL PURPLE SYNFILM GT 46 (20 GAL)

COMPONENT CONDITION SUMMARY

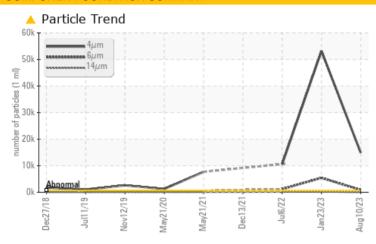

RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL		
Particles >4µm	ASTM D7647	>640	14926	<u></u> 53234	<u></u> 10604		
Particles >6µm	ASTM D7647	>160	▲ 870	<u>▲</u> 5429	<u></u> 1164		
Oil Cleanliness	ISO 4406 (c)	>16/14/12	<u>^</u> 21/17/11	23/20/15	<u>^</u> 21/17/14		

Customer Id: AJIEDD Sample No.: WC0804717 Lab Number: 05926130 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component if applicable.

HISTORICAL DIAGNOSIS

23 Jan 2023 Diag: Don Baldridge





We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

View report

06 Jul 2022 Diag: Don Baldridge

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

13 Dec 2021 Diag: Angela Borella

VIS DEBRIS



We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






OIL ANALYSIS REPORT

North Plant-Crystallization PU-2513A

Component

Lube System

ROYAL PURPLE SYNFILM GT 46 (20 GAL)





DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

0.1.101 5 11.5001.11				May2021 Dec2021 Jul2022 Jan20		
SAMPLE INFORMA	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0804717	WC0765952	WC0686374
Sample Date		Client Info		10 Aug 2023	23 Jan 2023	06 Jul 2022
3-	mths	Client Info		0	0	0
J	mths	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	3	4	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>10	0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	<1
	ppm	ASTM D5185m		0	0	0
	ppm	ASTM D5185m	>10	6	3	1
Copper	ppm	ASTM D5185m		2	1	1
	ppm	ASTM D5185m	>10	0	0	<1
	ppm	ASTM D5185m				
	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	0	1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
	ppm	ASTM D5185m	95	57	61	58
	ppm	ASTM D5185m	0	41	46	45
	ppm	ASTM D5185m	0	20	23	25
	ppm	ASTM D5185m	0	2	0	1
Sulfur	ppm	ASTM D5185m	15000	19934	18818	21131
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>20	1	1	1
Sodium	ppm	ASTM D5185m		0	<1	1
Potassium	ppm	ASTM D5185m	>20	1	<1	0
Water	%	ASTM D6304	>0.1	0.014	0.003	0.017
ppm Water	ppm	ASTM D6304	>1000	145.6	35.9	176.7
FLUID CLEANLINE	SS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>640	<u> </u>	▲ 53234	<u>▲</u> 10604
Particles >6μm		ASTM D7647		<u>A</u> 870	<u>▲</u> 5429	<u>1164</u>
Particles >14µm		ASTM D7647	>40	20	<u> </u>	<u>116</u>
Particles >21µm		ASTM D7647	>10	5	<u>▲</u> 57	<u>42</u>
Particles >38µm		ASTM D7647	>3	0	<u>^</u> 8	<u>^</u> 7
Particles >71µm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>16/14/12	<u> </u>	<u>\$\text{\Delta}\$ 23/20/15</u>	<u> </u>
FLUID DEGRADAT	ION	method	limit/base	current	history1	history2

0.40

Acid Number (AN)

mg KOH/g ASTM D8045

0.33



OIL ANALYSIS REPORT



Certificate L2367

Test Package

: PLANT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: Alan Brittain

brittaina@ajiusa.com

T: (641)295-0086

F: