


## **PROBLEM SUMMARY**

# ER1 HSRC-05 (S/N 60357)

Refrigeration Compressor Fluid USPI ALT-68 SC (--- GAL)

### COMPONENT CONDITION SUMMARY

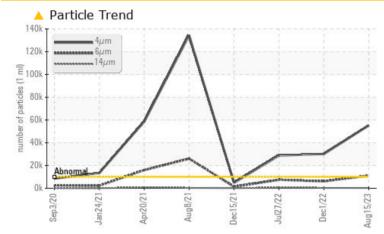

### RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL			
Particles >4µm	ASTM D7647	>10000	<b>6</b> 55202	<b>A</b> 30120	<u> </u>			
Particles >6µm	ASTM D7647	>2500	🔺 11136	6031	<b>A</b> 7467			
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<u> </u>	<b>A</b> 22/20/15	<u> </u>			


Customer Id: AMEOMA Sample No.: USP0000616 Lab Number: 05926159 Test Package: IND 2



To manage this report scan the QR code

*To discuss the diagnosis or test data:* Doug Bogart +1 (800)237-1369 x4016 <u>dougb@wearcheckusa.com</u>

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

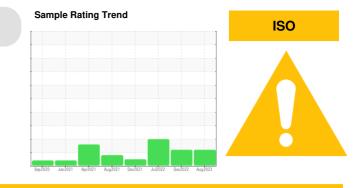

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

### 01 Dec 2022 Diag: Doug Bogart



Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report

### 27 Jul 2022 Diag: Doug Bogart

15 Dec 2021 Diag: Doug Bogart



We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.







Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.








### **OIL ANALYSIS REPORT**

SAMPLE INFORMATION method

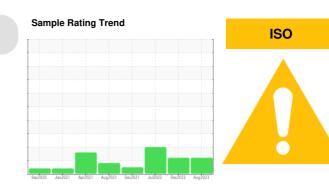

current

history1

history2

# ER1 HSRC-05 (S/N 60357)

Refrigeration Compressor Fluid USPI ALT-68 SC (--- GAL)

### DIAGNOSIS

### A Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Comple Number		Client Info		USP0000616	USP247967	USP240310	
Sample Number		Client Info			03P247967 01 Dec 2022	27 Jul 2022	
Sample Date	la un			15 Aug 2023			
Machine Age	hrs	Client Info		0	0	0	
Oil Age	hrs	Client Info		0	0	0	
Oil Changed		Client Info		N/A	N/A	N/A	
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>8	<1	<1	<1	
Chromium	ppm	ASTM D5185m	>2	0	0	0	
Nickel	ppm	ASTM D5185m		0	0	0	
Titanium	ppm	ASTM D5185m		0	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	0	
Aluminum	ppm	ASTM D5185m	>3	0	0	<1	
Lead	ppm	ASTM D5185m	>2	0	0	0	
Copper	ppm	ASTM D5185m	>8	0	0	0	
Tin	ppm	ASTM D5185m	>4	0	0	0	
Antimony	ppm	ASTM D5185m					
Vanadium	ppm	ASTM D5185m		0	0	0	
Cadmium	ppm	ASTM D5185m		0	0	0	
ADDITIVES		method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	0	
Barium	ppm	ASTM D5185m		<1	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	0	
Manganese	ppm	ASTM D5185m		0	0	0	
Magnesium	ppm	ASTM D5185m		0	0	0	
Calcium	ppm	ASTM D5185m		0	<1	0	
Phosphorus	ppm	ASTM D5185m		0	0	0	
Zinc	ppm	ASTM D5185m		0	0	0	
Sulfur	ppm	ASTM D5185m	50	0	2	0	
CONTAMINANTS		method	limit/base		history1	history2	
Silicon	ppm	ASTM D5185m	>15	<1	0	0	
Sodium	ppm	ASTM D5185m	>15	0	0	0	
Potassium		ASTM D5185m	>20	۰ <1	0	<1	
Water	ppm %	ASTM D5185III ASTM D6304	>20	< 1	0.003	0.003	
ppm Water		ASTM D6304 ASTM D6304	>0.01	20.8	34.3	35.3	
	ppm						
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2	
Particles >4µm		ASTM D7647	>10000	<b>6</b> 55202	<b>A</b> 30120	<b>2</b> 8770	
Particles >6µm		ASTM D7647	>2500	<u> </u>	<u> </u>	<u>∧</u> 7467	
Particles >14µm		ASTM D7647	>320	271	303	<u> </u>	
Particles >21µm		ASTM D7647	>80	29	65	<b>1</b> 26	
Particles >38µm		ASTM D7647	>20	0	1	1	
Particles >71µm		ASTM D7647	>4	0	0	0	
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>A</b> 23/21/15	<b>22/20/15</b>	▲ 22/20/16	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.013	0.015	0.015	
·44·46) Rev: 1	- 0		Contact/Location: Service Manager - AMEOMA				

limit/base

Report Id: AMEOMA [WUSCAR] 05926159 (Generated: 08/17/2023 14:44:46) Rev: 1

Contact/Location: Service Manager - AMEOMA





Acid Number


0.02


0.01 (B/H0) KOH/0

## **OIL ANALYSIS REPORT**





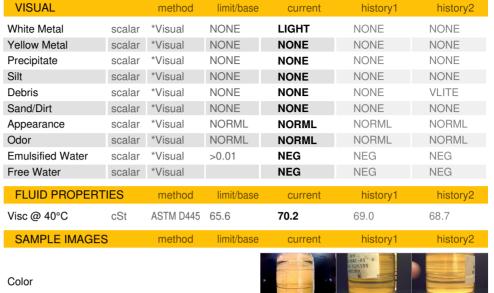



Bottom



Contact/Location: Service Manager - AMEOMA