


PROBLEM SUMMARY

Area **PD01** [1787343] Machine Id **RC-02 (S/N TDSH233S1735E)** Component

Refrigeration Compressor

FRICK COMPRESSOR OIL #3 (165 GAL)

COMPONENT CONDITION SUMMARY

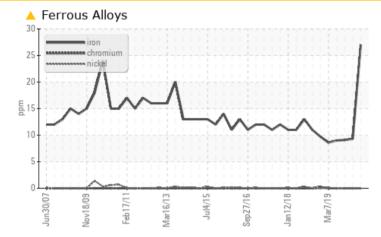

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status				ABNORMAL	NORMAL	NORMAL		
Iron	ppm	ASTM D5185m	>8	<u> </u>	9	9		


Customer Id: LEPFOR Sample No.: WC0807608 Lab Number: 05926176 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

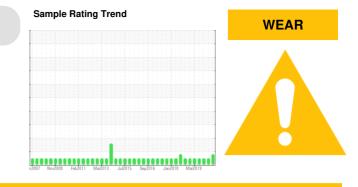

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

10 Jan 2020 Diag: Jonathan Hester



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the component. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



22 Aug 2019 Diag: Don Baldridge



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the component. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

06 Jun 2019 Diag: Jonathan Hester



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.







OIL ANALYSIS REPORT

Area **PD01** [1787343] Machine Id **RC-02 (S/N TDSH233S1735E)** Component

Refrigeration Compressor

FRICK COMPRESSOR OIL #3 (165 GAL)

DIAGNOSIS

A Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

🔺 Wear


The iron level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

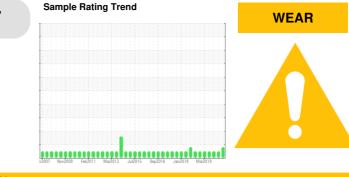



SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0807608	WC0397306	WC0357827
Sample Date		Client Info		04 Aug 2023	10 Jan 2020	22 Aug 2019
Machine Age	hrs	Client Info		23345	193697	190547
Oil Age	hrs	Client Info		23345	0	0
Oil Changed		Client Info		Filtered	Not Changd	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	A 27	9	9
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>3	0	0	<1
Lead	ppm	ASTM D5185m	>2	<1	0	0
Copper	ppm	ASTM D5185m	>8	0	<1	<1
Tin	ppm	ASTM D5185m	>4	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	<1
Barium	ppm	ASTM D5185m		7	4	5
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		<1	<1	1
Phosphorus	ppm	ASTM D5185m		0	<1	<1
Zinc	ppm	ASTM D5185m		1	10	8
Sulfur	ppm	ASTM D5185m		96	788	743
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	1
Sodium	ppm	ASTM D5185m		0	2	2
Potassium	ppm	ASTM D5185m	>20	<1	0	<1
Water	%	ASTM D6304	>0.01	0.001	0.001	0.002
ppm Water	ppm	ASTM D6304	>100	2.1	11.4	21.5
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
						· · · · ·




OIL ANALYSIS REPORT










VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	VLITE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	73	68.7	68.5	68.2
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

ttom

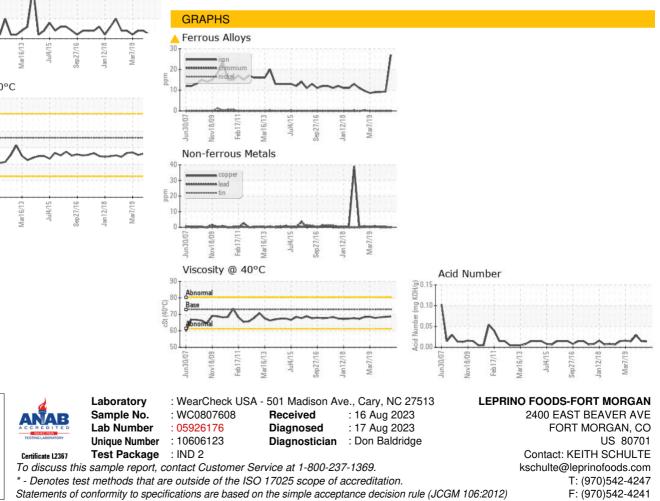

Submitted By: ? IND2BUSREP

Page 4 of 4