

OIL ANALYSIS REPORT

Area **S-460** [5864] **KAESER 1075 - SUPERIOR GRAPHITE CO** Component

Compressor

Recommendation

We suspect abnormal contamination may be due to sampling method. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend




			Jun2023	Aug2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05926215	UCH05873340	
Sample Date		Client Info		08 Aug 2023	06 Jun 2023	
Machine Age	hrs	Client Info		6357	5501	
Oil Age	hrs	Client Info		6357	5501	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	5	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m		8	8	
Tin	ppm		>10	0	0	
Vanadium	ppm	ASTM D5185m	-	<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	2	3	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m	-	5	0	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		19871	21564	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	13	
Sodium	ppm	ASTM D5185m	220	1	2	
Potassium	ppm	ASTM D5185m	>20	- <1	<1	
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.47	0.46	
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	LIGHT	MODER	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	
Free Water	scalar	*Visual	- 0.00	NEG	NEG	
1:25:37) Boy: 1	000101	violal	Cont		CHAEL EERRIS	

Contact/Location: MICHAEL FERRIS - UCDELDOW



OIL ANALYSIS REPORT

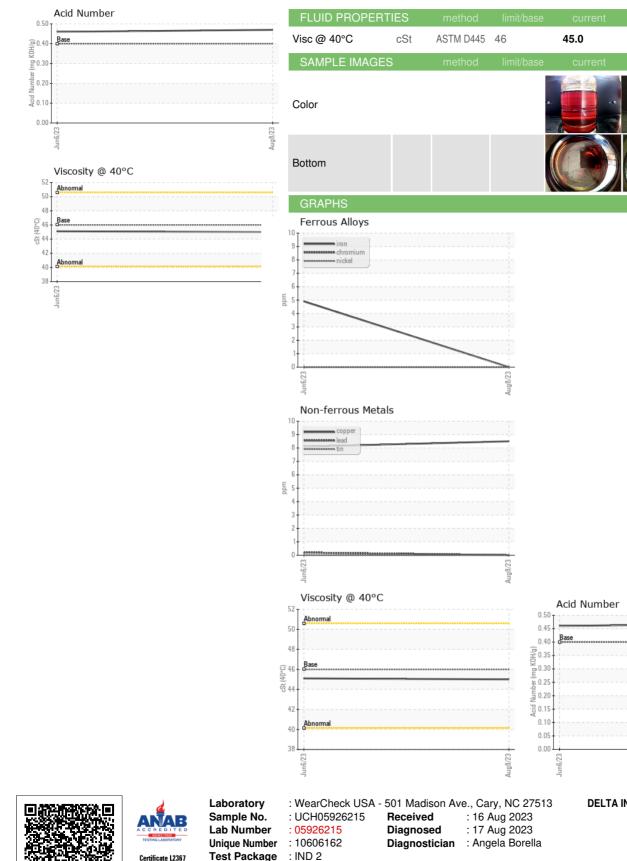

DELTA INDUSTRIES - DOWNERS GROVE 2201 CURTISS STREET DOWNERS GROVE, IL US 60515 Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: (630)960-3931

45.1

no image

no image