




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**ROTO Z [PM6-2698324]**  
 Machine Id  
**ATLAS COPCO API794561 - APPLE/ICOM**  
 Component  
**Compressor**

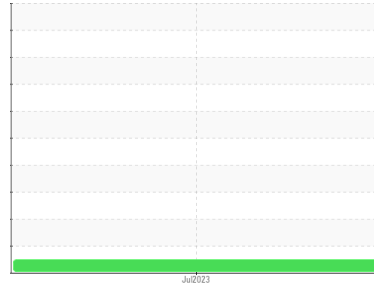

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1 | history2 |
|---------------|-------------|-------------|--------------------|----------|----------|
| Sample Number | Client Info |             | <b>UCH05926234</b> | ---      | ---      |
| Sample Date   | Client Info |             | <b>21 Jul 2023</b> | ---      | ---      |
| Machine Age   | hrs         | Client Info | <b>2928</b>        | ---      | ---      |
| Oil Age       | hrs         | Client Info | <b>2928</b>        | ---      | ---      |
| Oil Changed   | Client Info |             | <b>Changed</b>     | ---      | ---      |
| Sample Status |             |             | <b>NORMAL</b>      | ---      | ---      |

## WEAR METALS

|          | method | limit/base      | current      | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron     | ppm    | ASTM D5185m >50 | <b>&lt;1</b> | ---      | ---      |
| Chromium | ppm    | ASTM D5185m >5  | <b>0</b>     | ---      | ---      |
| Nickel   | ppm    | ASTM D5185m     | <b>0</b>     | ---      | ---      |
| Titanium | ppm    | ASTM D5185m     | <b>0</b>     | ---      | ---      |
| Silver   | ppm    | ASTM D5185m     | <b>0</b>     | ---      | ---      |
| Aluminum | ppm    | ASTM D5185m >15 | <b>0</b>     | ---      | ---      |
| Lead     | ppm    | ASTM D5185m >65 | <b>0</b>     | ---      | ---      |
| Copper   | ppm    | ASTM D5185m >65 | <b>1</b>     | ---      | ---      |
| Tin      | ppm    | ASTM D5185m >10 | <b>0</b>     | ---      | ---      |
| Vanadium | ppm    | ASTM D5185m     | <b>&lt;1</b> | ---      | ---      |
| Cadmium  | ppm    | ASTM D5185m     | <b>0</b>     | ---      | ---      |

## ADDITIVES

|            | method | limit/base  | current      | history1 | history2 |
|------------|--------|-------------|--------------|----------|----------|
| Boron      | ppm    | ASTM D5185m | <b>0</b>     | ---      | ---      |
| Barium     | ppm    | ASTM D5185m | <b>0</b>     | ---      | ---      |
| Molybdenum | ppm    | ASTM D5185m | <b>0</b>     | ---      | ---      |
| Manganese  | ppm    | ASTM D5185m | <b>&lt;1</b> | ---      | ---      |
| Magnesium  | ppm    | ASTM D5185m | <b>2</b>     | ---      | ---      |
| Calcium    | ppm    | ASTM D5185m | <b>3</b>     | ---      | ---      |
| Phosphorus | ppm    | ASTM D5185m | <b>394</b>   | ---      | ---      |
| Zinc       | ppm    | ASTM D5185m | <b>34</b>    | ---      | ---      |
| Sulfur     | ppm    | ASTM D5185m | <b>620</b>   | ---      | ---      |

## CONTAMINANTS

|           | method | limit/base      | current      | history1 | history2 |
|-----------|--------|-----------------|--------------|----------|----------|
| Silicon   | ppm    | ASTM D5185m >35 | <b>&lt;1</b> | ---      | ---      |
| Sodium    | ppm    | ASTM D5185m     | <b>2</b>     | ---      | ---      |
| Potassium | ppm    | ASTM D5185m >20 | <b>3</b>     | ---      | ---      |

## FLUID DEGRADATION



|                  | method   | limit/base | current     | history1 | history2 |
|------------------|----------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | <b>0.29</b> | ---      | ---      |

## VISUAL



|                  | method | limit/base    | current      | history1 | history2 |
|------------------|--------|---------------|--------------|----------|----------|
| White Metal      | scalar | *Visual NONE  | <b>NONE</b>  | ---      | ---      |
| Yellow Metal     | scalar | *Visual NONE  | <b>NONE</b>  | ---      | ---      |
| Precipitate      | scalar | *Visual NONE  | <b>NONE</b>  | ---      | ---      |
| Silt             | scalar | *Visual NONE  | <b>NONE</b>  | ---      | ---      |
| Debris           | scalar | *Visual NONE  | <b>NONE</b>  | ---      | ---      |
| Sand/Dirt        | scalar | *Visual NONE  | <b>NONE</b>  | ---      | ---      |
| Appearance       | scalar | *Visual NORML | <b>NORML</b> | ---      | ---      |
| Odor             | scalar | *Visual NORML | <b>NORML</b> | ---      | ---      |
| Emulsified Water | scalar | *Visual >0.1  | <b>NEG</b>   | ---      | ---      |
| Free Water       | scalar | *Visual       | <b>NEG</b>   | ---      | ---      |







# OIL ANALYSIS REPORT

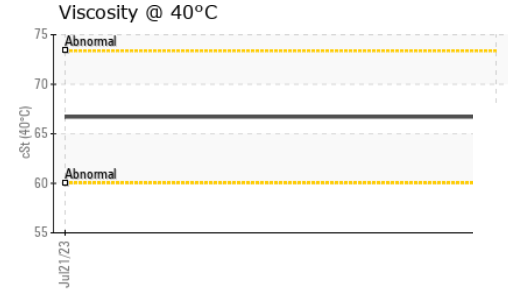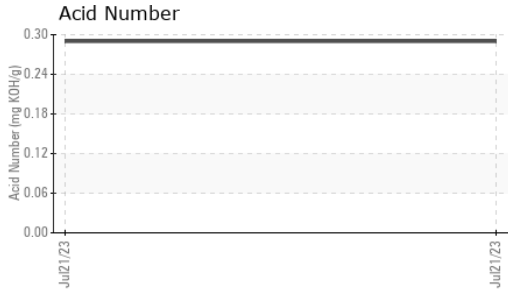

| FLUID PROPERTIES | method | limit/base | current     | history1 | history2 |
|------------------|--------|------------|-------------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | <b>66.7</b> | ---      | ---      |

| SAMPLE IMAGES | method | limit/base | current   | history1 | history2 |
|---------------|--------|------------|---|----------|----------|
| Color         |        |            |  | no image | no image |
| Bottom        |        |            |  | no image | no image |

## GRAPHS

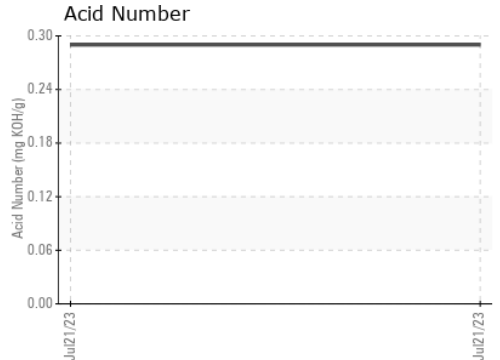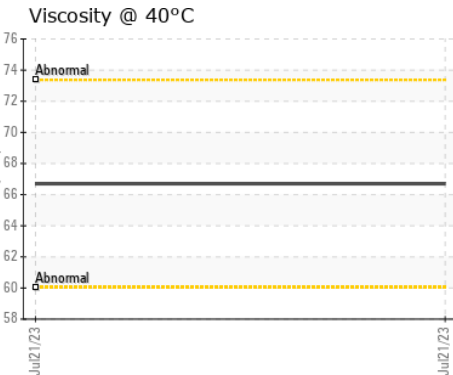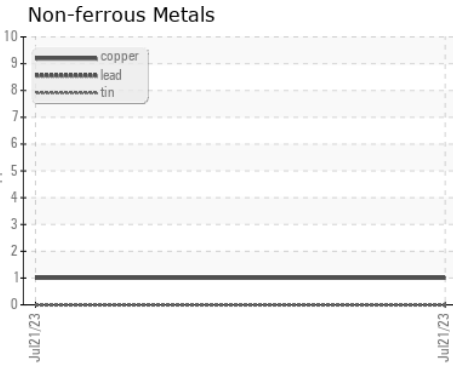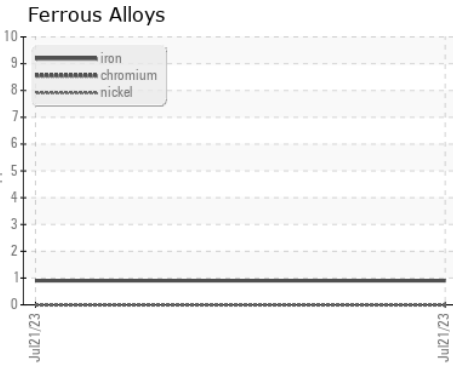

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05926234    **Received** : 16 Aug 2023  
**Lab Number** : **05926234**    **Diagnosed** : 17 Aug 2023  
**Unique Number** : 10606181    **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**CISCO AIR SYSTEMS**  
 2373 LINCOLN AVE  
 HAYWARD, CA  
 US 94545

Contact: ANDREW DATTOLICO  
 adattolico@ciscoair.com  
 T: (916)414-0331  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)