




PROBLEM SUMMARY

Sample Rating Trend

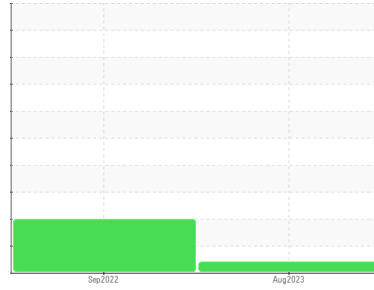

VIS DEBRIS



Machine Id
KAESER SK20 6533803 (S/N 1171)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ABNORMAL	---
Debris	scalar *Visual	NONE	▲ HEAVY	LIGHT ---

Customer Id: AIRHUN
Sample No.: KCPA004123
Lab Number: 05926724
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

20 Sep 2022 Diag: Don Baldrige

ISO




Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

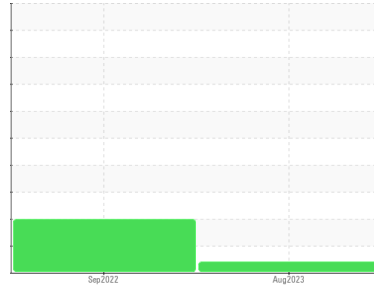

VIS DEBRIS



Machine Id
KAESER SK20 6533803 (S/N 1171)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

High concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA004123	KCP31948	---
Sample Date	Client Info			16 Aug 2023	20 Sep 2022	---
Machine Age	hrs	Client Info		22209	17209	---
Oil Age	hrs	Client Info		7471	3000	---
Oil Changed	Client Info			N/A	Changed	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	0	<1	---
Aluminum	ppm	ASTM D5185m	>10	<1	<1	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	8	27	---
Tin	ppm	ASTM D5185m	>10	0	<1	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m	90	31	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m	90	62	2	---
Calcium	ppm	ASTM D5185m	2	<1	0	---
Phosphorus	ppm	ASTM D5185m		5	5	---
Zinc	ppm	ASTM D5185m		49	30	---
Sulfur	ppm	ASTM D5185m		21649	19705	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	---
Sodium	ppm	ASTM D5185m		10	0	---
Potassium	ppm	ASTM D5185m	>20	3	1	---
Water	%	ASTM D6304	>0.05	0.026	0.004	---
ppm Water	ppm	ASTM D6304	>500	267.2	47.9	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	37901	---
Particles >6µm		ASTM D7647	>1300	---	▲ 12625	---
Particles >14µm		ASTM D7647	>80	---	▲ 1167	---
Particles >21µm		ASTM D7647	>20	---	▲ 361	---
Particles >38µm		ASTM D7647	>4	---	▲ 20	---
Particles >71µm		ASTM D7647	>3	---	▲ 2	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	▲ 22/21/17	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.42	0.34	---


OIL ANALYSIS REPORT

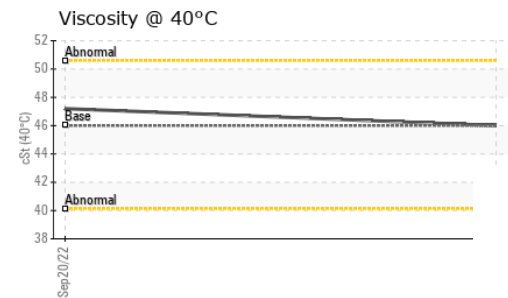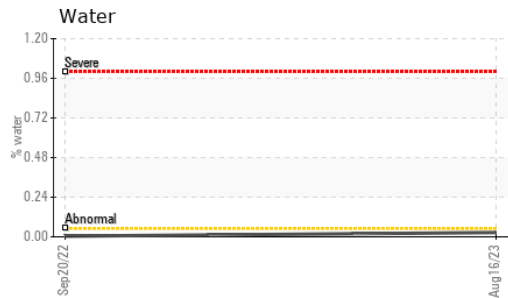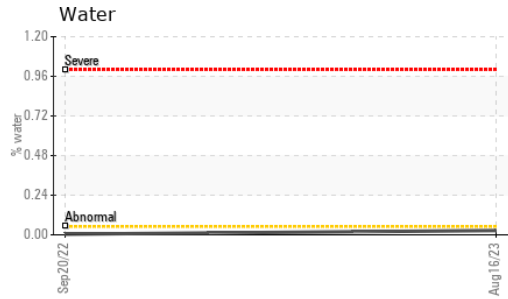





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	LIGHT	LIGHT	---
Yellow Metal	scalar	*Visual NONE	NONE	NONE	---
Precipitate	scalar	*Visual NONE	NONE	NONE	---
Silt	scalar	*Visual NONE	NONE	NONE	---
Debris	scalar	*Visual NONE	▲ HEAVY	LIGHT	---
Sand/Dirt	scalar	*Visual NONE	NONE	NONE	---
Appearance	scalar	*Visual NORML	NORML	NORML	---
Odor	scalar	*Visual NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual >0.05	NEG	NEG	---
Free Water	scalar	*Visual	NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.0	47.2	---

SAMPLE IMAGES

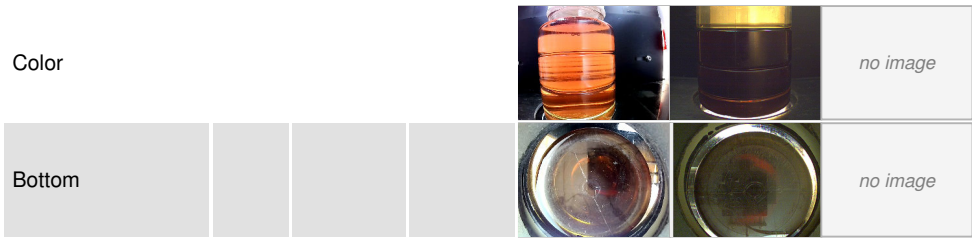

GRAPHS

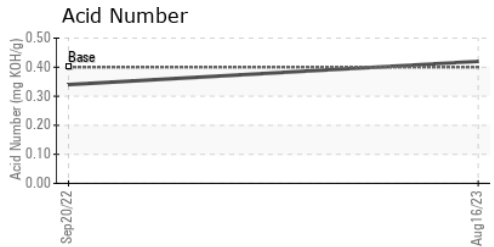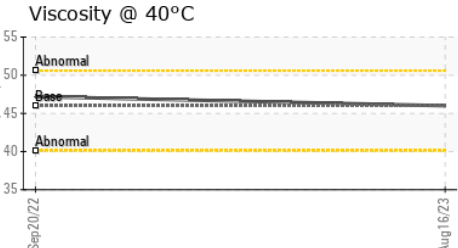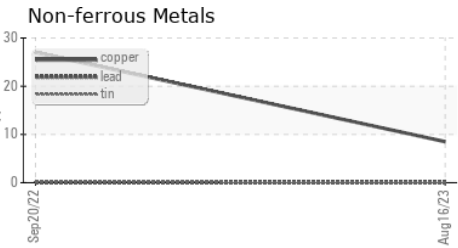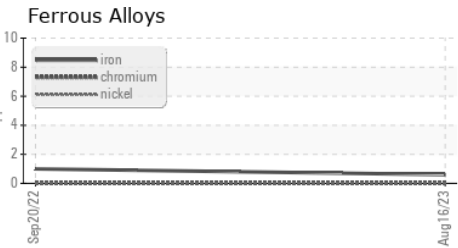

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA004123 **Received** : 16 Aug 2023
Lab Number : **05926724** **Diagnosed** : 18 Aug 2023
Unique Number : 10606671 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AIRCRAFT X-RAY
 5216 PACIFIC BLVD
 HUNTINGTON PARK, CA
 US 90255
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: