

# **PROBLEM SUMMARY**

KAESER 8116349


Component

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

# Sample Rating Trend ISO

## **COMPONENT CONDITION SUMMARY**

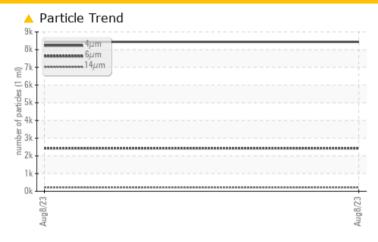

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			<b>ABNORMAL</b>					
Particles >6µm	ASTM D7647	>1300	<b>4</b> 2430					
Particles >14μm	ASTM D7647	>80	<u> </u>					
Particles >21µm	ASTM D7647	>20	<b>△</b> 56					
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>20/18/15</b>					

Customer Id: MONLAM Sample No.: KCPA004356 Lab Number: 05926733 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

# RECOMMENDED ACTIONS

There are no recommended actions for this sample.

# HISTORICAL DIAGNOSIS




# **OIL ANALYSIS REPORT**

**KAESER 8116349** 

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)



## **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA004356		
Sample Date		Client Info		08 Aug 2023		
Machine Age	hrs	Client Info		4823		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	13		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	2		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	22286		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	<1		
	ppm		>20			
Sodium Potassium	ppm	ASTM D5185m ASTM D5185m	>20	2		
	ppm o/		>0.05	0.005		
Water ppm Water	% ppm	ASTM D6304 ASTM D6304	>0.05	59.9		
FLUID CLEANLIN		method	limit/base	current	history1	history2
	1200		mini/base			
Particles >4µm Particles >6µm		ASTM D7647 ASTM D7647	>1300	8439 <b>2430</b>		
Particles >14µm		ASTM D7647	>80	<u>△</u> 217		
Particles >21µm		ASTM D7647	>20	▲ 56		
Particles >38µm		ASTM D7647 ASTM D7647	>4	3		
Particles >30µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	△ 20/18/15		
	TION	. ,				
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.34		



# **OIL ANALYSIS REPORT**

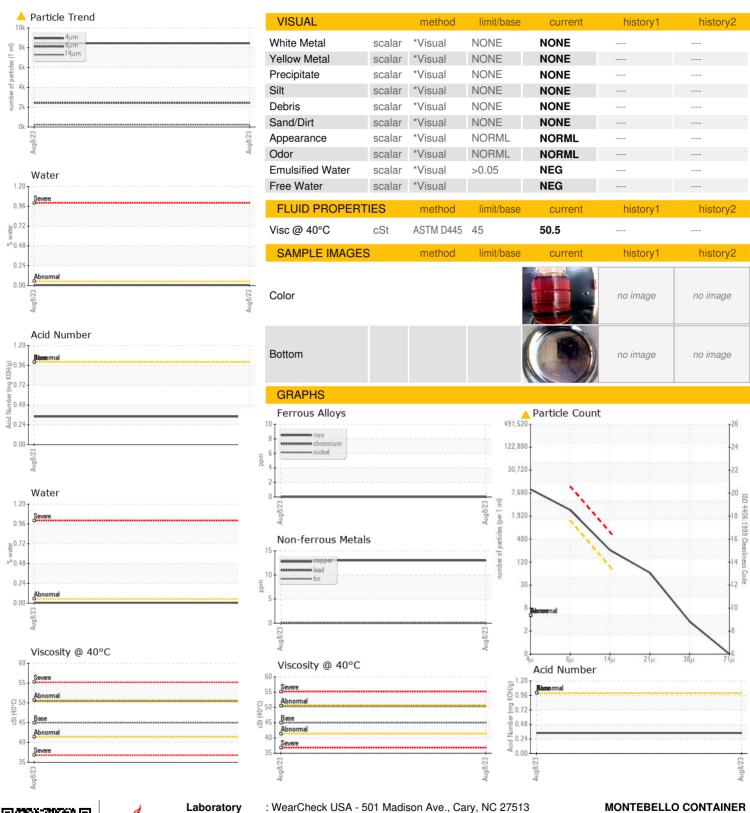





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** 

: 05926733

: KCPA004356 : 10606680

Received Diagnosed

: 18 Aug 2023 Diagnostician : Don Baldridge

: 16 Aug 2023

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**MONTEBELLO CONTAINER** 

14333 MACAW ST LA MIRADA, CA US 90638

Contact: Service Manager

T:

F: