

PROBLEM SUMMARY

Sample Rating Trend


ISO

Machine Id **6281799 (S/N 1202)**

Component Compressor

NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

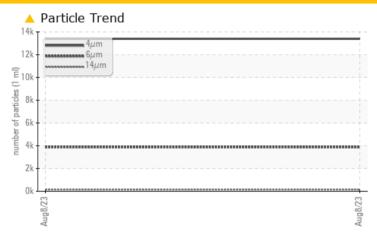

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status			ABNORMAL				
Particles >6μm	ASTM D7647	>1300	△ 3875				
Particles >14μm	ASTM D7647	>80	157				
Particles >21µm	ASTM D7647	>20	^ 30				
Oil Cleanliness	ISO 4406 (c)	>/17/13	2 1/19/14				

Customer Id: PLAVER Sample No.: KCP35050 Lab Number: 05926735 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Fluid			?	Oil and filter change at the time of sampling has been noted.		
Change Filter			?	Oil and filter change at the time of sampling has been noted.		

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

ISO



6281799 (S/N 1202)

Component

Compressor

NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug2023		
SAMPLE INFORMA	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP35050		
Sample Date		Client Info		08 Aug 2023		
	hrs	Client Info		8425		
Oil Age	hrs	Client Info		2500		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
	ppm	ASTM D5185m	>10	0		
	ppm	ASTM D5185m	>3	0		
		ASTM D5185m		<1		
	ppm	ASTM D5185m	>2	0		
	ppm			0		
	ppm	ASTM D5185m	>10	-		
	ppm	ASTM D5185m	>10	0		
	ppm		>50	11		
	ppm	ASTM D5185m	>10	<1		
	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		2		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		3		
·	ppm	ASTM D5185m		0		
	ppm	ASTM D5185m		17703		
	1-1-		15		la ta ka mad	la la taux o
CONTAMINANTS		method	limit/base	current	history1	history2
	ppm	ASTM D5185m	>25	<1		
	ppm	ASTM D5185m		2		
	ppm	ASTM D5185m	>20	2		
	%	ASTM D6304	>0.05	0.006		
ppm Water	ppm	ASTM D6304	>500	69.1		
FLUID CLEANLINE	SS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		13400		
Particles >6µm		ASTM D7647	>1300	<u>▲</u> 3875		
Particles >14µm		ASTM D7647	>80	157		
Particles >21µm		ASTM D7647	>20	△ 30		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/14		
FLUID DEGRADAT	ION	method	limit/base	current	history1	history2
I LOID DEGITADAT	IOIN	method	IIIIII/Dase	Current	HISTORY	HISTORYZ


mg KOH/g ASTM D8045

Acid Number (AN)

0.55



OIL ANALYSIS REPORT

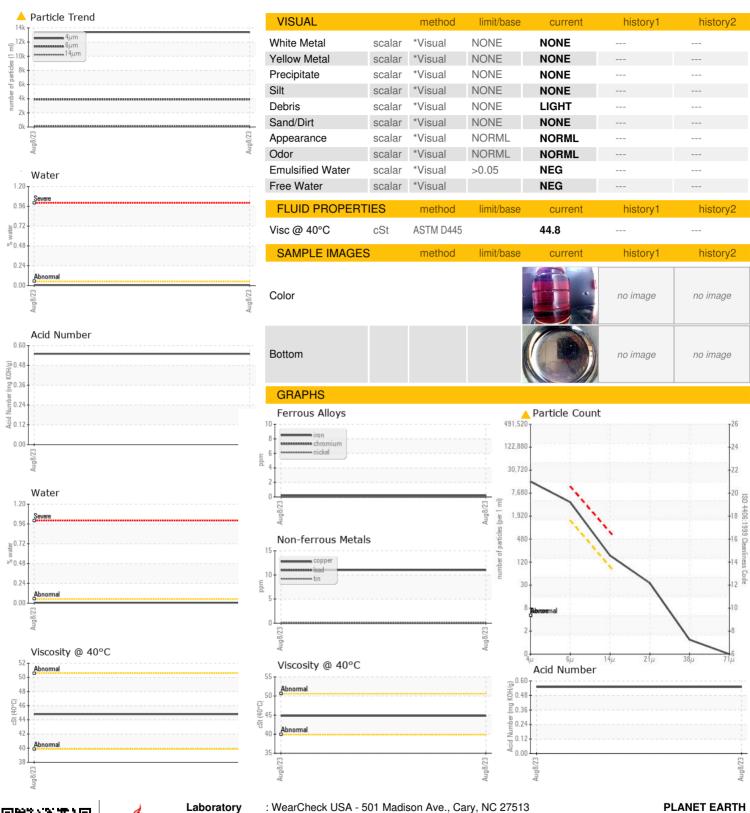



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: KCP35050 : 05926735 : 10606682

Received

: 16 Aug 2023 Diagnosed

: 18 Aug 2023 Diagnostician : Don Baldridge Test Package : IND 2 (Additional Tests: KF, PrtCount)

US 90058

Contact: Service Manager

5300 S BOYLE AVE

VERNON, CA

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) T: F: