

# **PROBLEM SUMMARY**


Paper Machine Refiner #1

Component **Bearing Lube** 

MOBIL SHC 630 (--- GAL)

# Sample Rating Trend ISO

### **COMPONENT CONDITION SUMMARY**

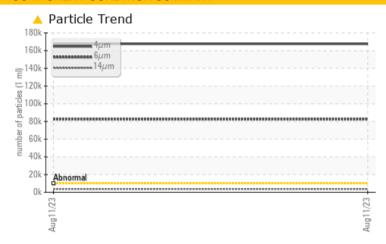

#### RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL						
Particles >4µm	ASTM D7647	>10000	<b>167604</b>						
Particles >6µm	ASTM D7647	>2500	<b>82439</b>						
Particles >14μm	ASTM D7647	>160	<b>△</b> 3640						
Particles >21µm	ASTM D7647	>40	<b>488</b>						
Oil Cleanliness	ISO 4406 (c)	>20/18/14	<b>25/24/19</b>						

Customer Id: CASASH **Sample No.:** WC0776563 Lab Number: 05927241 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS							
Action	Status	Date	Done By	Description			
Change Filter			?	We recommend you service the filters on this component if applicable.			

# HISTORICAL DIAGNOSIS




# **OIL ANALYSIS REPORT**

Paper Machine Refiner #1

**Bearing Lube** 

MOBIL SHC 630 (--- GAL)

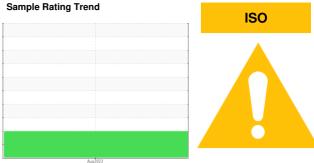

## **DIAGNOSIS**

#### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug 2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0776563		
Sample Date		Client Info		11 Aug 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>120	41		
Chromium	ppm	ASTM D5185m	>5	<1		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>4	<1		
Lead	ppm	ASTM D5185m	>30	2		
Copper	ppm	ASTM D5185m	>17	5		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m		2		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m		469		
Zinc	ppm	ASTM D5185m		2		
Sulfur	ppm	ASTM D5185m		735		
CONTAMINANTS	}	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	13		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.2	0.005		
ppm Water	ppm	ASTM D6304	>2000	51.2		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<u>▲</u> 167604		
Particles >6µm		ASTM D7647	>2500	<u>A</u> 82439		
Particles >14µm		ASTM D7647	>160	<b>▲</b> 3640		
Particles >21µm		ASTM D7647	>40	<b>488</b>		
Particles >38µm		ASTM D7647	>10	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/14	<u>25/24/19</u>		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.42		



## **OIL ANALYSIS REPORT**

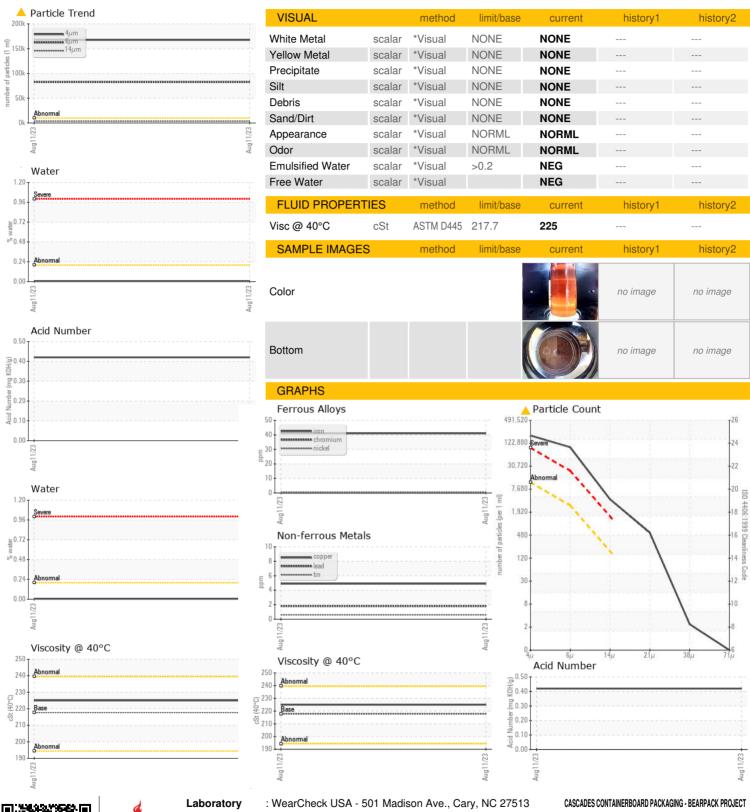



Certificate L2367

Sample No. Lab Number **Unique Number** 

: WC0776563 : 05927241 : 10607188 Test Package : PLANT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Received : 17 Aug 2023 Diagnosed

: 18 Aug 2023 : Don Baldridge Diagnostician

10026 OLD RIDGE ROAD

ASHLAND, VA US 23005

Contact: MARC-ANDRE HUBERT marc-andre hubert@cascades.com

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: