



# PROBLEM SUMMARY

Sample Rating Trend



ISO



Area  
**Paper Machine**  
 Machine Id  
**Vacuum Pump #6 Gearbox**  
 Component  
**Gearbox**  
 Fluid  
**MOBIL MOBILGEAR SHC 220 (35 GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend



## RECOMMENDATION

No corrective action is recommended at this time.  
 Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	---	---
Particles >4µm	ASTM D7647	>20000	▲ 52918	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 23/19/14	---	---

Customer Id: CASASH  
 Sample No.: WC0776544  
 Lab Number: 05927253  
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Area  
**Paper Machine**  
 Machine Id  
**Vacuum Pump #6 Gearbox**  
 Component  
**Gearbox**  
 Fluid  
**MOBIL MOBILGEAR SHC 220 (35 GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 6 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0776544</b>	---	---
Sample Date	Client Info	<b>11 Aug 2023</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---
Oil Age	hrs	Client Info	<b>0</b>	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>200	<b>7</b>	---	---
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	>100	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m	>200	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		<b>19</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>3</b>	---	---
Calcium	ppm	ASTM D5185m		<b>4</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>463</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>2546</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>50	<b>19</b>	---	---
Sodium	ppm	ASTM D5185m		<b>9</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Water	%	ASTM D6304	>0.2	<b>0.008</b>	---	---
ppm Water	ppm	ASTM D6304	>2000	<b>80.6</b>	---	---






## FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>20000	<b>▲ 52918</b>	---	---
Particles >6µm	ASTM D7647	>5000	<b>3215</b>	---	---
Particles >14µm	ASTM D7647	>640	<b>100</b>	---	---
Particles >21µm	ASTM D7647	>160	<b>28</b>	---	---
Particles >38µm	ASTM D7647	>40	<b>4</b>	---	---
Particles >71µm	ASTM D7647	>10	<b>1</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>▲ 23/19/14</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.88</b>	---	---

# OIL ANALYSIS REPORT

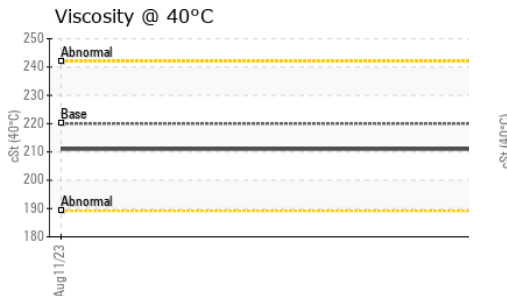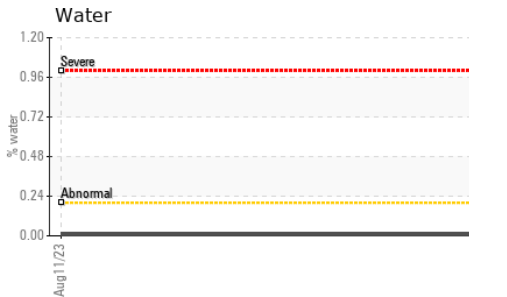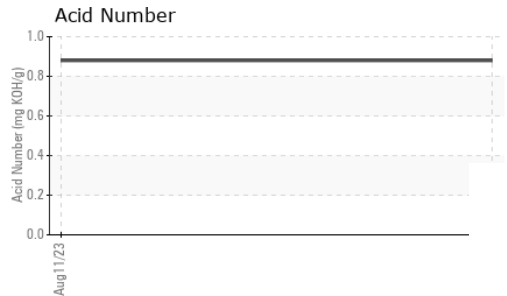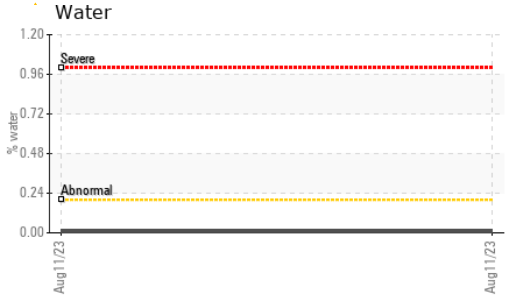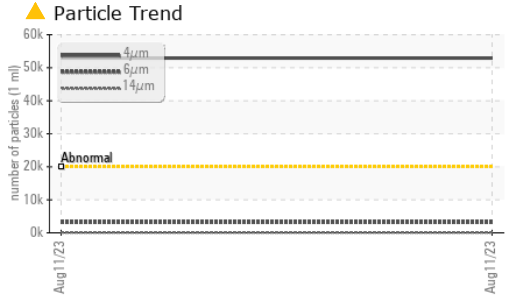





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	LIGHT	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	211	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

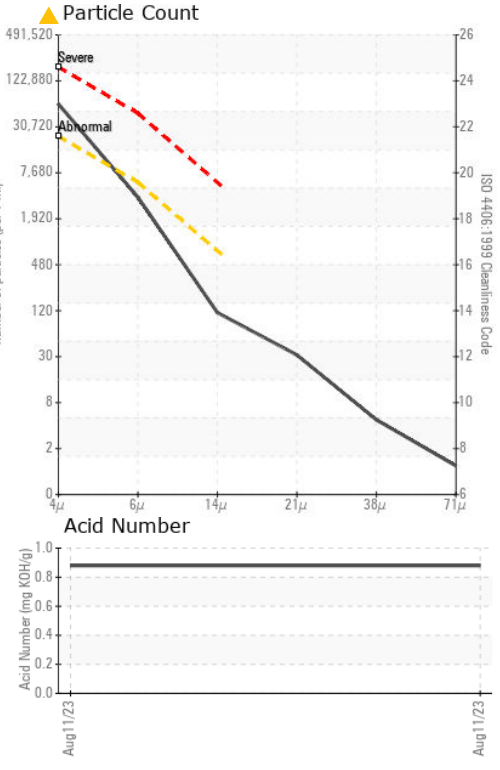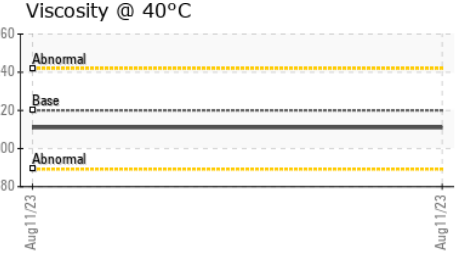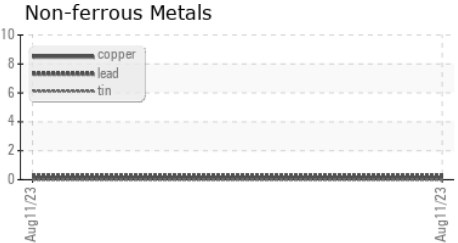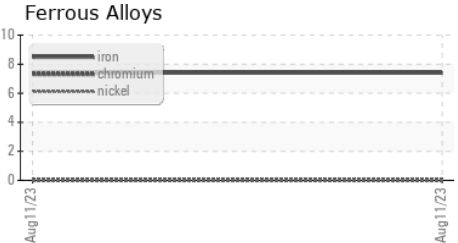

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0776544 **Received** : 17 Aug 2023  
**Lab Number** : 05927253 **Diagnosed** : 18 Aug 2023  
**Unique Number** : 10607200 **Diagnostician** : Doug Bogart  
**Test Package** : PLANT

CASCADES CONTAINERBOARD PACKAGING - BEARPACK PROJECT  
 10026 OLD RIDGE ROAD  
 ASHLAND, VA  
 US 23005  
 Contact: MARC-ANDRE HUBERT  
 marc-andre\_hubert@cascades.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)