




PROBLEM SUMMARY


Area
Paper Machine
 Machine Id
Dry End Lubrication System
 Component
Bearing Lube
 Fluid
MOBIL DTE PM 220 (20000 LTR)

Sample Rating Trend

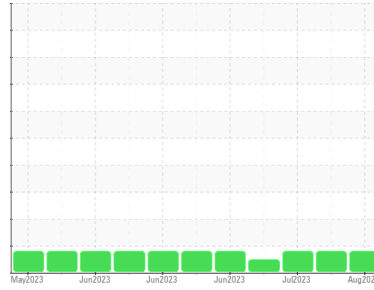

COMPONENT CONDITION SUMMARY

▲ Particle Trend

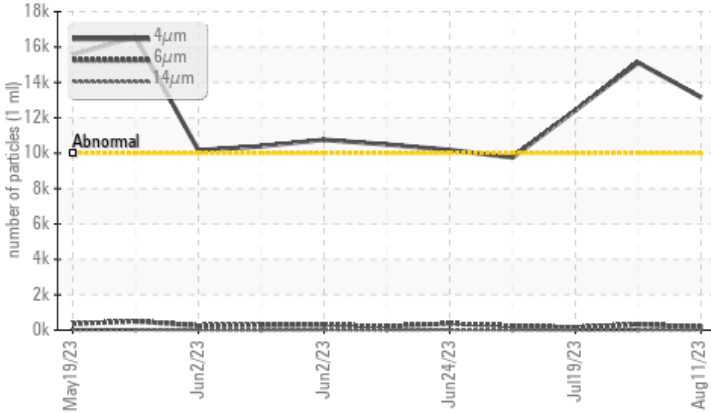

RECOMMENDATION

No corrective action is recommended at this time.
 Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ISO 4406 (c)	ATTENTION	ATTENTION	ATTENTION
Particles >4µm	>10000		▲ 13161	▲ 15114	▲ 12423
Oil Cleanliness		>20/18/14	▲ 21/15/10	▲ 21/16/11	▲ 21/14/10

Customer Id: CASASH
 Sample No.: WC0776551
 Lab Number: 05927255
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

24 Jul 2023 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The water content is negligible. Water confirmed (146ppm/109ppm) The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



19 Jul 2023 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



25 Jun 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

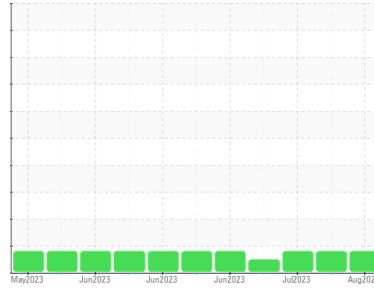

ISO



Area
Paper Machine
 Machine Id
Dry End Lubrication System
 Component
Bearing Lube
 Fluid
MOBIL DTE PM 220 (20000 LTR)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0776551	WC0776568	WC0776628
Sample Date	Client Info		11 Aug 2023	24 Jul 2023	19 Jul 2023
Machine Age	mths	Client Info	0	0	0
Oil Age	mths	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ATTENTION	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >120	30	29	31
Chromium	ppm	ASTM D5185m >5	0	0	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >4	<1	0	<1
Lead	ppm	ASTM D5185m >30	<1	<1	0
Copper	ppm	ASTM D5185m >17	3	3	2
Tin	ppm	ASTM D5185m >10	0	0	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	1	<1
Molybdenum	ppm	ASTM D5185m	<1	<1	<1
Manganese	ppm	ASTM D5185m	1	<1	<1
Magnesium	ppm	ASTM D5185m	7	6	4
Calcium	ppm	ASTM D5185m	126	132	139
Phosphorus	ppm	ASTM D5185m	867	871	937
Zinc	ppm	ASTM D5185m	1105	1112	1276
Sulfur	ppm	ASTM D5185m	14226	13864	16391

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	4	2	2
Sodium	ppm	ASTM D5185m	3	0	2
Potassium	ppm	ASTM D5185m >20	2	1	0
Water	%	ASTM D6304 >0.2	0.008	0.014	0.012
ppm Water	ppm	ASTM D6304 >2000	82.8	145.8	123.0

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 13161	▲ 15114	▲ 12423
Particles >6µm	ASTM D7647	>2500	179	328	146
Particles >14µm	ASTM D7647	>160	10	11	5
Particles >21µm	ASTM D7647	>40	3	2	2
Particles >38µm	ASTM D7647	>10	0	1	1
Particles >71µm	ASTM D7647	>3	0	1	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 21/15/10	▲ 21/16/11	▲ 21/14/10

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.46	1.46	1.55




OIL ANALYSIS REPORT

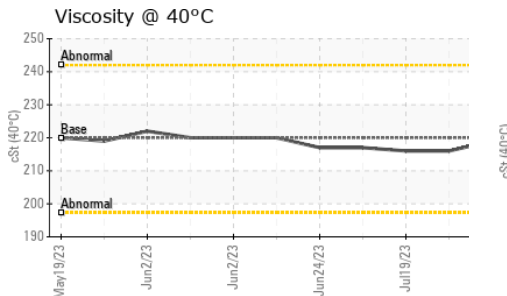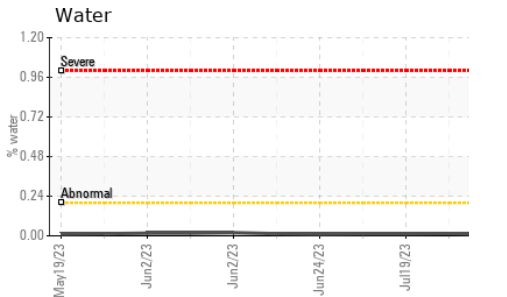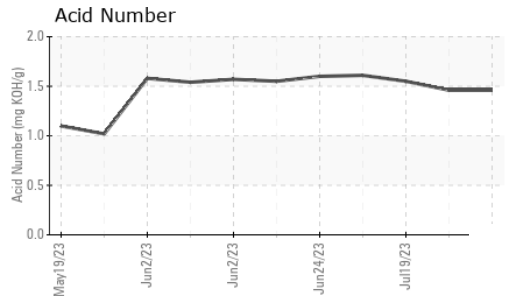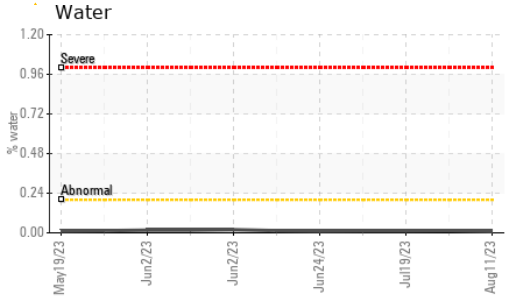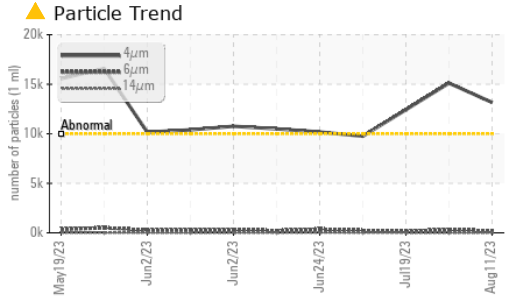






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 220	219	216	216

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

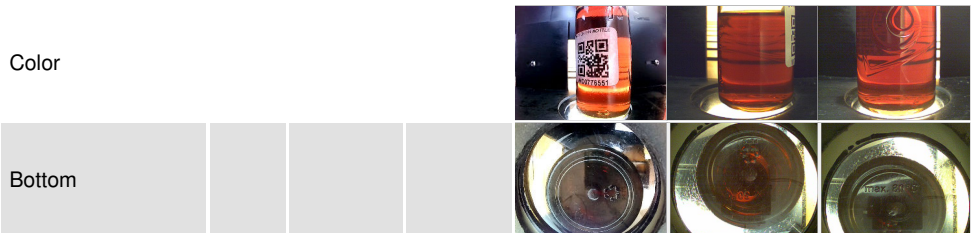

GRAPHS

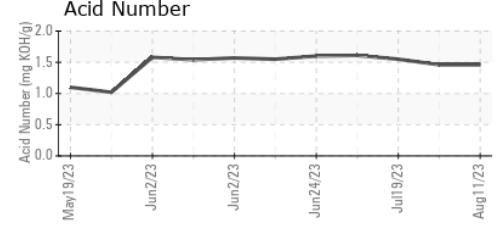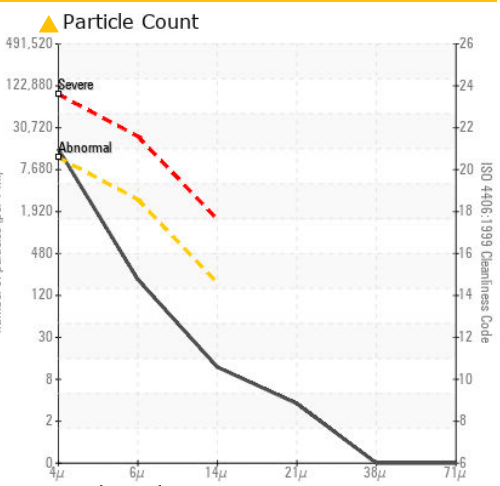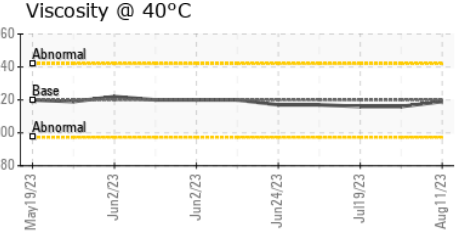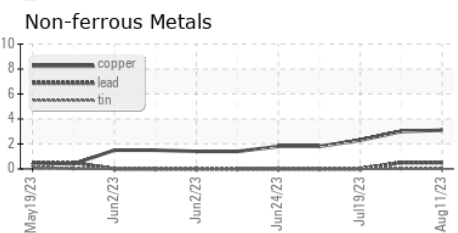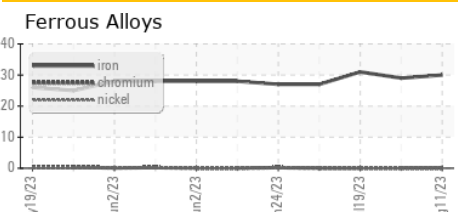

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0776551 **Received** : 17 Aug 2023
Lab Number : 05927255 **Diagnosed** : 18 Aug 2023
Unique Number : 10607202 **Diagnostician** : Doug Bogart
Test Package : PLANT

CASCADES CONTAINERBOARD PACKAGING - BEARPACK PROJECT
 10026 OLD RIDGE ROAD
 ASHLAND, VA
 US 23005
 Contact: MARC-ANDRE HUBERT
 marc-andre_hubert@cascades.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)