




PROBLEM SUMMARY

Sample Rating Trend


ISO

Area
Effluent Treatment Plant
 Machine Id
Sludge Screw Press #2 Gearbox
 Component
Gearbox
 Fluid
MOBIL MOBILGEAR SHC 320 (225 GAL)

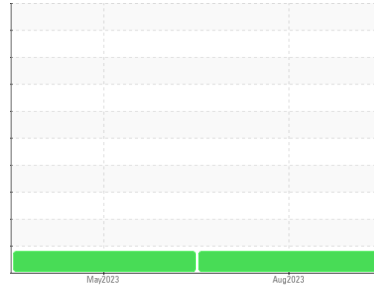

COMPONENT CONDITION SUMMARY

▲ Particle Trend

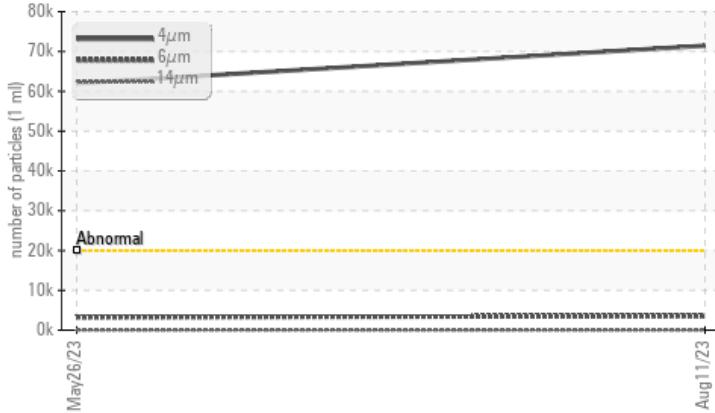

RECOMMENDATION

No corrective action is recommended at this time.
 Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ABNORMAL	---
Particles >4µm	ASTM D7647 >20000	▲ 71448	▲ 62002	---
Oil Cleanliness	ISO 4406 (c) >21/19/16	▲ 23/19/13	▲ 23/19/13	---

Customer Id: CASASH
 Sample No.: WC0776602
 Lab Number: 05927257
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

26 May 2023 Diag: Wes Davis

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

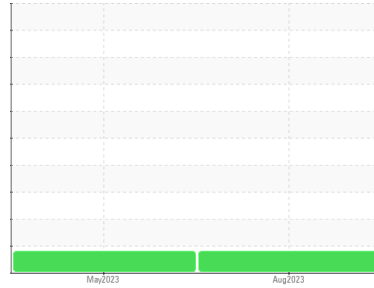

ISO



Area
Effluent Treatment Plant
 Machine Id
Sludge Screw Press #2 Gearbox
 Component
Gearbox
 Fluid
MOBIL MOBILGEAR SHC 320 (225 GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0776602	WC0776633	---
Sample Date	Client Info			11 Aug 2023	26 May 2023	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	14	14	---
Chromium	ppm	ASTM D5185m	>15	<1	0	---
Nickel	ppm	ASTM D5185m	>15	0	0	---
Titanium	ppm	ASTM D5185m		<1	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	<1	0	---
Lead	ppm	ASTM D5185m	>100	<1	0	---
Copper	ppm	ASTM D5185m	>200	<1	<1	---
Tin	ppm	ASTM D5185m	>25	0	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	<1	---
Molybdenum	ppm	ASTM D5185m		<1	<1	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m		2	<1	---
Calcium	ppm	ASTM D5185m		0	0	---
Phosphorus	ppm	ASTM D5185m		457	427	---
Zinc	ppm	ASTM D5185m		0	0	---
Sulfur	ppm	ASTM D5185m		2850	3014	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	20	21	---
Sodium	ppm	ASTM D5185m		<1	0	---
Potassium	ppm	ASTM D5185m	>20	2	<1	---
Water	%	ASTM D6304	>0.2	0.003	0.010	---
ppm Water	ppm	ASTM D6304	>2000	35.3	103.8	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	▲ 71448	▲ 62002	---
Particles >6µm		ASTM D7647	>5000	3538	3245	---
Particles >14µm		ASTM D7647	>640	56	61	---
Particles >21µm		ASTM D7647	>160	10	9	---
Particles >38µm		ASTM D7647	>40	1	1	---
Particles >71µm		ASTM D7647	>10	0	1	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	▲ 23/19/13	▲ 23/19/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.96	1.00	---



OIL ANALYSIS REPORT

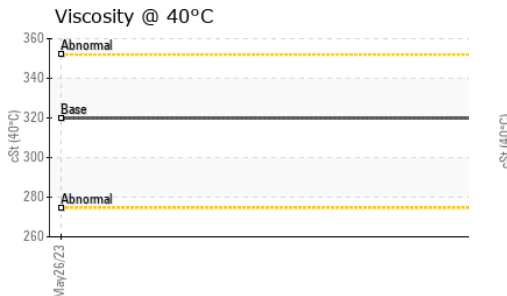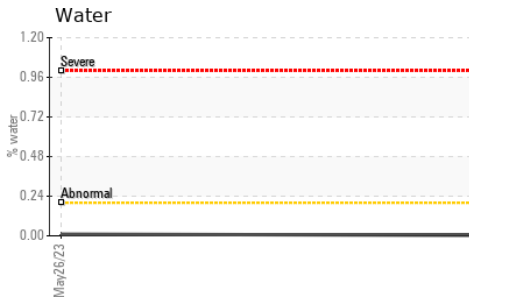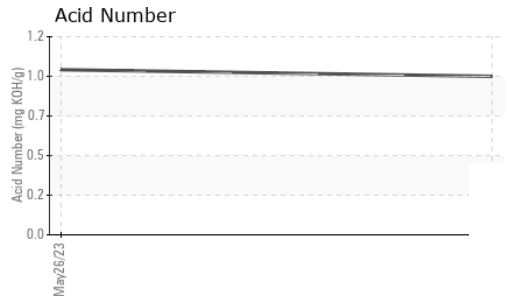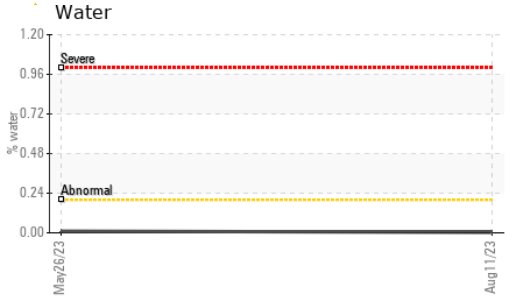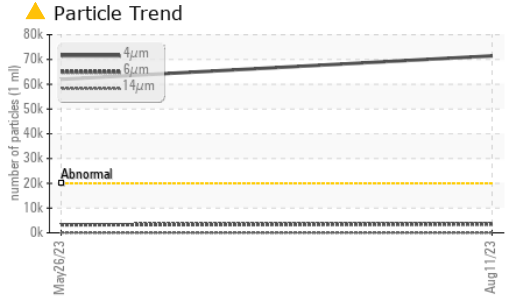






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	320	---

SAMPLE IMAGES

method	limit/base	current	history1	history2	
Color					no image
Bottom					no image

GRAPHS

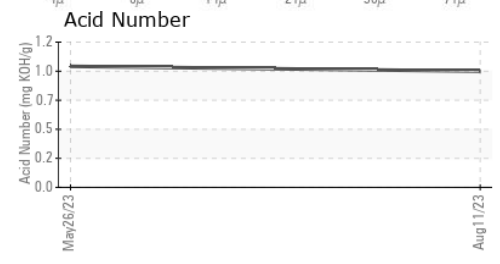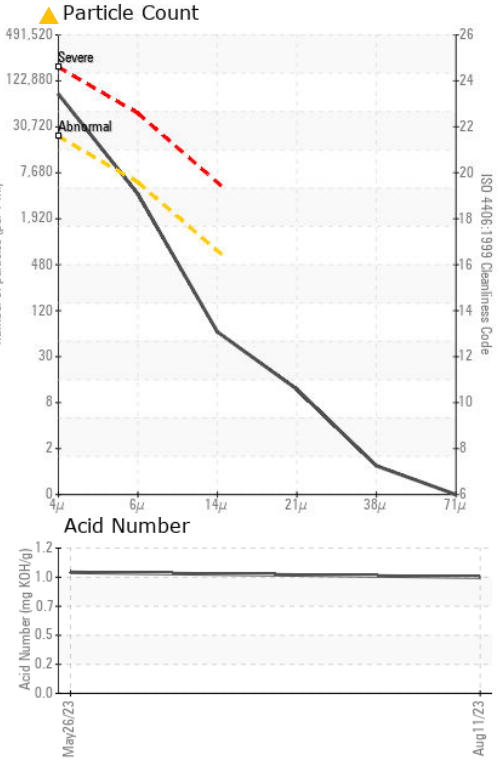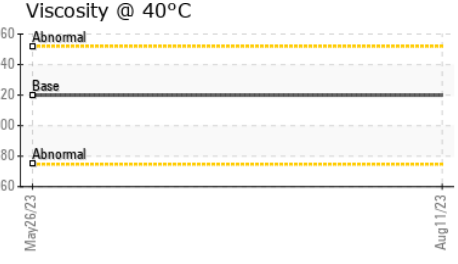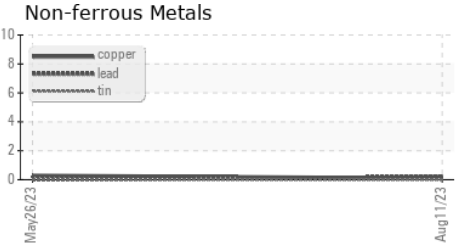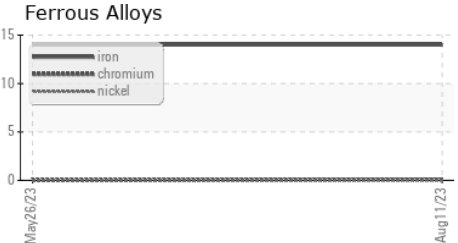

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0776602 **Received** : 17 Aug 2023
Lab Number : 05927257 **Diagnosed** : 18 Aug 2023
Unique Number : 10607204 **Diagnostician** : Doug Bogart
Test Package : PLANT

CASCADES CONTAINERBOARD PACKAGING - BEARPACK PROJECT
 10026 OLD RIDGE ROAD
 ASHLAND, VA
 US 23005
 Contact: MARC-ANDRE HUBERT
 marc-andre_hubert@cascades.com
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)