




PROBLEM SUMMARY

Sample Rating Trend

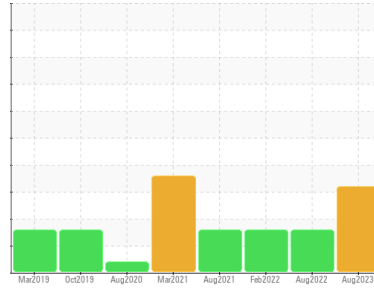

WATER




Machine Id
KAESER SK 15 5845403 (S/N 1020)

Component
Compressor


Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Water

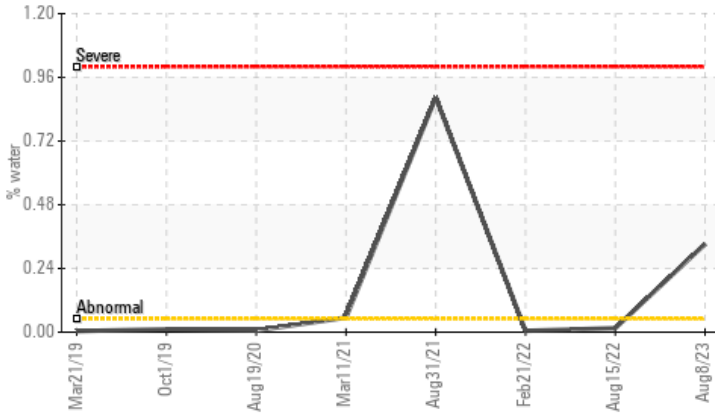

▲ Particle Trend

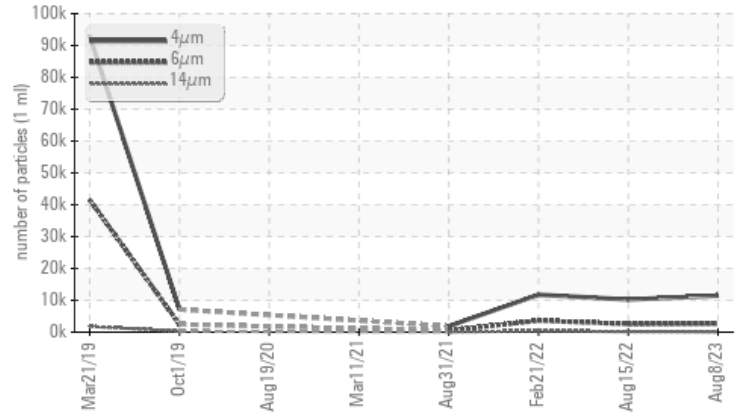

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.05	▲ 0.332	0.015	0.005
ppm Water	ppm	ASTM D6304	>500	▲ 3320	154.7	55.0
Particles >6µm		ASTM D7647	>1300	▲ 2694	▲ 2535	▲ 3615
Particles >14µm		ASTM D7647	>80	▲ 102	▲ 142	▲ 369
Particles >21µm		ASTM D7647	>20	▲ 23	▲ 34	▲ 93
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/19/14	▲ 21/19/14	▲ 19/16

Customer Id: TRAROCTX
Sample No.: KCPA005673
Lab Number: 05927259
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

15 Aug 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



21 Feb 2022 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



31 Aug 2021 Diag: Don Baldrige

WATER




We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a high concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

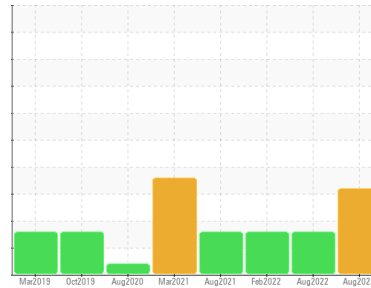

WATER



Machine Id
KAESER SK 15 5845403 (S/N 1020)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA005673	KCP50529	KCP41185
Sample Date	Client Info		08 Aug 2023	15 Aug 2022	21 Feb 2022
Machine Age	hrs	Client Info	35559	32262	30757
Oil Age	hrs	Client Info	0	1504	0
Oil Changed	Client Info		N/A	Not Changd	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	2	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	<1	<1
Aluminum	ppm	ASTM D5185m >10	<1	2	2
Lead	ppm	ASTM D5185m >10	<1	0	<1
Copper	ppm	ASTM D5185m >50	10	6	15
Tin	ppm	ASTM D5185m >10	0	<1	<1
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	<1	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 90	11	21	0
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	5	14	8
Zinc	ppm	ASTM D5185m	34	29	0
Sulfur	ppm	ASTM D5185m	20714	18388	15854

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	2	4	0
Potassium	ppm	ASTM D5185m >20	2	0	<1
Water	%	ASTM D6304 >0.05	▲ 0.332	0.015	0.005
ppm Water	ppm	ASTM D6304 >500	▲ 3320	154.7	55.0






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		11466	10235	11754
Particles >6µm	ASTM D7647 >1300		▲ 2694	▲ 2535	▲ 3615
Particles >14µm	ASTM D7647 >80		▲ 102	▲ 142	▲ 369
Particles >21µm	ASTM D7647 >20		▲ 23	▲ 34	▲ 93
Particles >38µm	ASTM D7647 >4		1	1	▲ 11
Particles >71µm	ASTM D7647 >3		0	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 21/19/14	▲ 21/19/14	▲ 19/16

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.31	0.22	0.35

OIL ANALYSIS REPORT

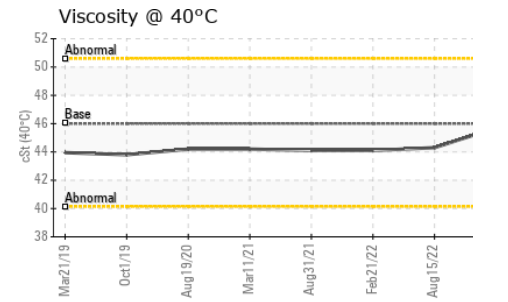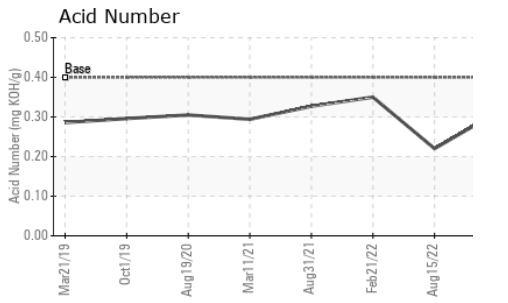
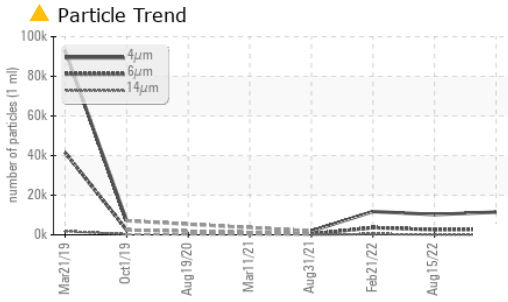
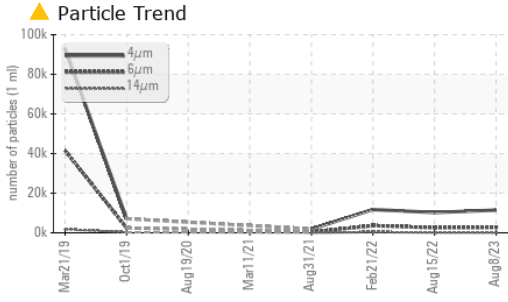
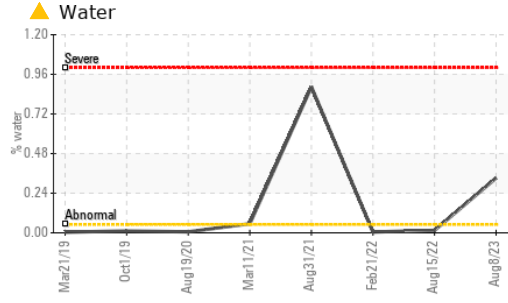


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.7	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

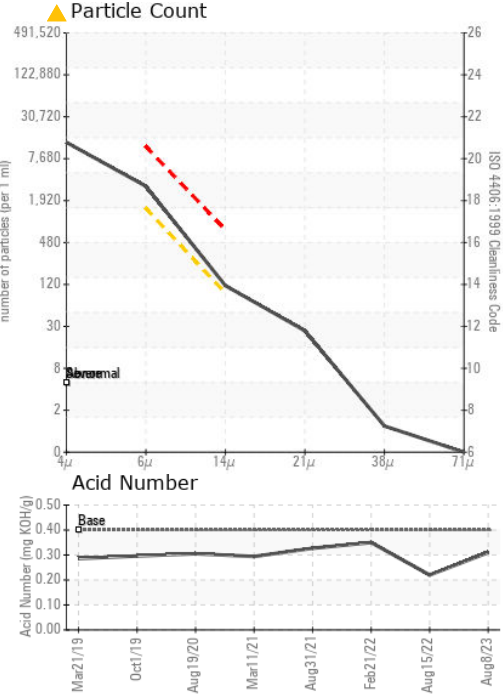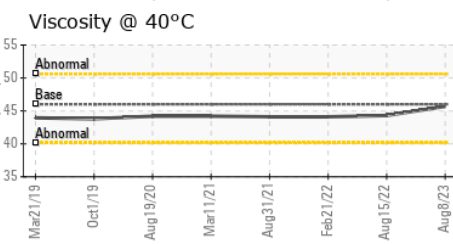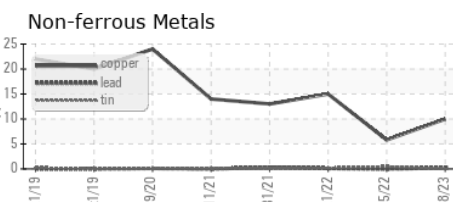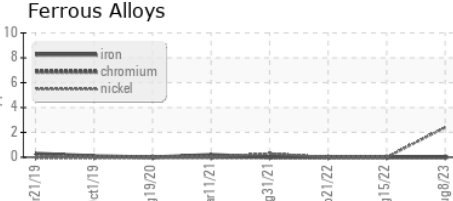

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA005673 **Received** : 17 Aug 2023
Lab Number : 05927259 **Diagnosed** : 22 Aug 2023
Unique Number : 10607206 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

TRANSAM TRUCKING
 2670 GOLIAD ST
 ROCKWALL, TX
 US 75032
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: