


PROBLEM SUMMARY

Sample Rating Trend




ISO

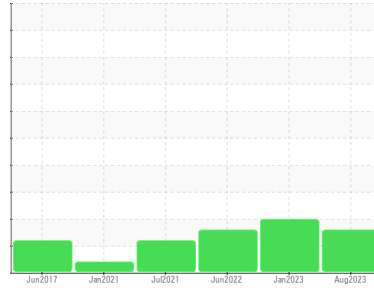

Machine Id
KAESER AS 20T 2636516 (S/N 1141)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

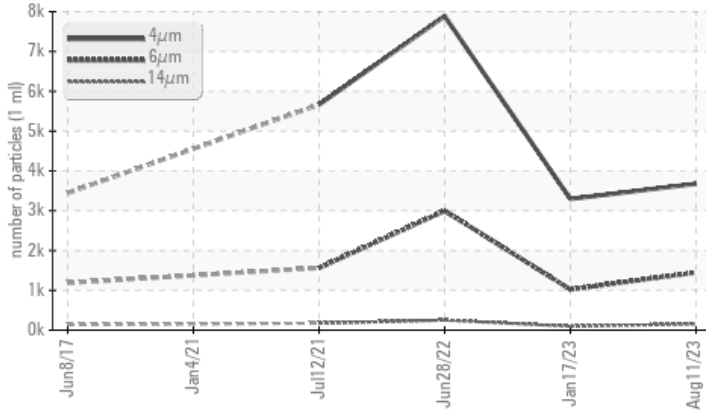

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ATTENTION	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 1448	1021	▲ 2997
Particles >14µm	ASTM D7647	>80	▲ 154	▲ 95	▲ 252
Particles >21µm	ASTM D7647	>20	▲ 45	▲ 33	▲ 60
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/18/14	▲ 19/17/14	▲ 20/19/15

Customer Id: MORGAR
Sample No.: KCPA002943
Lab Number: 05927272
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

17 Jan 2023 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



28 Jun 2022 Diag: Don Baldrige

ISO



The oil change at the time of sampling has been noted. We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



12 Jul 2021 Diag: Jonathan Hester

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

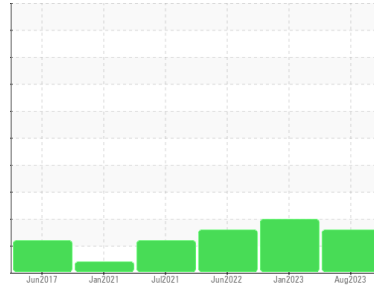

ISO



Machine Id
KAESER AS 20T 2636516 (S/N 1141)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA002943	KCP52891	KCP51993
Sample Date	Client Info		11 Aug 2023	17 Jan 2023	28 Jun 2022
Machine Age	hrs	Client Info	66066	63657	61141
Oil Age	hrs	Client Info	0	0	2320
Oil Changed	Client Info		N/A	Changed	Changed
Sample Status			ATTENTION	ATTENTION	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	0	<1
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	3	2	2
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	0	1	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 100	37	32	42
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 0	4	36	7
Zinc	ppm	ASTM D5185m 0	19	16	31
Sulfur	ppm	ASTM D5185m 23500	23136	20123	21962

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	0
Sodium	ppm	ASTM D5185m	12	7	13
Potassium	ppm	ASTM D5185m >20	3	0	<1
Water	%	ASTM D6304 >0.05	0.014	0.014	0.020
ppm Water	ppm	ASTM D6304 >500	143.6	148.3	202.1






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		3676	3296	7887
Particles >6µm	ASTM D7647	>1300	▲ 1448	1021	▲ 2997
Particles >14µm	ASTM D7647	>80	▲ 154	▲ 95	▲ 252
Particles >21µm	ASTM D7647	>20	▲ 45	▲ 33	▲ 60
Particles >38µm	ASTM D7647	>4	2	▲ 9	2
Particles >71µm	ASTM D7647	>3	0	▲ 6	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/18/14	▲ 19/17/14	▲ 20/19/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.36	0.38	0.32

OIL ANALYSIS REPORT

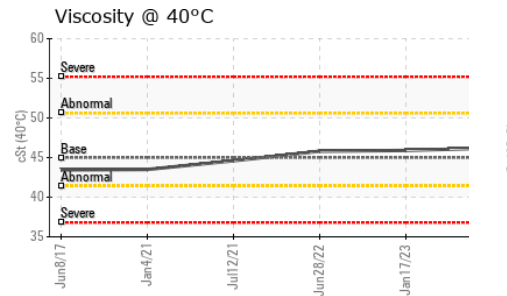
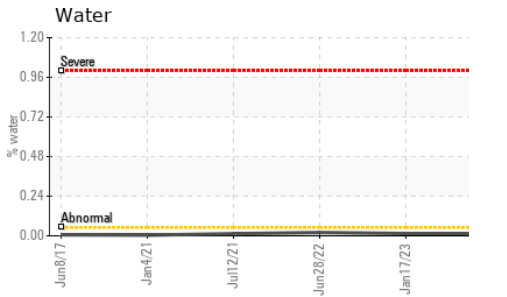
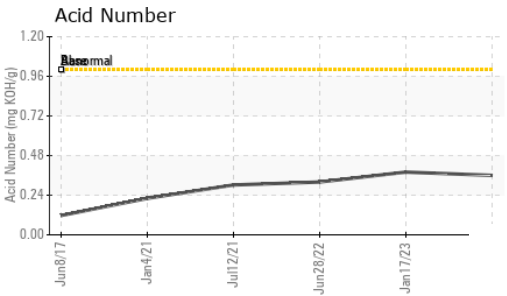
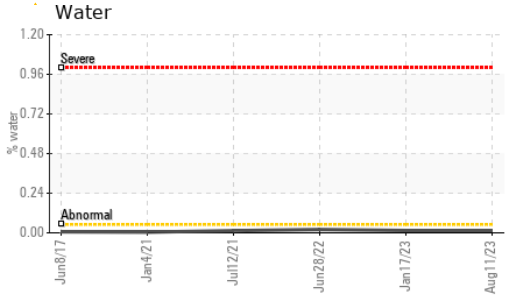
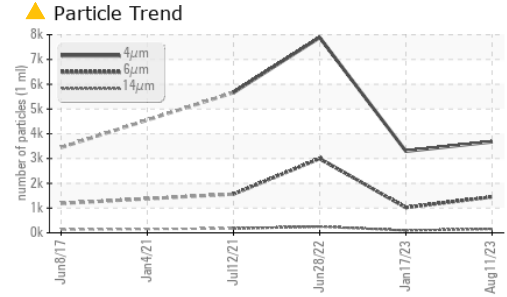


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.2	45.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

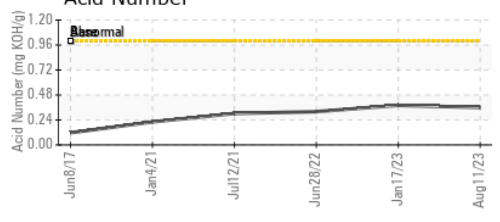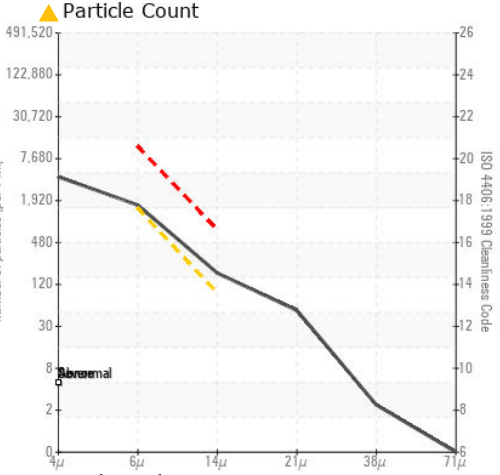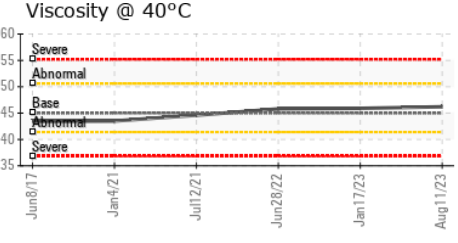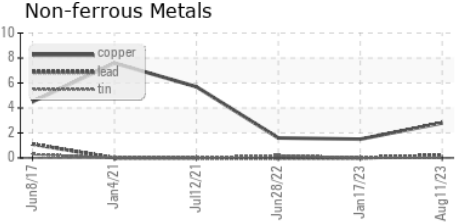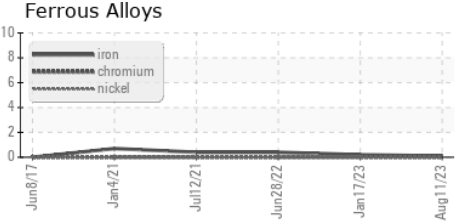

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA002943 **Received** : 17 Aug 2023
Lab Number : 05927272 **Diagnosed** : 18 Aug 2023
Unique Number : 10607219 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MORGAN CABINETRY
 2775 W KINGSLEY RD
 GARLAND, TX
 US 75041
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: