




KAESER 7858364

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

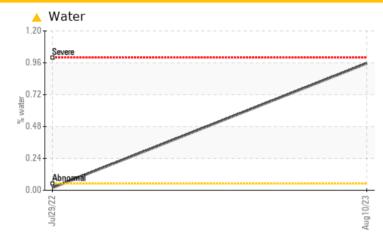

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

| PROBLEMATIC TEST RESULTS | | | | | | | | | |
|--------------------------|--------|------------|-------|----------------|----------|--|--|--|--|
| Sample Status | | | | ABNORMAL | ABNORMAL | | | | |
| Water | % | ASTM D6304 | >0.05 | A 0.955 | 0.018 | | | | |
| ppm Water | ppm | ASTM D6304 | >500 | A 9550 | 183.6 | | | | |
| Appearance | scalar | *Visual | NORML | 🔺 HAZY | NORML | | | | |


Customer Id: AMACOM Sample No.: KCPA003842 Lab Number: 05927274 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 <u>dougb@wearcheckusa.com</u>

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

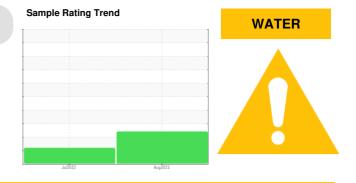

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

29 Jul 2022 Diag: Angela Borella



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.





OIL ANALYSIS REPORT

Sample Rating Trend

WATER

Machine Id KAESER 7858364 Component

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition


The AN level is acceptable for this fluid.


| | | | Jui2022 | Aug ² 023 | | |
|------------------|---------------|--------------|------------|----------------------|---------------|----------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | KCPA003842 | KCP50198 | |
| Sample Date | | Client Info | | 10 Aug 2023 | 29 Jul 2022 | |
| Machine Age | hrs | Client Info | | 2006 | 955 | |
| Oil Age | hrs | Client Info | | 0 | 955 | |
| Oil Changed | | Client Info | | N/A | Changed | |
| Sample Status | | | | ABNORMAL | ABNORMAL | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | <1 | <1 | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | 0 | |
| Titanium | ppm | ASTM D5185m | >3 | <1 | 0 | |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | <1 | |
| Lead | ppm | ASTM D5185m | >10 | <1 | <1 | |
| Copper | ppm | ASTM D5185m | >50 | 3 | 2 | |
| Tin | ppm | ASTM D5185m | >10 | 0 | <1 | |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 0 | 0 | 0 | |
| Barium | ppm | ASTM D5185m | 90 | 0 | 0 | |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 | |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | |
| Magnesium | ppm | ASTM D5185m | 100 | 45 | 52 | |
| Calcium | ppm | ASTM D5185m | 0 | 2 | 0 | |
| Phosphorus | ppm | ASTM D5185m | 0 | 6 | <1 | |
| Zinc | ppm | ASTM D5185m | 0 | 9 | 5 | |
| Sulfur | ppm | ASTM D5185m | 23500 | 21535 | 17973 | |
| CONTAMINANTS | 6 | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 2 | <1 | |
| Sodium | ppm | ASTM D5185m | | 5 | 9 | |
| Potassium | ppm | ASTM D5185m | >20 | 2 | 2 | |
| Water | % | ASTM D6304 | | A 0.955 | 0.018 | |
| ppm Water | ppm | ASTM D6304 | | 4 9550 | 183.6 | |
| FLUID CLEANLIN | IESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 2305 | 19389 | |
| Particles >6µm | | ASTM D7647 | >1300 | 746 | 4 9313 | |
| Particles >14μm | | ASTM D7647 | >80 | 52 | A 287 | |
| Particles >21µm | | ASTM D7647 | >20 | 10 | 13 | |
| Particles >38µm | | ASTM D7647 | >4 | 2 | 4 | |
| Particles >71µm | | ASTM D7647 | >3 | 1 | 2 | |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | 18/17/13 | ▲ 21/20/15 | |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 1.0 | 0.37 | 0.37 | |
| | iliy KO⊓/ŷ | AG HVI DOU40 | 1.0 | 0.37 | 0.57 | |



Built for a lifetime


OIL ANALYSIS REPORT











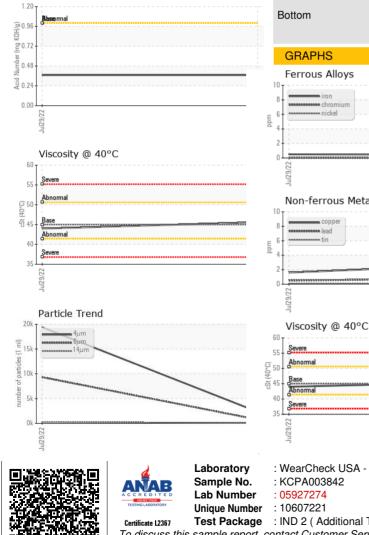

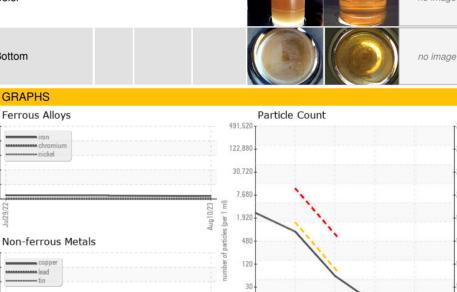

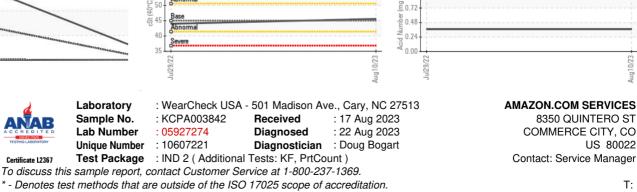

(B/H0) MOX 0.96

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

US 80022

4406

:1999 Cle

14

214

Acid Number

28