

PROBLEM SUMMARY

Sample Rating Trend




Machine Id **6721150 (S/N 1237)**

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

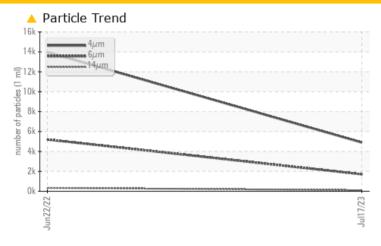

RECOMMENDATION

No corrective action is recommended at this time. Filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ATTENTION	ABNORMAL					
Particles >6µm	ASTM D7647	>1300	1706	▲ 5196					
Particles >14µm	ASTM D7647	>80	104	▲ 340					
Particles >21µm	ASTM D7647	>20	27	△ 39					
Oil Cleanliness	ISO 4406 (c)	>17/13	18/14	<u>^</u> 20/16					

Customer Id: INTGRA Sample No.: KCPA003239 Lab Number: 05927277 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS							
Action	Status	Date	Done By	Description			
Change Fluid			?	Oil and filter change at the time of sampling has been noted.			
Change Filter			?	Oil and filter change at the time of sampling has been noted.			

HISTORICAL DIAGNOSIS

22 Jun 2022 Diag: Jonathan Hester





Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






OIL ANALYSIS REPORT

6721150 (S/N 1237)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)





DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jun2022	Jul2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA003239	KC97344	
Sample Date		Client Info		17 Jul 2023	22 Jun 2022	
Machine Age	hrs	Client Info		14298	10663	
Oil Age	hrs	Client Info		0	3000	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	<1	1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	4	10	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	2	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	100	3	5	
Calcium	ppm	ASTM D5185m	0	0	<1	
Phosphorus	ppm	ASTM D5185m	0	3	19	
Zinc	ppm	ASTM D5185m	0	0	12	
Sulfur	ppm	ASTM D5185m	23500	23301	18604	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m		1	1	
Potassium	ppm	ASTM D5185m	>20	<1	0	
Water	%	ASTM D6304	>0.05	0.003	0.004	
ppm Water	ppm	ASTM D6304	>500	33.4	45.8	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4896	13966	
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u></u> 5196	
Particles >14μm		ASTM D7647	>80	104	▲ 340	
Particles >21µm		ASTM D7647	>20	<u> </u>	△ 39	
Particles >38μm		ASTM D7647	>4	2	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>17/13	▲ 18/14	<u>^</u> 20/16	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.40	0.45	



OIL ANALYSIS REPORT

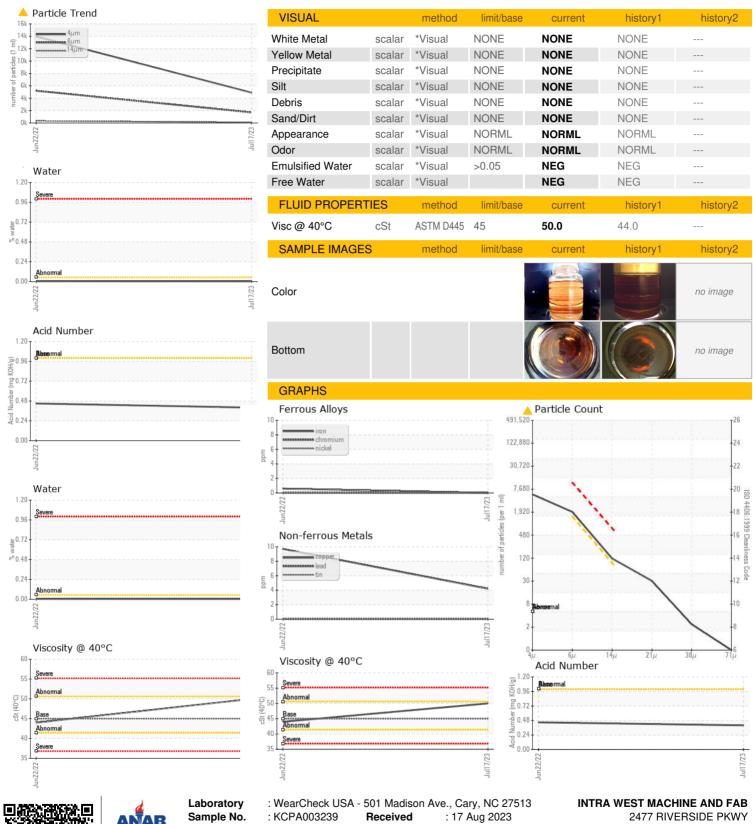





Certificate L2367

Sample No. Lab Number **Unique Number**

: 05927277 : 10607224

Received : KCPA003239 Diagnosed

: 18 Aug 2023

Diagnostician : Doug Bogart Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

2477 RIVERSIDE PKWY

GRAND JUNCTION, CO US 81505

Contact: Service Manager

T: F: