


OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id MLU-3 Component **Inboard Pump**

ROYAL PURPLE SYNFILM GT 32 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

)						
		,	Apr2023	Jul2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0032072	RP0027410	
Sample Date		Client Info		31 Jul 2023	13 Apr 2023	
Machine Age	hrs	Client Info		0	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	0	0	
Chromium	ppm	ASTM D5185m	>5	0	0	
Nickel	ppm	ASTM D5185m	>5	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>3	0	0	
Aluminum	ppm	ASTM D5185m	>7	<1	<1	
Lead	ppm	ASTM D5185m	>12	<1	0	
Copper	ppm	ASTM D5185m	>30	2	<1	
Tin	ppm	ASTM D5185m	>9	4	8	
Vanadium	ppm	ASTM D5185m		<1	<1	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m		83	85	
Calcium	ppm	ASTM D5185m		2	0	
Phosphorus	ppm	ASTM D5185m		3	0	
Zinc	ppm	ASTM D5185m		0	0	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	<1	<1	
Sodium	ppm	ASTM D5185m		2	0	
Potassium	ppm	ASTM D5185m	>20	1	0	
Water	%	ASTM D6304		0.021	0.020	
ppm Water	ppm	ASTM D6304	>.1	210.3	205.5	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.34	0.36	
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	LIGHT	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual		NEG	NEG	
1 Free Water	scalar	*Visual		NEG	SerwitedManage	er - ENELONRP



OIL ANALYSIS REPORT

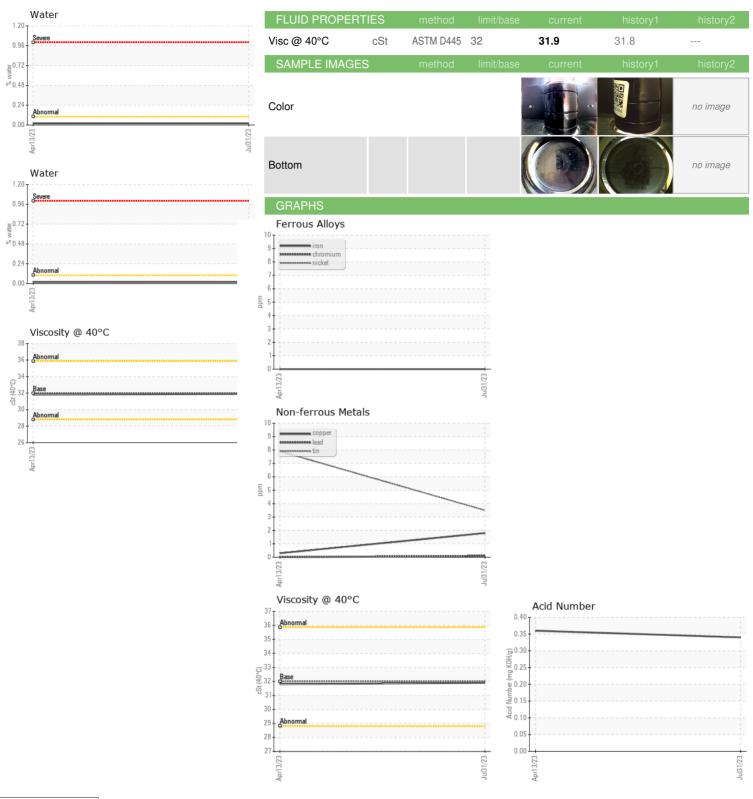





Laboratory Sample No. Lab Number Unique Number : 10607275 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : 05927328

: RP0032072

Received : 17 Aug 2023 Diagnosed : 21 Aug 2023 Diagnostician : Jonathan Hester **ENERGY TRANSFER - LONGVIEW** 1010 COX DIARY RD

LONGVIEW, TX US 75601

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: