




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

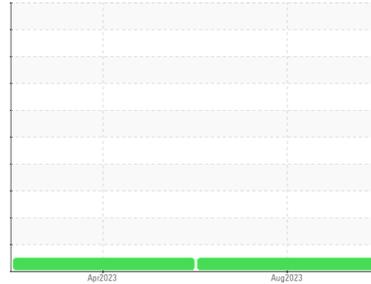

Machine Id  
**MLU-1**

Component  
**Lube System**

Fluid  
**CHEVRON REGAL OIL R&O 32 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0032141</b>	RP0033397	---
Sample Date	Client Info			<b>01 Aug 2023</b>	18 Apr 2023	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	---
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Aluminum	ppm	ASTM D5185m	>20	<b>1</b>	<1	---
Lead	ppm	ASTM D5185m	>20	<b>2</b>	0	---
Copper	ppm	ASTM D5185m	>20	<b>19</b>	18	---
Tin	ppm	ASTM D5185m	>20	<b>6</b>	2	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>3</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m		<b>2</b>	2	---
Calcium	ppm	ASTM D5185m		<b>37</b>	32	---
Phosphorus	ppm	ASTM D5185m		<b>237</b>	232	---
Zinc	ppm	ASTM D5185m		<b>293</b>	285	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m		<b>1</b>	2	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Water	%	ASTM D6304	>0.05	<b>0.003</b>	0.003	---
ppm Water	ppm	ASTM D6304	>500	<b>39.5</b>	34.6	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.25</b>	0.22	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

# OIL ANALYSIS REPORT

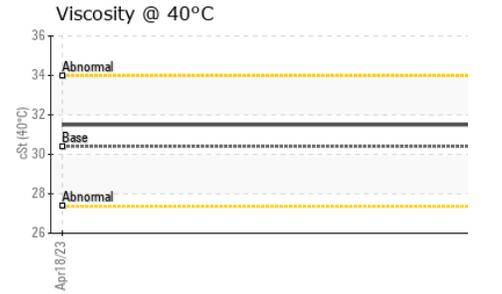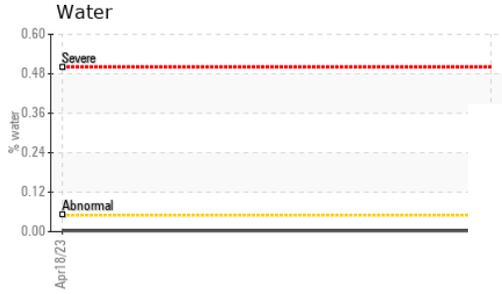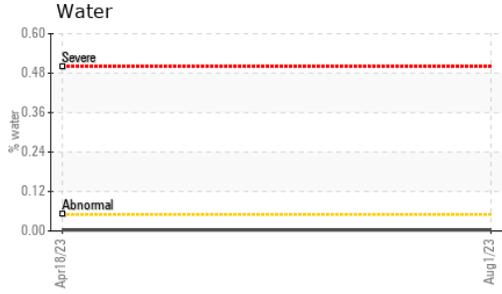





## FLUID PROPERTIES

method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445	30.4	31.5	---

## SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				no image
Bottom				no image

## GRAPHS

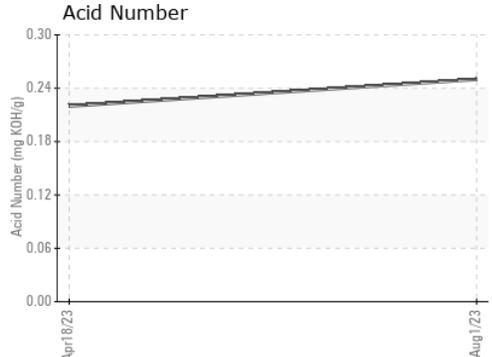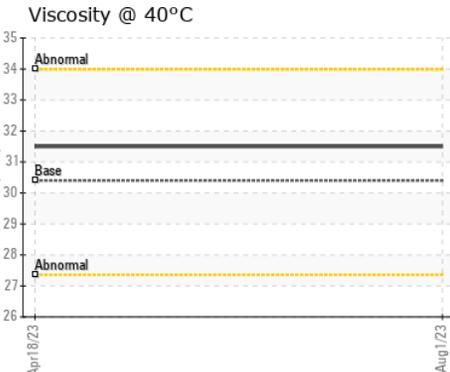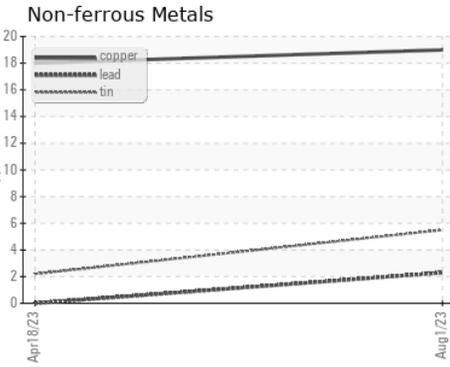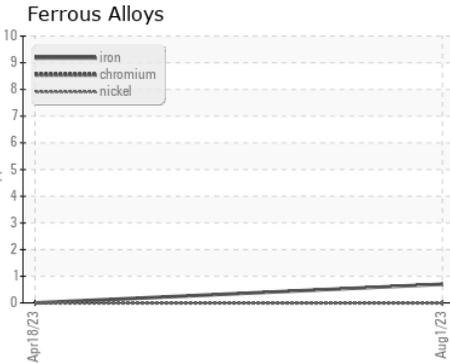

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0032141 **Received** : 17 Aug 2023  
**Lab Number** : 05927338 **Diagnosed** : 21 Aug 2023  
**Unique Number** : 10607285 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**ENERGY TRANSFER - SPEARVILLE**  
 126 FIRE TOWER RD  
 SPEARVILLE, LA  
 US 71277  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: