


OIL ANALYSIS REPORT

TECHTROL GOLD Machine Id INGERSOLL RAND 1 - BECTON DICKINSON (S/N M90-5538)

Component

Compressor





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jul2023		
OAMBLE INCOM	4471011					
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05927362		
Sample Date		Client Info		25 Jul 2023		
Machine Age	hrs	Client Info		80492		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		2		
ADDITIVEC		and the section	12 21 /1		In the Landson of	h'-t0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		376		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		6		
Calcium	ppm	ASTM D5185m		9		
Phosphorus	ppm	ASTM D5185m		61		
Zinc	ppm	ASTM D5185m		7		
Sulfur	ppm	ASTM D5185m		291		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.10	0.15		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		



OIL ANALYSIS REPORT

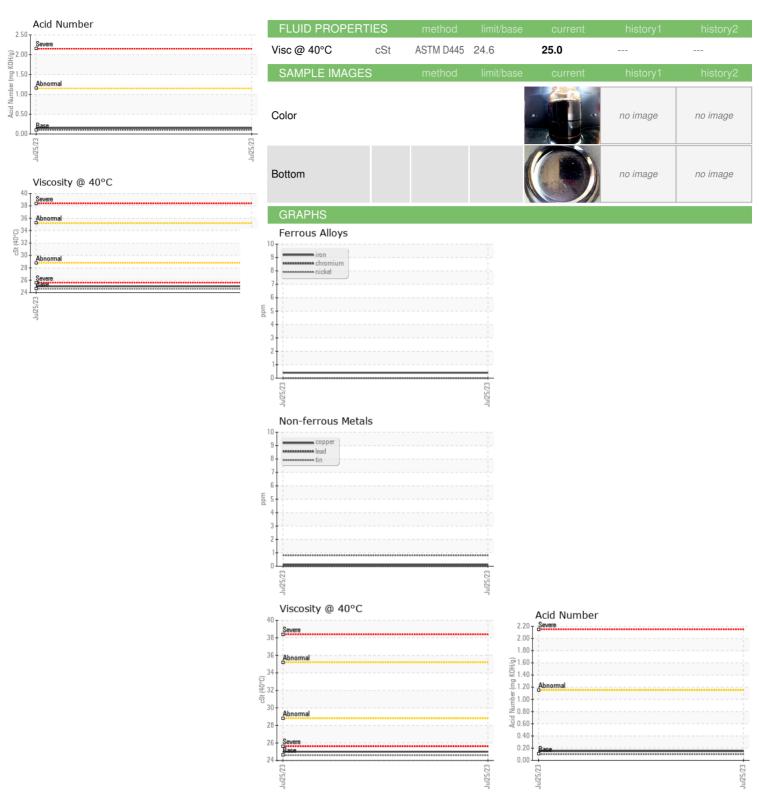





Laboratory Sample No. Lab Number

Unique Number : 10607309 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH05927362 : 05927362

Received : 17 Aug 2023 Diagnosed : 21 Aug 2023 Diagnostician : Jonathan Hester

CHARLOTTE, NC US 28217 Contact: SCOTT MITCHELL

PFME - COMPESSED AIR AND GAS SYSTEMS SPECIALISTS

SMITCHELL@PFM-ENG.COM T:

1615 CROSS BEAM DR

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Report Id: UCPFMCHA [WUSCAR] 05927362 (Generated: 08/21/2023 15:43:46) Rev: 1

Contact/Location: SCOTT MITCHELL - UCPFMCHA

F: