




OIL ANALYSIS REPORT

Sample Rating Trend

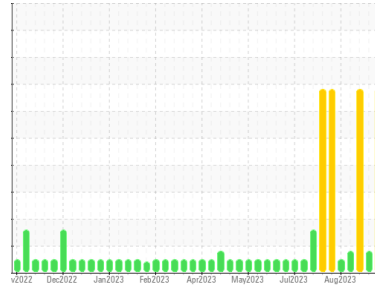

WEAR



Machine Id
CATERPILLAR GM02
 Component
Biogas Engine
 Fluid
Q8 G5 MAHLER 40 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

The iron level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0836324	WC0836322	WC0836320
Sample Date	Client Info		15 Aug 2023	14 Aug 2023	13 Aug 2023
Machine Age	hrs	Client Info	64611	64565	64500
Oil Age	hrs	Client Info	107	61	85
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	ABNORMAL	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >45	83	75	121
Chromium	ppm	ASTM D5185m >2	2	<1	2
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >5	0	0	0
Aluminum	ppm	ASTM D5185m >10	3	1	2
Lead	ppm	ASTM D5185m >5	<1	0	0
Copper	ppm	ASTM D5185m >14	2	0	<1
Tin	ppm	ASTM D5185m >13	<1	0	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	1	<1	1
Magnesium	ppm	ASTM D5185m	5	1	4
Calcium	ppm	ASTM D5185m	1424	1470	1466
Phosphorus	ppm	ASTM D5185m	387	395	406
Zinc	ppm	ASTM D5185m	440	430	454
Sulfur	ppm	ASTM D5185m	2388	2320	2444

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >200	50	43	57
Sodium	ppm	ASTM D5185m	0	0	1
Potassium	ppm	ASTM D5185m >20	0	0	<1

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0	0.1
Nitration	Abs/cm	*ASTM D7624 >20	4.8	4.9	5.0
Sulfation	Abs/.1mm	*ASTM D7415 >30	15.0	15.5	15.2


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	9.3	9.5	9.5
Acid Number (AN)	mg KOH/g	ASTM D8045	0.45	0.50	0.29
Base Number (BN)	mg KOH/g	ASTM D2896	7.40	6.36	7.31




OIL ANALYSIS REPORT

Ferrous Alloys

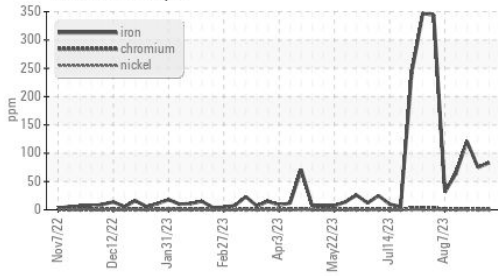

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


Acid Number

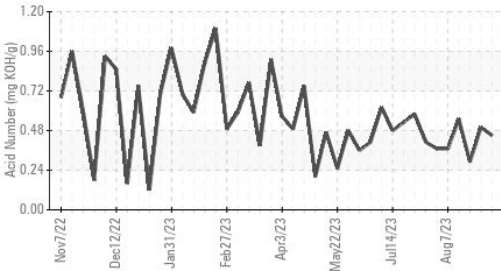


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.1	13.1	13.1

GRAPHS


Base Number

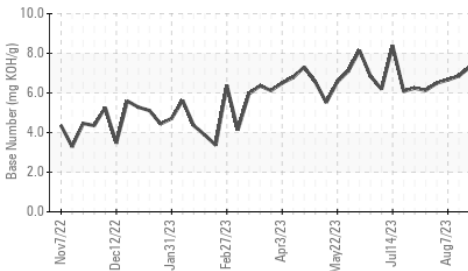


Iron (ppm)

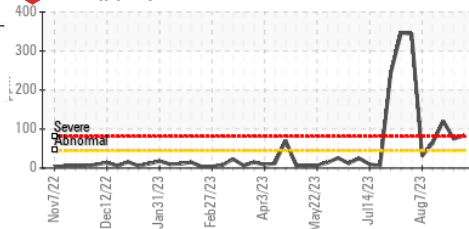


Lead (ppm)

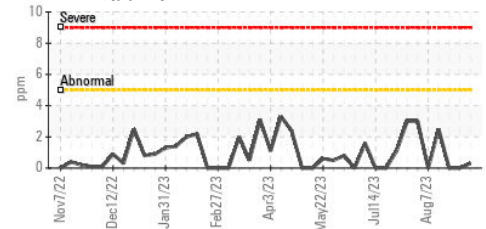


Aluminum (ppm)

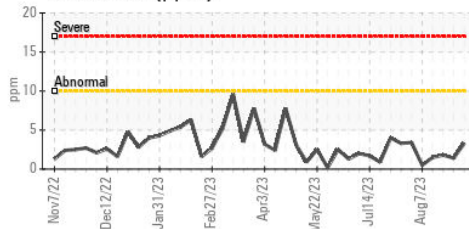


Chromium (ppm)

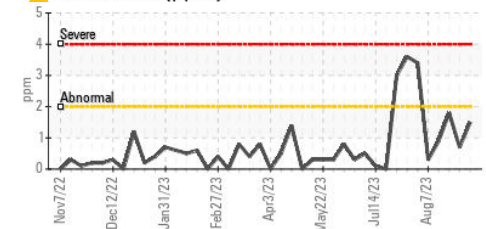


Viscosity @ 100°C

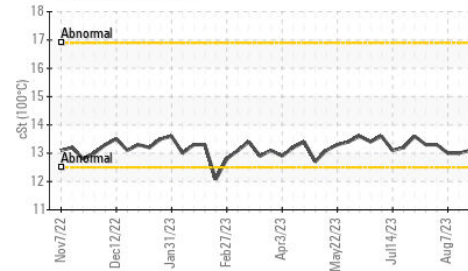


Copper (ppm)

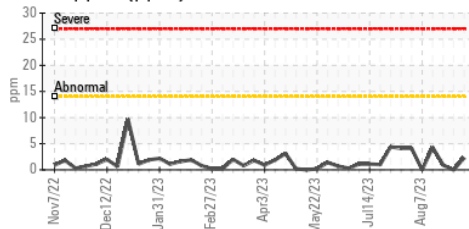


Silicon (ppm)

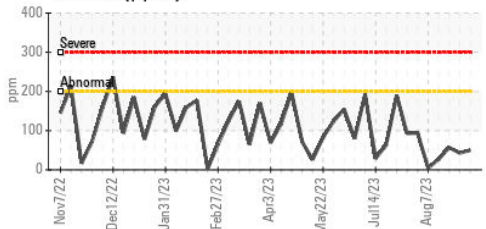

Viscosity @ 100°C

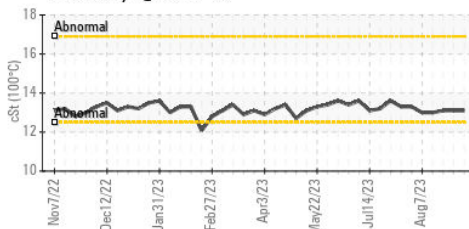

Base Number

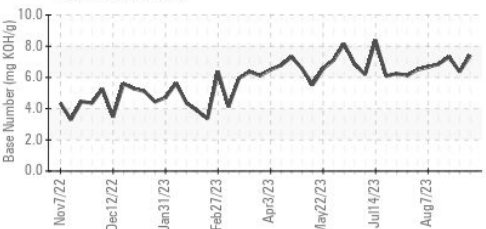

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0836324 **Received** : 17 Aug 2023
Lab Number : 05927428 **Diagnosed** : 18 Aug 2023
Unique Number : 10607375 **Diagnostician** : Angela Borella
Test Package : MOB 2

OAK GROVE KS
 1150 E 700TH AVE
 ARCADIA, KS
 US 66711

Contact: KALEB WEAVER
 kaleb.weaver@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: