

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

KAESER CSD 100 8862403 (S/N 1244)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2023	Aug2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05927836	KC100841	
Sample Date		Client Info		08 Aug 2023	27 Apr 2023	
Machine Age	hrs	Client Info		3972	1506	
Oil Age	hrs	Client Info		0	1506	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	5	9	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	9	1	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	7	<1	
Calcium	ppm	ASTM D5185m	2	1	0	
Phosphorus	ppm	ASTM D5185m		23	56	
Zinc	ppm	ASTM D5185m		2	<1	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	1	
Sodium	ppm	ASTM D5185m		2	0	
Potassium	ppm	ASTM D5185m	>20	2	1	
Water	%	ASTM D6304	>0.05	0.007	0.003	
ppm Water	ppm	ASTM D6304	>500	74.0	36.1	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		497	5590	
Particles >6µm		ASTM D7647	>1300	113	<u> </u>	
Particles >14µm		ASTM D7647	>80	8	A 239	
Particles >21µm		ASTM D7647	>20	3	A 38	
Particles >38µm		ASTM D7647	>4	0	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/14/10	▲ 20/18/15	
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.28	0.12	
. ,						



Water

Viscosity @ 40°C

1.20

0.9 <u>ل</u>ة 0.72

2²0.48

0.2

0.00

52


50


48

() 46 to 44

OIL ANALYSIS REPORT





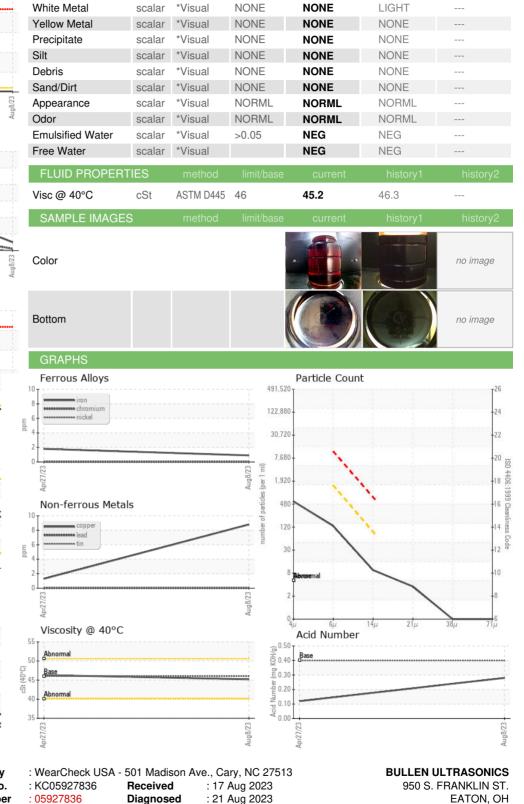

: Don Baldridge

47 Abnorm 40 38 Apr27/23 Particle Trend Ê 5 ŦE 3 3 21 0 Laboratory Sample No. Lab Number Unique Number Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: 10607783

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnostician

US 45320

Contact: SERVICE MANAGER