




# PROBLEM SUMMARY

Sample Rating Trend

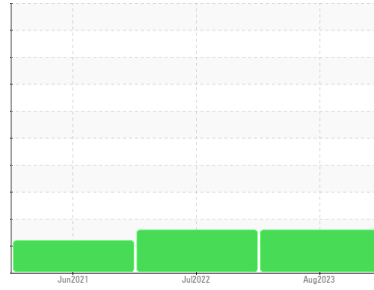

**WATER**




Machine Id  
**7245792 (S/N 1452)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Water

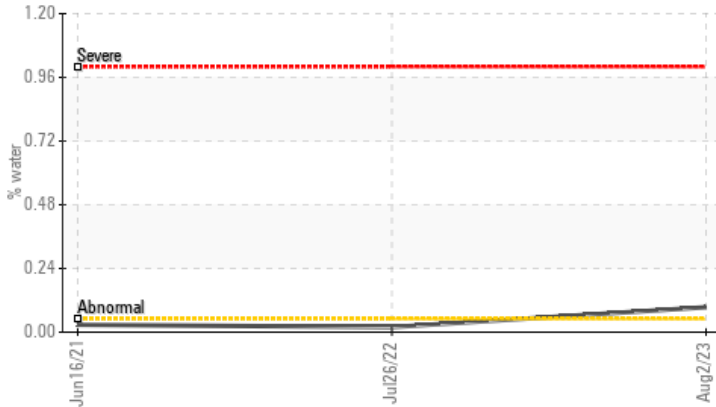

## RECOMMENDATION

The filter change at the time of sampling has been noted. We were unable to perform a particle count on this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.05	▲ <b>0.094</b>	0.019	0.028
ppm Water	ppm	ASTM D6304	>500	▲ <b>940</b>	191.9	285.7

Customer Id: WINWINNJ  
Sample No.: KCPA005953  
Lab Number: 05927851  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

## HISTORICAL DIAGNOSIS

### 26 Jul 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 16 Jun 2021 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report



# OIL ANALYSIS REPORT

Sample Rating Trend

**WATER**

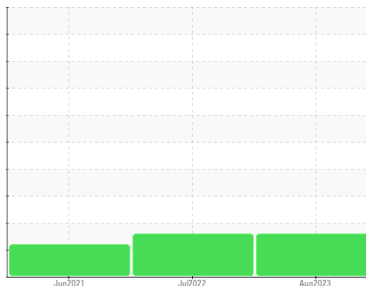

Machine Id  
**7245792 (S/N 1452)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

The filter change at the time of sampling has been noted. We were unable to perform a particle count on this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a light concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA005953</b>	KCP44126	KCP33914
Sample Date	Client Info			<b>02 Aug 2023</b>	26 Jul 2022	16 Jun 2021
Machine Age	hrs	Client Info		<b>8582</b>	5655	2872
Oil Age	hrs	Client Info		<b>0</b>	5655	2872
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>10</b>	6	3
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	<1	14
Barium	ppm	ASTM D5185m	90	<b>0</b>	<1	6
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>23</b>	47	61
Calcium	ppm	ASTM D5185m	2	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m		<b>3</b>	0	5
Zinc	ppm	ASTM D5185m		<b>7</b>	6	2
Sulfur	ppm	ASTM D5185m		<b>19958</b>	18624	15428

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>8</b>	30	16
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	9	9
Water	%	ASTM D6304	>0.05	<b>▲ 0.094</b>	0.019	0.028
ppm Water	ppm	ASTM D6304	>500	<b>▲ 940</b>	191.9	285.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>---</b>	5613	3542
Particles >6µm		ASTM D7647	>1300	<b>---</b>	▲ 2315	▲ 1762
Particles >14µm		ASTM D7647	>80	<b>---</b>	▲ 239	▲ 266
Particles >21µm		ASTM D7647	>20	<b>---</b>	▲ 35	▲ 63
Particles >38µm		ASTM D7647	>4	<b>---</b>	1	2
Particles >71µm		ASTM D7647	>3	<b>---</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>---</b>	▲ 20/18/15	▲ 18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.33</b>	0.32	0.337


# OIL ANALYSIS REPORT

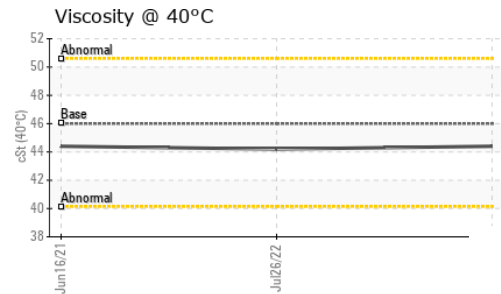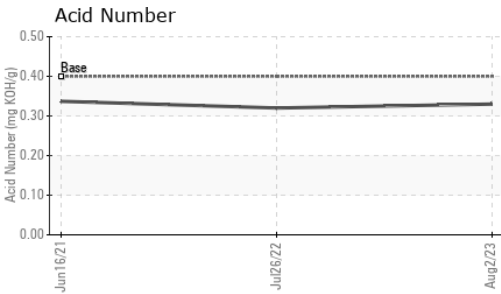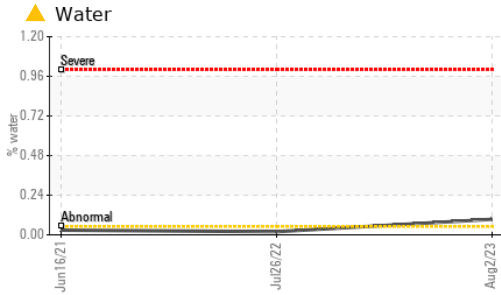





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>MODER</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>0.2%</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	<b>44.4</b>	44.2	44.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

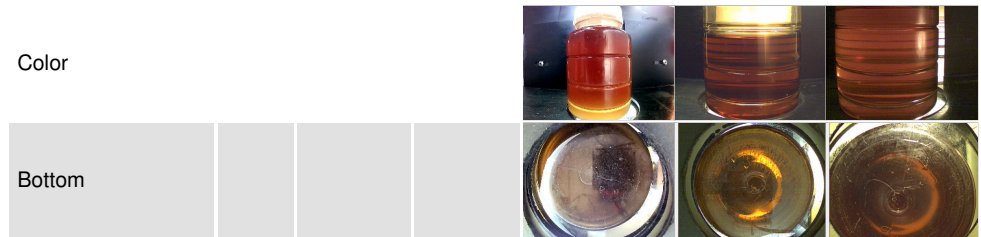

## GRAPHS

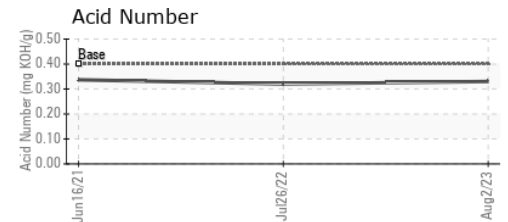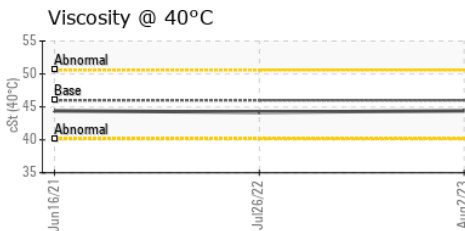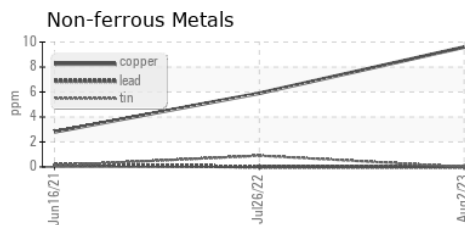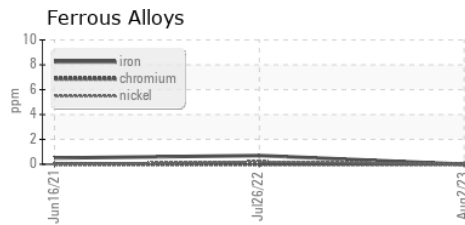

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : KCPA005953 Received : 17 Aug 2023  
 Lab Number : 05927851 Diagnosed : 18 Aug 2023  
 Unique Number : 10607798 Diagnostician : Doug Bogart  
 Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**WING IT INNOVATIONS LLC**  
 92 N MAIN ST, BLDG 11  
 WINDSOR, NJ  
 US 08561  
 Contact: K COYLE  
 KCOYLE@WINGITS.COM

T:  
F: