

FUEL REPORT

Sample Rating Trend



ISO

Machine Id Component **Diesel Fuel** NOT GIVEN (--- GAL)

DIAGNOSIS

A Recommendation

We advise that you filter this fluid before use. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a high amount of particulates present in the fuel. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC05927963		
Sample Date		Client Info		17 Aug 2023		
Machine Age	hrs	Client Info		0		
Sample Status				ATTENTION		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		0.859		
Fuel Color	text	*Visual Screen		Red		
ASTM Color	scalar	*ASTM D1500		L4.5		
Visc @ 40°C	cSt	ASTM D445		2.79		
Pensky-Martens Flash Point	°C	*PMCC Calculated		58		
SULFUR CONTER	T	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0		
Sulfur (UVF)	ppm	ASTM D5453		12		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		163		
5% Distillation Point	°C	ASTM D86		196		
10% Distill Point	°C	ASTM D86		210		
15% Distillation Point	°C	ASTM D86		219		
20% Distill Point	°C	ASTM D86		225		
30% Distill Point	°C	ASTM D86		239		
40% Distill Point	°C	ASTM D86		251		
50% Distill Point	°C	ASTM D86		264		
60% Distill Point	°C	ASTM D86		278		
70% Distill Point	°C	ASTM D86		292		
80% Distill Point	°C	ASTM D86		308		
85% Distillation Point	°C	ASTM D86		317		
90% Distill Point	°C	ASTM D86		329		
95% Distillation Point	°C	ASTM D86		346		
Final Boiling Point	°C	ASTM D86		355		
Distillation Residue	%	ASTM D86		1.4		
Distillation Loss	%	ASTM D86		0.5		
IGNITION QUALIT	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D7777		33.2		
Cetane Index		ASTM D4737	<40.0	42.8		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	<1		
Potassium	ppm	ASTM D5185m	<0.1	0		
Water	%	ASTM D6304	<0.05	0.003		
ppm Water	ppm	ASTM D6304	<500	35.7		
% Gasoline	%	*In-House	<0.50	0.0		
% Biodiesel	%	*In-House	<20.0	0.0		




number of particles (per 1

10

回語

% 20%

FUEL REPORT

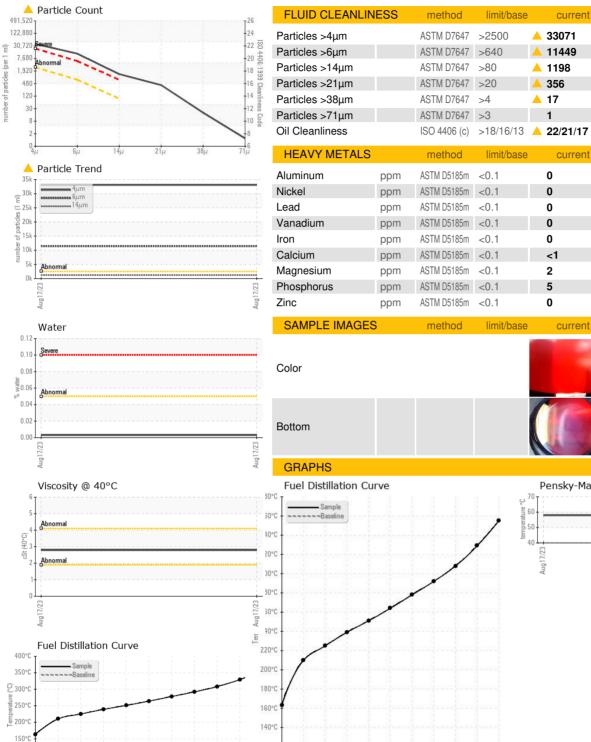

120°C

%0

%0% %0% 10% 20% 30% 40% 20% %09 %0L 80% %06 Pensky-Martens Flash Point (°C)

history1

historv1

history1

no image

no image

history2

history2

history2

no image

no image



	Percent Recovered					
	1	Laboratory	ALEDONIA FARMERS ELEVATOR			
		Sample No.	: WC05927963	Received	: 17 Aug 2023	2166 E CLINTON TRAIL
		Lab Number	: 05927963	Diagnosed	: 23 Aug 2023	CHARLOTTE, MI
F	TESTING LABORATORY	Unique Number	: 10607910	Diagnostician	: Doug Bogart	US 48813
	Certificate L2367	Test Package	Contact: WILLIAM FISHER			
	To discuss this	s sample report, o	contact Customer Se	ervice at 1-800-23	7-1369.	wfisher@cfeco.com
* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.						T: (517)543-1160
				,	ance decision rule (JCGM 106	:2012) F:

Contact/Location: WILLIAM FISHER - CFECHA