

OIL ANALYSIS REPORT

SAMPLE INFORMATION method limit/base

[185235-N2STV4W]

E-12

Component

Hydraulic System

AW HYDRAULIC OIL ISO 46 (45 GAL)

Sample Rating Trend



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.


Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

O/ (IVII EE IIVI OT (IV		method	IIIIII basc	Current	Thistory	111010172
Sample Number		Client Info		PH05928123		
Sample Date		Client Info		17 Feb 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		mathad	limit/bass	ou irront	historia	history ()
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		<1		
Aluminum	ppm	ASTM D5185m	>20	0		
Lead	ppm	ASTM D5185m	>20	<1		
Copper	ppm	ASTM D5185m	>20	6		
Tin	ppm	ASTM D5185m	>20	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVE O	• •		12 25 /1		111	1::
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0		
Barium	ppm	ASTM D5185m	5	0		
Molybdenum	ppm	ASTM D5185m	5	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	25	0		
Calcium	ppm	ASTM D5185m	200	49		
Phosphorus	ppm	ASTM D5185m	300	376		
Zinc	ppm	ASTM D5185m	370	474		
Sulfur	ppm	ASTM D5185m	2500	1199		
CONTANAINIANITO		ام مالم میر	lineit/leeee	aa.b	lai ata mud	history.O
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	4		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	137		
Particles >6µm		ASTM D7647	>2500	35		
Particles >14µm		ASTM D7647	>320	7		
Particles >21µm		ASTM D7647	>80	1		
Particles >38µm		ASTM D7647	>20	0		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness				14/12/10		
On Oleanilliess		ISO 4406 (c)	>20/18/15	14/12/10		
ELLUB BEOBABA						



FLUID DEGRADATION


Acid Number (AN)

mg KOH/g ASTM D8045 0.57

0.36



OIL ANALYSIS REPORT

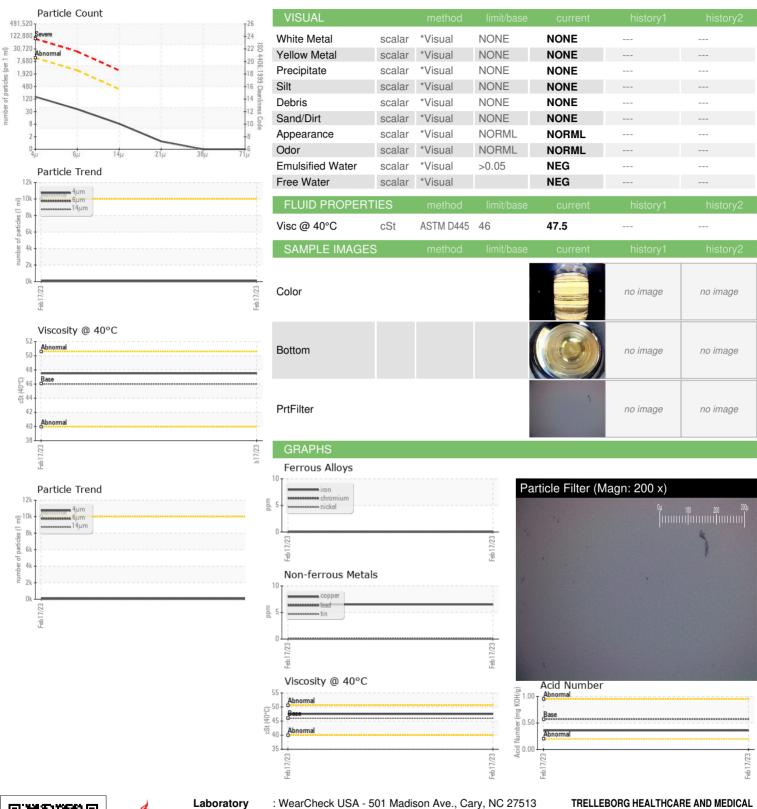





Laboratory Sample No. Lab Number

: 05928123 : 10608070 **Unique Number**

Diagnostician : Jonathan Hester Test Package : PLANT (Additional Tests: PrtFilter)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: PH05928123

Certificate L2367

TRELLEBORG HEALTHCARE AND MEDICAL

3077 ROLLIE GATE DR PASO POBLES, CA US 93446

Contact: DARRYL DRUM

DARRYL.DRUM@TRELLEBORG.COM

T: (805)239-4284 F:

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received

Diagnosed

: 18 Aug 2023

: 22 Aug 2023