




# PROBLEM SUMMARY

## Sample Rating Trend

ISO




Area  
**HIGHLAND [600380498]**  
 Machine Id  
**20WEA80827**  
 Component  
**Wind Turbine Gearbox**  
 Fluid  
**MOBIL XMP 320 (--- LTR)**

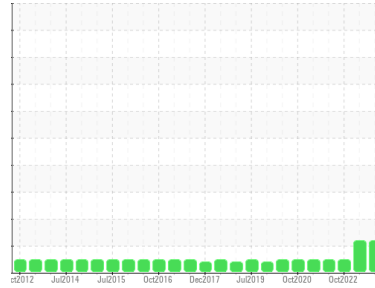

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

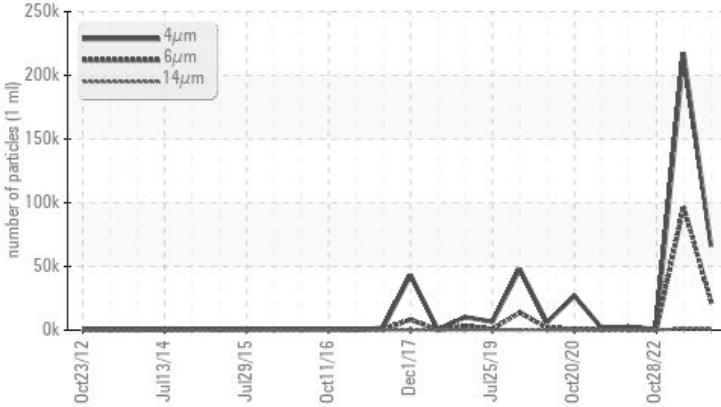

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	NORMAL
Particles >6µm	ASTM D7647	>2500	▲ <b>23019</b>	▲ 96721	83
Particles >14µm	ASTM D7647	>320	▲ <b>817</b>	▲ 1052	6
Oil Cleanliness	ISO 4406 (c)	>--/18/15	▲ <b>23/22/17</b>	▲ 25/24/17	17/14/10

Customer Id: NORHIG  
 Sample No.: NX05928196  
 Lab Number: 05928196  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS

### 12 Jan 2023 Diag: Doug Bogart

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 28 Oct 2022 Diag: Angela Borella

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 11 May 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report






# OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area  
**HIGHLAND [600380498]**  
 Machine Id  
**20WEA80827**  
 Component  
**Wind Turbine Gearbox**  
 Fluid  
**MOBIL XMP 320 (--- LTR)**

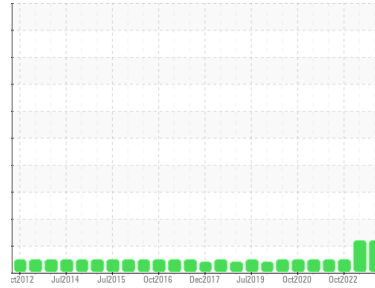

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>NX05928196</b>	NX05766517	NX05700255
Sample Date	Client Info		<b>26 Jun 2023</b>	12 Jan 2023	28 Oct 2022
Machine Age	mths	Client Info	<b>0</b>	0	0
Oil Age	mths	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>80	<b>12</b>	30	11	
Iron	ppm	ASTM D5185m	>150	<b>126</b>	70	65
Chromium	ppm	ASTM D5185m	>5	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>1</b>	1	1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	10
Manganese	ppm	ASTM D5185m		<b>1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	1	0
Calcium	ppm	ASTM D5185m		<b>0</b>	0	13
Phosphorus	ppm	ASTM D5185m	315	<b>376</b>	363	363
Zinc	ppm	ASTM D5185m		<b>33</b>	31	29
Sulfur	ppm	ASTM D5185m		<b>14330</b>	12980	13529

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Water	%	ASTM D6304	>0.05	<b>0.013</b>	0.008	0.016
ppm Water	ppm	ASTM D6304	>500	<b>131.1</b>	82.0	160.8






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>66173</b>	217268	717
Particles >6µm	ASTM D7647	>2500	<b>▲ 23019</b>	▲ 96721	83
Particles >14µm	ASTM D7647	>320	<b>▲ 817</b>	▲ 1052	6
Particles >21µm	ASTM D7647	>80	<b>53</b>	75	2
Particles >38µm	ASTM D7647	>20	<b>1</b>	2	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/18/15	<b>▲ 23/22/17</b>	▲ 25/24/17	17/14/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>1.17</b>	1.17	1.19

# OIL ANALYSIS REPORT

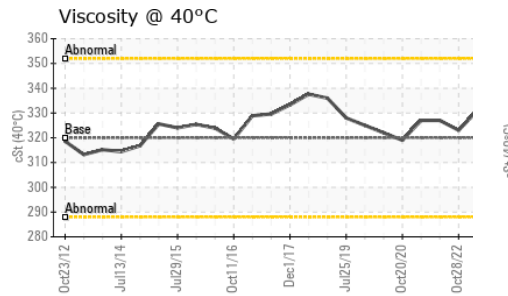
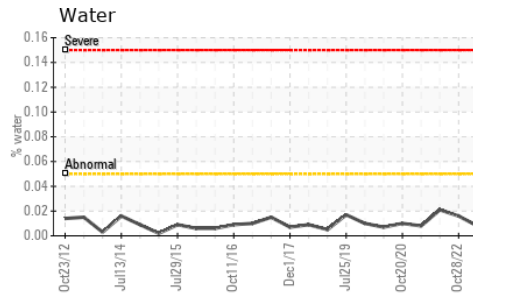
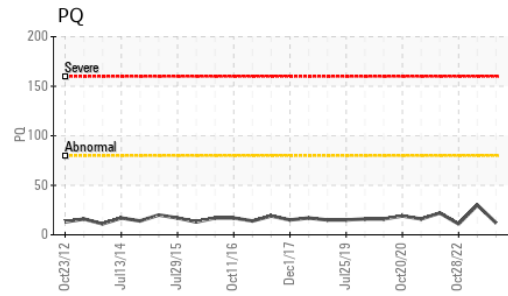
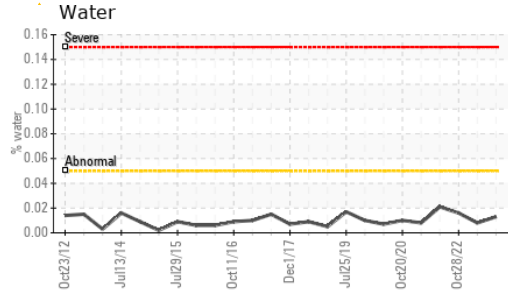
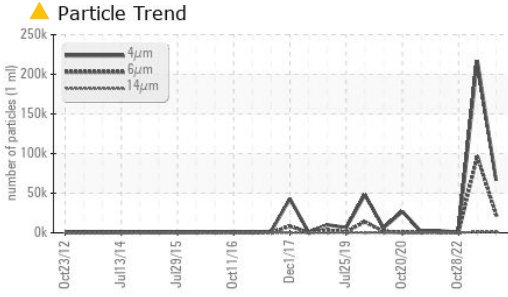


VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	LIGHT	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	331	323

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

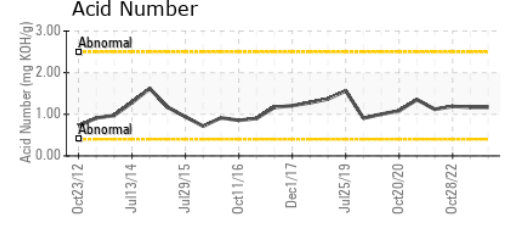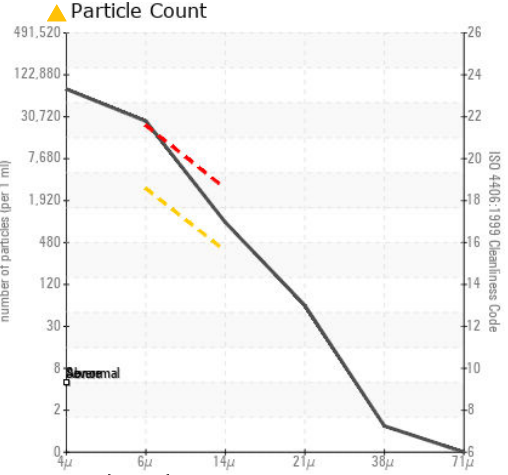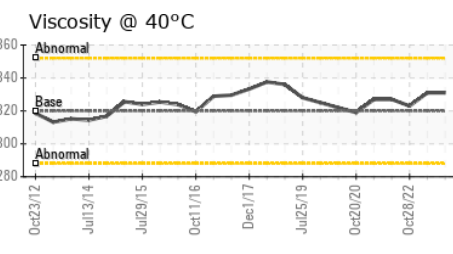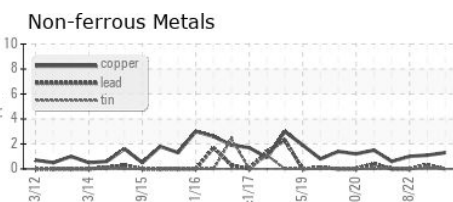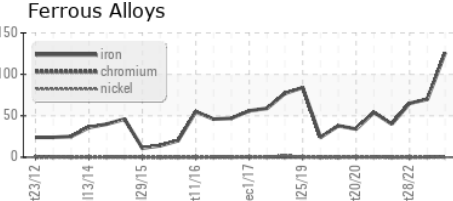

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : NX05928196 **Received** : 18 Aug 2023  
**Lab Number** : 05928196 **Diagnosed** : 21 Aug 2023  
**Unique Number** : 10608143 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**NORDEX USA - HIGHLAND & HIGHLAND NORTH**  
 300 SOUTH WACKER DRIVE, SUITE 1500  
 CHICAGO, IL  
 US 60606  
 Contact: Robert Warner  
 rwarner@everpower.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:  
 F: x: