




# PROBLEM SUMMARY

Sample Rating Trend

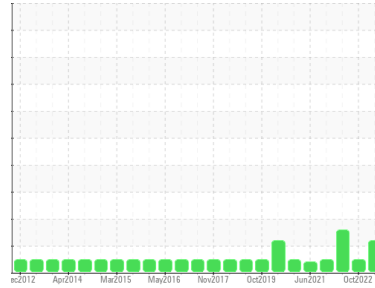

## VISUAL METAL



Area  
**HIGHLAND [600380494]**  
 Machine Id  
**16WEA80823**  
 Component  
**Wind Turbine Gearbox**  
 Fluid  
**MOBIL XMP 320 (--- LTR)**

### COMPONENT CONDITION SUMMARY

No relevant graphs to display


### RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. We were unable to perform a particle count due to metal particles present in this sample.

### PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	ABNORMAL
White Metal	scalar	*Visual	NONE	▲ MODER	NONE	LIGHT

**Customer Id:** NORHIG  
**Sample No.:** NX05928204  
**Lab Number:** 05928204  
**Test Package:** IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Inspect Wear Source	---	---	?	We advise that you inspect for the source(s) of wear.
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.
Alert	---	---	?	We were unable to perform a particle count due to metal particles present in this sample.

## HISTORICAL DIAGNOSIS

### 25 Oct 2022 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 21 Jun 2022 Diag: Don Baldrige

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 02 Dec 2021 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report






# OIL ANALYSIS REPORT

Sample Rating Trend

VISUAL METAL

Area  
**HIGHLAND [600380494]**  
 Machine Id  
**16WEA80823**  
 Component  
**Wind Turbine Gearbox**  
 Fluid  
**MOBIL XMP 320 (--- LTR)**

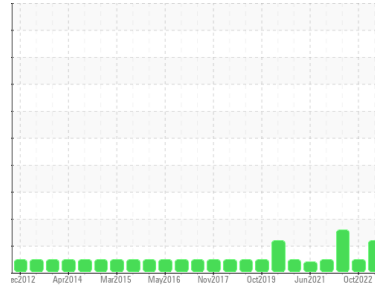

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. We were unable to perform a particle count due to metal particles present in this sample.

### Wear

Moderate concentration of visible metal present. All component wear rates are normal.

### Contamination

No other contaminants were detected in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>NX05928204</b>	NX05700288	NX05602765
Sample Date	Client Info		<b>07 Jun 2023</b>	25 Oct 2022	21 Jun 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>80	<b>15</b>	7	18	
Iron	ppm	ASTM D5185m	>150	<b>74</b>	60	53
Chromium	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>1</b>	1	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	>5	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>9</b>	2	17
Manganese	ppm	ASTM D5185m		<b>1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	0
Calcium	ppm	ASTM D5185m		<b>8</b>	3	5
Phosphorus	ppm	ASTM D5185m	315	<b>366</b>	378	222
Zinc	ppm	ASTM D5185m		<b>25</b>	22	12
Sulfur	ppm	ASTM D5185m		<b>14765</b>	14580	8933

## CONTAMINANTS





	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	0
Sodium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Water	%	ASTM D6304	>0.05	<b>0.014</b>	0.014	0.020
ppm Water	ppm	ASTM D6304	>500	<b>140.6</b>	145.6	203.8

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>---</b>	1836	96415
Particles >6µm	ASTM D7647	>2500	<b>---</b>	309	▲ 58675
Particles >14µm	ASTM D7647	>320	<b>---</b>	20	▲ 4922
Particles >21µm	ASTM D7647	>80	<b>---</b>	5	▲ 295
Particles >38µm	ASTM D7647	>20	<b>---</b>	0	8
Particles >71µm	ASTM D7647	>4	<b>---</b>	0	2
Oil Cleanliness	ISO 4406 (c)	>--/18/15	<b>---</b>	18/15/11	▲ 24/23/19



# OIL ANALYSIS REPORT

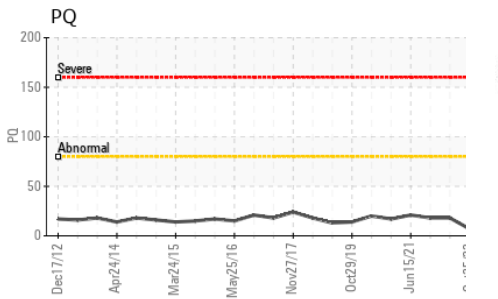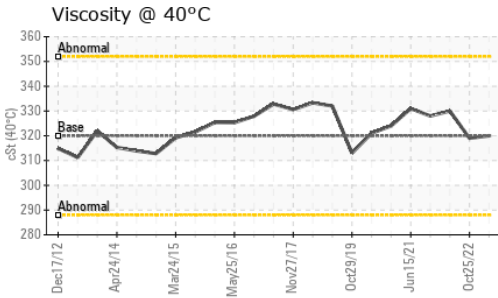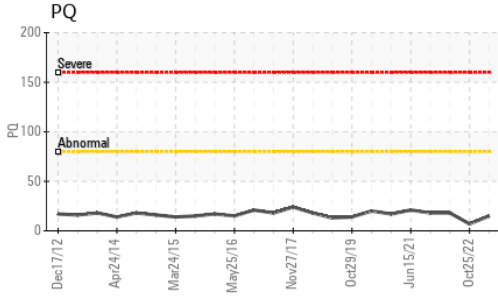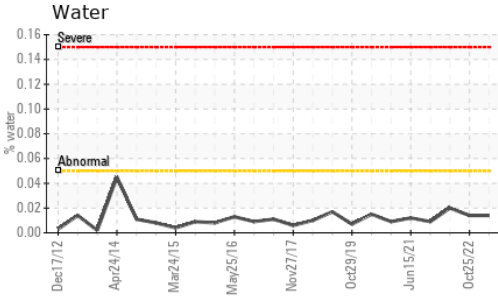

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>1.19</b>	1.14	0.97


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	▲ <b>MODER</b>	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	<b>320</b>	319	330





SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color

Bottom

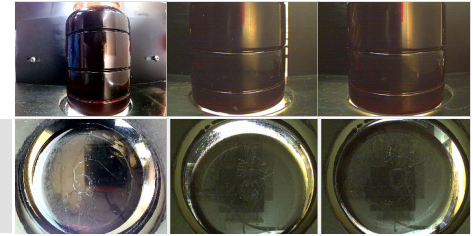

## GRAPHS

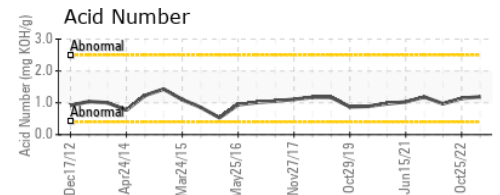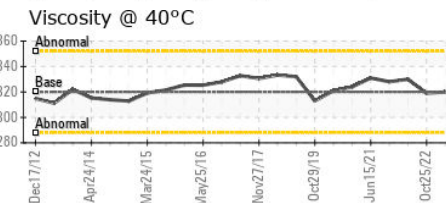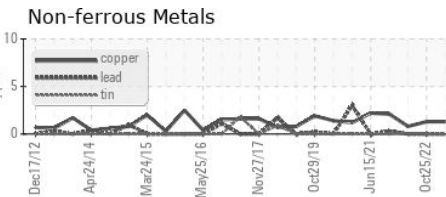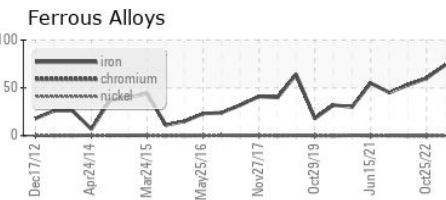

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : NX05928204 **Received** : 18 Aug 2023  
**Lab Number** : **05928204** **Diagnosed** : 21 Aug 2023  
**Unique Number** : 10608151 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**NORDEX USA - HIGHLAND & HIGHLAND NORTH**  
 300 SOUTH WACKER DRIVE, SUITE 1500  
 CHICAGO, IL  
 US 60606  
 Contact: Robert Warner  
 rwarner@everpower.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:

F: x: