

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

BUSCH VM6 / VP-2 (S/N 2512909)

Pump Fluid USPI VAC 100 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.








SAMPLE INFORM	IATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		USPM29231	USPM28924	USPM26262		
Sample Date		Client Info		19 Aug 2023	11 May 2023	26 Jan 2023		
Machine Age	hrs	Client Info		0	0	0		
Oil Age	hrs	Client Info		0	0	0		
Oil Changed		Client Info		N/A	N/A	N/A		
Sample Status				NORMAL	ABNORMAL	ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>90	1	3	14		
Chromium	ppm	ASTM D5185m	>5	<1	0	0		
Nickel	ppm	ASTM D5185m	>5	0	0	0		
Titanium	ppm	ASTM D5185m	>3	0	<1	0		
Silver	ppm	ASTM D5185m	>3	0	0	0		
Aluminum	ppm	ASTM D5185m	>7	2	7	<1		
Lead	ppm	ASTM D5185m	>12	0	0	0		
Copper	ppm	ASTM D5185m	>30	0	0	0		
Tin	ppm	ASTM D5185m	>9	0	<1	<1		
Vanadium	ppm	ASTM D5185m		<1	<1	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	0	0	0	0		
Barium	ppm	ASTM D5185m	0	0	0	0		
Molybdenum	ppm	ASTM D5185m	0	<1	0	0		
Manganese	ppm	ASTM D5185m		0	<1	0		
Magnesium	ppm	ASTM D5185m	0	<1	10	0		
Calcium	ppm	ASTM D5185m	0	2	1	1		
Phosphorus	ppm	ASTM D5185m	1800	595	1286	1481		
Zinc	ppm	ASTM D5185m	0	0	12	4		
Sulfur	ppm	ASTM D5185m	0	11	0	36		
CONTAMINANTS		method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>60	1	2	<1		
Sodium	ppm	ASTM D5185m		3	1	3		
Potassium	ppm	ASTM D5185m	>20	2	7	<1		
Water	%	ASTM D6304		0.045	0.058	0.022		
ppm Water	ppm	ASTM D6304	>.1	458.6	581.9	220.8		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647	>5000	1133				
Particles >6µm		ASTM D7647	>1300	347				
Particles >14µm		ASTM D7647	>160	45				
Particles >21µm		ASTM D7647	>40	18				
Particles >38µm		ASTM D7647	>10	1				
Particles >71µm		ASTM D7647	>3	1				
Oil Cleanliness		ISO 4406 (c)	>19/17/14	17/16/13				
FLUID DEGRADATION method limit/base current history1 history2								
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.26	0.23	0.29		



OIL ANALYSIS REPORT






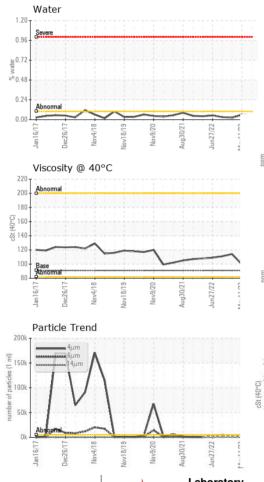

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	🔺 MODER	🔺 MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual		NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	91	99.9	99.6	114
SAMPLE IMAGES	S	method	limit/base	current	history1	history2
Color						

Bottom

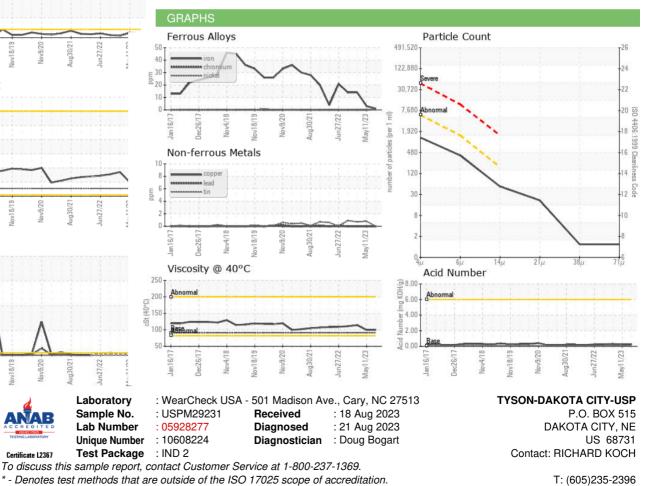

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Contact/Location: RICHARD KOCH - IBPDAK01