




# OIL ANALYSIS REPORT

Sample Rating Trend

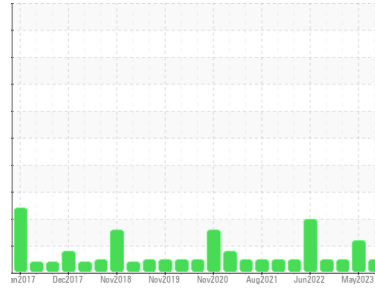

**NORMAL**



Machine Id  
**BUSCH VM9 / VP-2 (S/N 2512909)**

Component  
**Pump**  
Fluid  
**USPI VAC 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM29226</b>	USPM28933	USPM26271
Sample Date	Client Info		<b>19 Aug 2023</b>	11 May 2023	26 Jan 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ATTENTION	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>2</b>	2	1
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >7	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >12	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >30	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >9	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	1	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	2	<1
Phosphorus	ppm	ASTM D5185m 1800	<b>1617</b>	1730	1553
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>13</b>	8	22

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>1</b>	2	1
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>3</b>	1	0
Water	%	ASTM D6304	<b>0.051</b>	0.052	0.023
ppm Water	ppm	ASTM D6304 >.1	<b>516.7</b>	528.3	238.1

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>2718</b>	▲ 5141	2148
Particles >6µm	ASTM D7647	>1300	<b>866</b>	▲ 1691	763
Particles >14µm	ASTM D7647	>160	<b>93</b>	96	53
Particles >21µm	ASTM D7647	>40	<b>28</b>	13	12
Particles >38µm	ASTM D7647	>10	<b>3</b>	3	1
Particles >71µm	ASTM D7647	>3	<b>1</b>	1	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>19/17/14</b>	▲ 20/18/14	18/17/13

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.34</b>	0.31	0.27




# OIL ANALYSIS REPORT

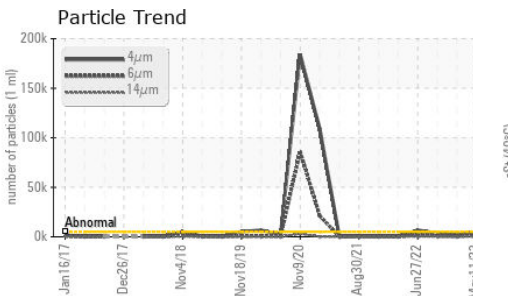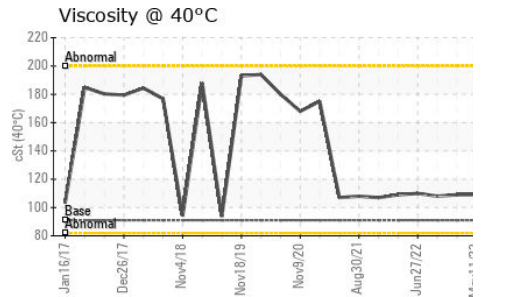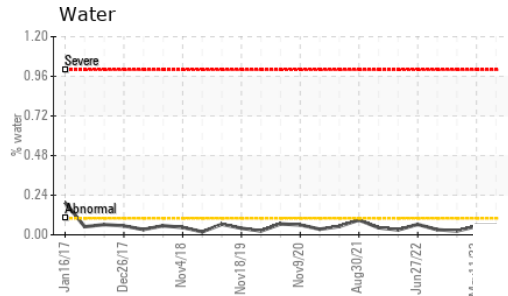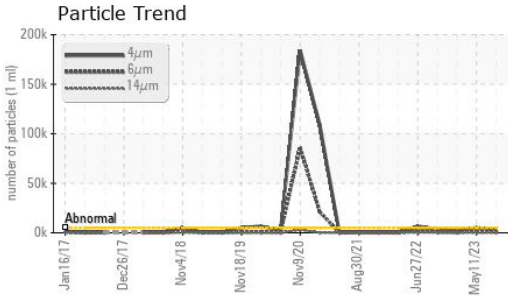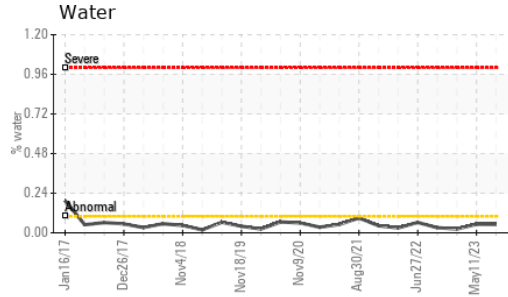






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	<b>110</b>	109	109

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

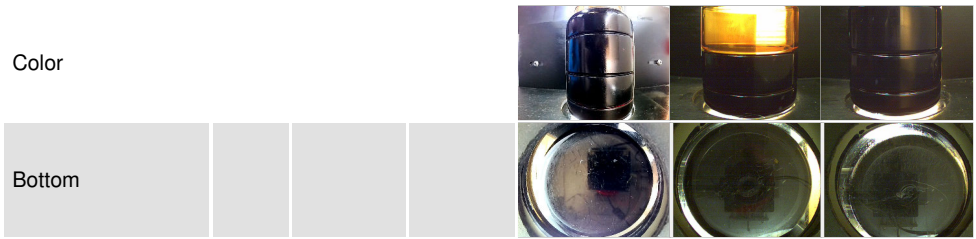

## GRAPHS

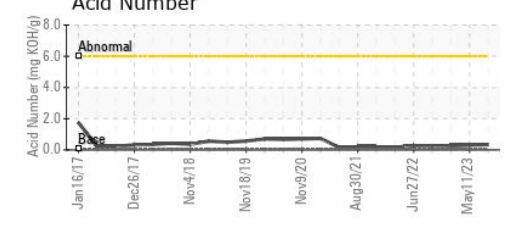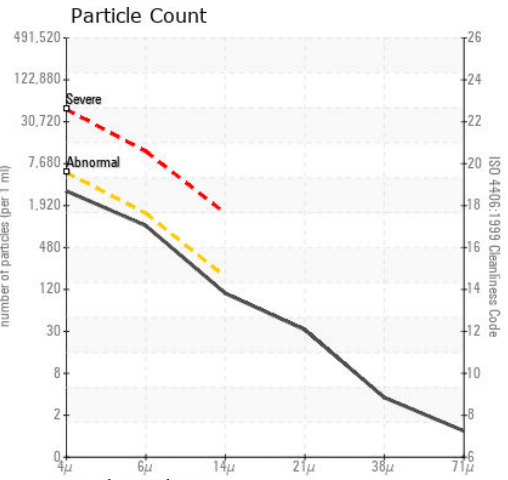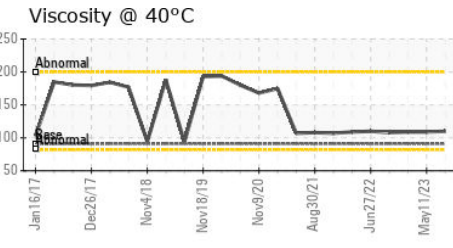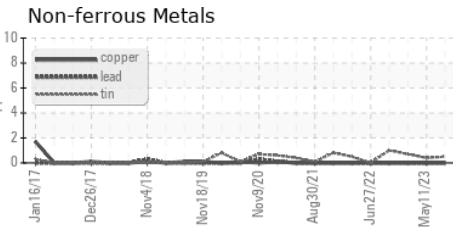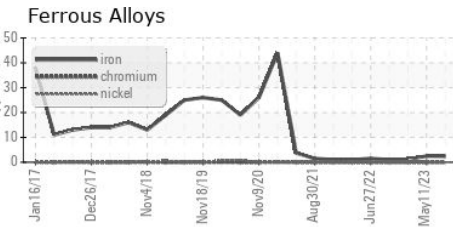

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM29226 **Received** : 18 Aug 2023  
**Lab Number** : **05928280** **Diagnosed** : 22 Aug 2023  
**Unique Number** : 10608227 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**TYSON-DAKOTA CITY-USP**  
 P.O. BOX 515  
 DAKOTA CITY, NE  
 US 68731  
 Contact: RICHARD KOCH

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (605)235-2396  
 F: (605)235-2960