




PROBLEM SUMMARY

Sample Rating Trend

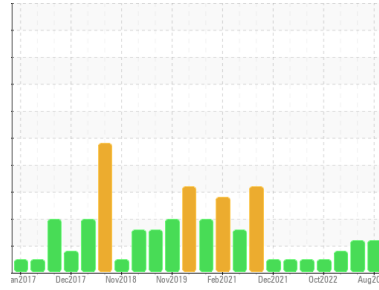

ISO



Machine Id
BUSCH VM4 / VP-3 (S/N 2512909)

Component


Pump

Fluid

USPI VAC 100 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

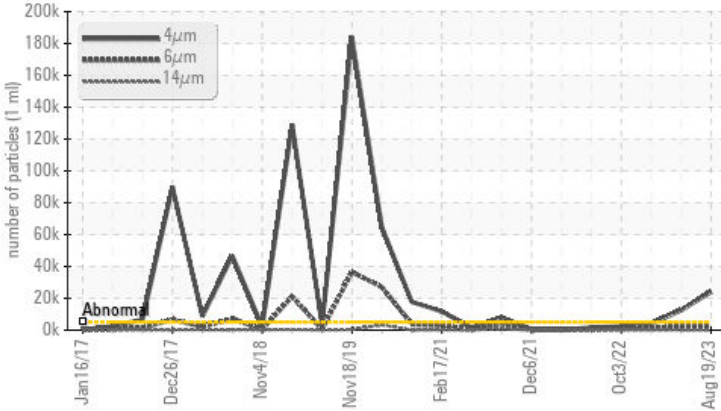

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ATTENTION
Particles >4µm	ASTM D7647	>5000	▲ 23961	▲ 12495	3899
Particles >6µm	ASTM D7647	>1300	▲ 2762	▲ 2502	▲ 1465
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 22/19/13	▲ 21/19/12	▲ 19/18/14

Customer Id: IBPDAK01
 Sample No.: USPM29266
 Lab Number: 05928288
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

11 May 2023 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



26 Jan 2023 Diag: Jonathan Hester

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



03 Oct 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

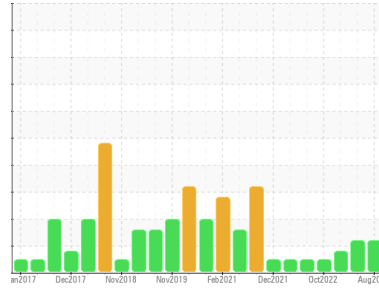

Machine Id
BUSCH VM4 / VP-3 (S/N 2512909)
 Component
Pump
 Fluid
USPI VAC 100 (--- GAL)

DIAGNOSIS

- Recommendation**
Resample at the next service interval to monitor.
- Wear**
All component wear rates are normal.
- Contamination**
There is a high amount of silt (particulates < 14 microns in size) present in the oil.
- Fluid Condition**
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USPM29266	USPM28919	USPM26257
Sample Date	Client Info	19 Aug 2023	11 May 2023	26 Jan 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >90	27	14	11
Chromium	ppm	ASTM D5185m >5	0	0	0
Nickel	ppm	ASTM D5185m >5	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >7	2	0	<1
Lead	ppm	ASTM D5185m >12	0	0	<1
Copper	ppm	ASTM D5185m >30	<1	<1	0
Tin	ppm	ASTM D5185m >9	<1	<1	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	<1	0
Barium	ppm	ASTM D5185m 0	0	2	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 0	2	<1	0
Calcium	ppm	ASTM D5185m 0	2	4	4
Phosphorus	ppm	ASTM D5185m 1800	1527	1438	1564
Zinc	ppm	ASTM D5185m 0	14	13	5
Sulfur	ppm	ASTM D5185m 0	8	2	17

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >60	3	2	2
Sodium	ppm	ASTM D5185m	2	0	1
Potassium	ppm	ASTM D5185m >20	3	2	0
Water	%	ASTM D6304	0.083	0.088	0.044
ppm Water	ppm	ASTM D6304 >.1	837.8	888.2	445.6

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	▲ 23961	▲ 12495	3899
Particles >6µm	ASTM D7647 >1300	▲ 2762	▲ 2502	▲ 1465
Particles >14µm	ASTM D7647 >160	63	39	91
Particles >21µm	ASTM D7647 >40	18	4	11
Particles >38µm	ASTM D7647 >10	1	2	1
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	▲ 22/19/13	▲ 21/19/12	▲ 19/18/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	2.51	2.49	2.73




OIL ANALYSIS REPORT

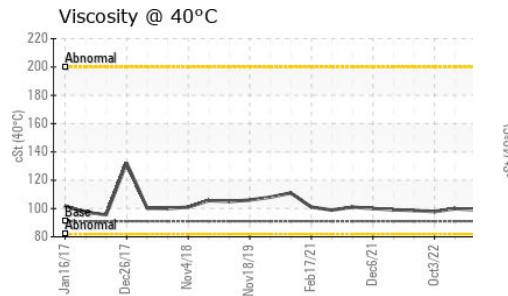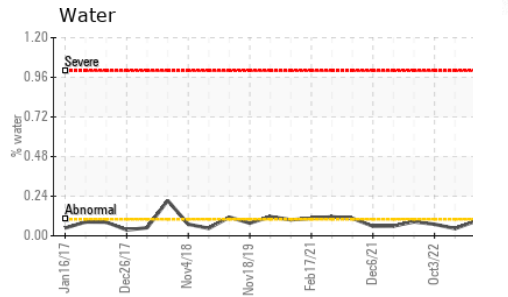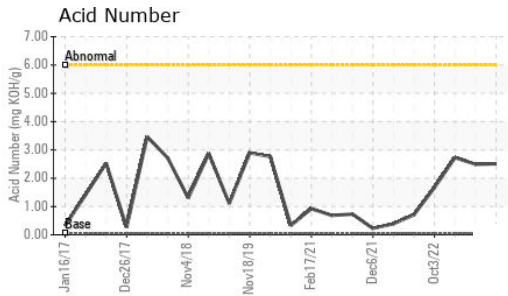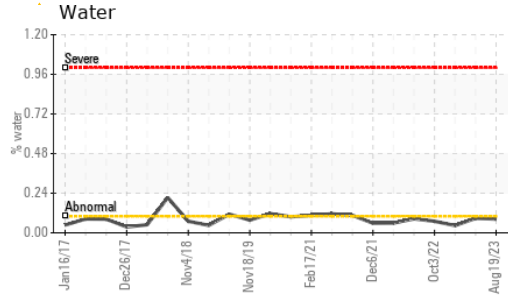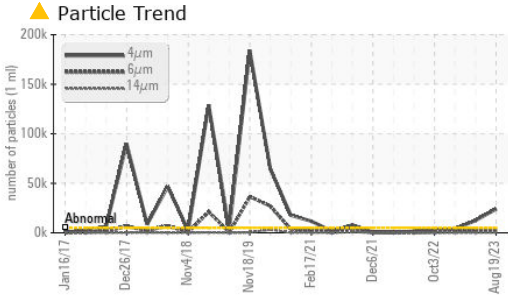





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	102	99.0	99.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

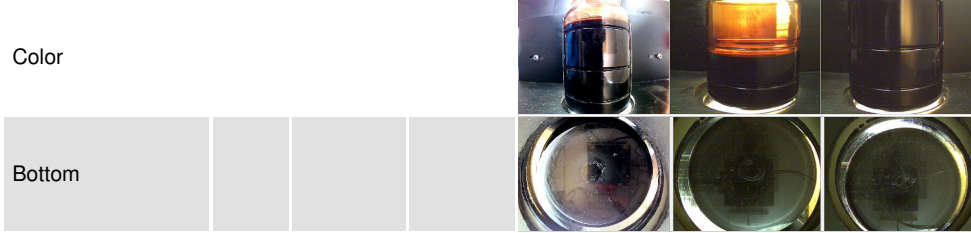

GRAPHS

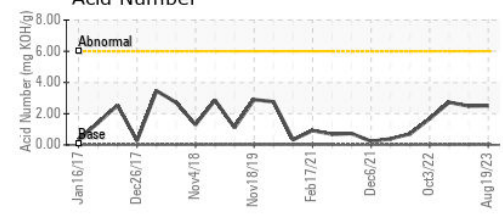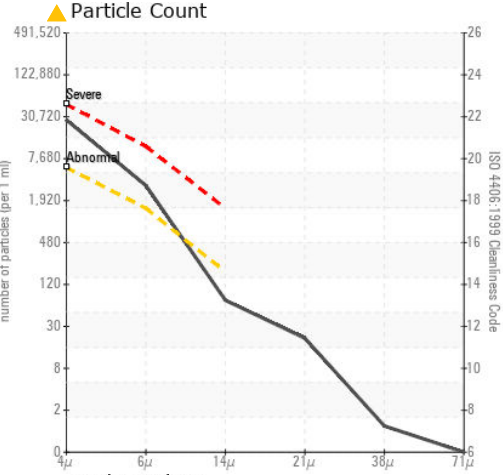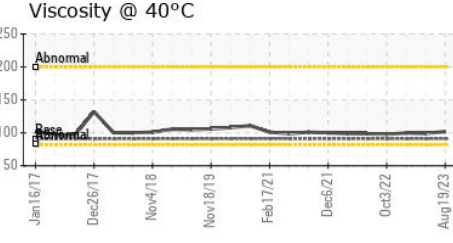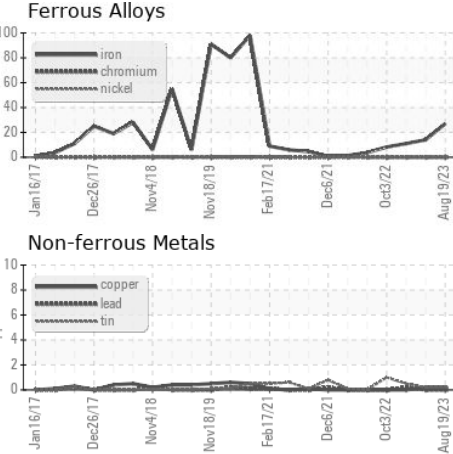

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM29266 **Received** : 18 Aug 2023
Lab Number : 05928288 **Diagnosed** : 22 Aug 2023
Unique Number : 10608235 **Diagnostician** : Doug Bogart
Test Package : IND 2

TYSON-DAKOTA CITY-USP
 P.O. BOX 515
 DAKOTA CITY, NE
 US 68731
 Contact: RICHARD KOCH

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (605)235-2396
 F: (605)235-2960